


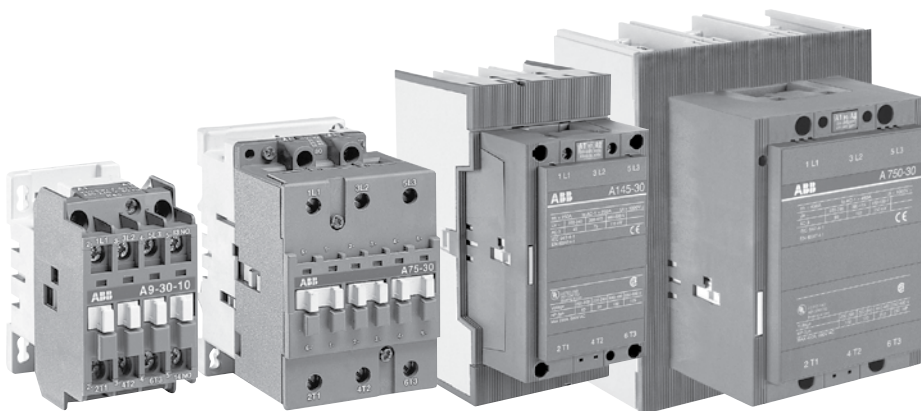

A9 - A110

- Maximum UL/CSA horsepower ratings according to UL508 and CSA22.2 No. 14
- Includes NEMA sizes 00 - 3
- CE mark
- Compact space saving design
- Standard auxiliary contact configurations:
 - A9 - A40 1 NO or 1 NC
 - A50 - A110 1 NO & 1 NC
- Contactor sizes A50 - A110 can be supplied without auxiliaries
- Additional auxiliary contact blocks are available
- D.C. ratings & D.C. control operation available
- Fast, snap-on DIN rail mounting
- Double break contact design
- Snap-on front mounted accessories include mechanical latch, pneumatic timer, and 1 & 4 pole auxiliary contact blocks
- Contactors ensure positive safety between their auxiliary contact blocks.
- Easy coil change
- Captive terminal screws
- NEMA, UL, IEC, CSA, VDE and most other international standards
- Touch safe design: All connection terminals are protected against accidental touch
- Terminals supplied open for ease of wiring
- Operates over an extended voltage range of 85% to 110% of rated control voltage
- Screwdriver guide holes
- UL File No: E39231 (A9 - A75); (AE9 - AE75); (AL9 - AL40); (AF50 - AF75)
- UL File No: E36588 (A95 - A110); (AE95 - AE110); (AF145 - AF750)
- CSA File No: LR56745 (A9 - A75); (AE9 - AE75); (AF50 - AF75)
- CSA File No: LR19700 (A95 - A110); (AE95 - AE110); (AF145 - AF750)
- CSA approved for elevator service

A145 - AF1650

- Maximum UL/CSA horsepower ratings according to UL508 and CSA22.2 No. 14
- Includes NEMA sizes 4 - 8
- CE mark
- 1 NO & 1 NC auxiliary contacts are standard and up to 6 additional auxiliary contacts may be added to provide a total of 8 (4 NO & 4 NC)
- Contactors ensure positive safety between their auxiliary contact blocks.
- D.C. ratings and D.C. control operation available
- Easy maintenance of main contacts and coil inspection
- Can be mounted in any position
- Terminal lugs sold separately. See page 1.25.
- Operates over an extended voltage range of 85% to 110% of rated control voltage
- NEMA, UL, IEC, CSA, VDE and most other international standards
- UL File No: E36588 (A/AF145 - AF750)
- UL File No: E73397 (AF1350 - AF1650)
- CSA File No: LR19700

A9 - A300

General information

AC operated, UL rated, 3 phase

Application

A-Line contactors are mainly used for controlling 3-phase motors and for controlling power circuits corresponding to their operating characteristics up to 690 and even 1000 VAC, and 440 VDC.

Description of 3 pole and 4 pole contactors A9 - A300

All A-Line contactors can be assembled side by side. The add-on or built-in auxiliary contacts are suitable for low level currents.

Control circuit types

- A-Line types: AC operated with laminated magnetic circuit.

Contactors types

- 3 pole contactors with NO or NC built in auxiliary contact for A9 - A40 contactors; factory assembled auxiliary contacts for A50 - A300 contactors
- 4 pole contactors: 4 NO or 2 NO & 2 NC without any auxiliary contacts. (A9 - A75)

Quick mounting on DIN rail: EN 50022 and EN 50023 standards:

35 x 7.5mm for A9 - A40

35 x 15mm for A9 - A75

75mm for A45 - A110

Location of side mounted accessories: on right or left hand side. Factory mounted on left hand side for CAL5 on A50 - A300


Holes for screw mounting (screws not supplied). Distance between holes according to EN 50003.

Terminals in A9 - A110 contactors are delivered in open position with captive screws (screws of unused terminals must be tightened).

Screwdriver guidance for all terminals makes it possible to use motorized screwdrivers.

All terminals provide protection against accidental direct contact with live parts according to VDE0106 - Part. 100.

All A9 - A40 contactor terminals as well as A45 - A300 contactor auxiliary contact and coil terminals ensure IP20 degree of protection according to IEC 947-1.

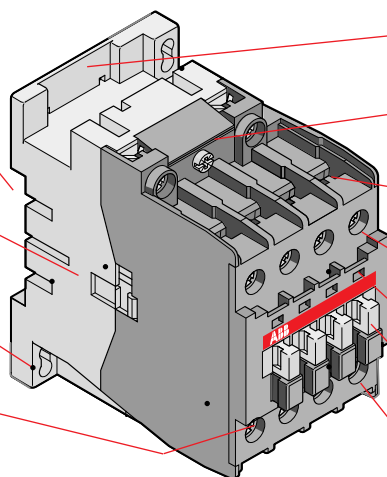

A9 - A300

Location of surge suppressors.

Clear marking of coil voltages and frequencies.

Connecting point for control leads in top part of main terminals of A50 - A75 contactors. For A95 & A110 contactors these are additional power connections.

Terminal marking according to IEC 947-4-1, EN 50005, EN 50012 and NEMA standards.

Location of function marker.

Stops for attaching front mounted accessories.

Terminal screws:

- Posidrive (+,-) No 2 for all A9 - A75
- M8 hex threaded socket screw for A95 - A300 main terminals.

Catalog number explanation

A9-30-10-84

Frame size

Power pole

30 = 3 NO

40 = 4 NO

22 = 2 NO & 2 NC

Coil voltage

(see coil voltage selection chart)

Auxiliary contacts

10 = 1 NO & 0 NC

01 = 0 NO & 1 NC

11 = 1 NO & 1 NC

00 = No auxiliary provided

22 = 2 NO & 2 NC

Coil voltage selection chart

Hz	Cntr type	Volts															
		12	24	48	110	120	125	208	220	240	277	380	415	440	480	500	600
60	A		81	83	84	84		34	36	80	42		86	86	51	53	55
50	A		81	83	84				80			85	86			55	

For other voltages, see page 1.24.

A9 - A300

Non-reversing, mechanically interlocked, reversing
AC operated, UL rated, 3 phase

Across the line
contactors


1



A26-30-10-84



A110M-30-11-84

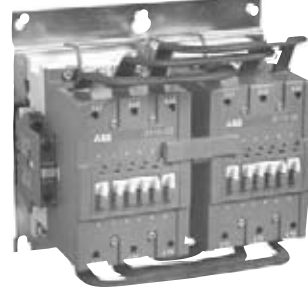

A110R-30-11-84

UL general purpose current	UL motor switching current	Maximum motor horsepower ratings 				Standard Aux. contacts		Non-reversing		Mechanically interlocked		Reversing	
		208V	240V	480V	575/600V	NO	NC	Catalog number	List price	Catalog number	List price	Catalog number	List price
AC1		UL rated											
21	9	2	2	5	7.5	1 0	0 1	A9-30-10-84 A9-30-01-84	\$ 78	A9M-30-10-84 A9M-30-01-84	\$ 255	A9R-30-10-84 A9R-30-01-84	\$ 315
25	11	3	3	7.5	10	1 0	0 1	A12-30-10-84 A12-30-01-84	84	A12M-30-10-84 A12M-30-01-84	315	A12R-30-10-84 A12R-30-01-84	375
30	17	5	5	10	15	1 0	0 1	A16-30-10-84 A16-30-01-84	102	A16M-30-10-84 A16M-30-01-84	345	A16R-30-10-84 A16R-30-01-84	413
40	28	7.5	10	20	25	1 0	0 1	A26-30-10-84 A26-30-01-84	183	A26M-30-10-84 A26M-30-01-84	405	A26R-30-10-84 A26R-30-01-84	480
50	34	10	10	25	30	1 0	0 1	A30-30-10-84 A30-30-01-84	252	A30M-30-10-84 A30M-30-01-84	548	A30R-30-10-84 A30R-30-01-84	623
60	42	10	15	30	40	1 0	0 1	A40-30-10-84 A40-30-01-84	297	A40M-30-10-84 A40M-30-01-84	639	A40R-30-10-84 A40R-30-01-84	750
80	54	15	20	40	50	1	1	A50-30-11-84	330	A50M-30-11-84	713	A50R-30-11-84	810
90	65	20	25	50	60	1	1	A63-30-11-84	372	A63M-30-11-84	870	A63R-30-11-84	1,013
105	80	25	30	60	75	1	1	A75-30-11-84	413	A75M-30-11-84	1,155	A75R-30-11-84	1,298
125	95	30	30	60	75	1	1	A95-30-11-84	450	A95M-30-11-84	1,230	A95R-30-11-84	1,425
140	110	30	40	75	100	1	1	A110-30-11-84	480	A110M-30-11-84	1,365	A110R-30-11-84	1,628
230	130	40	50	100	125	1	1	A145-30-11-84	825	A145M-30-11-84	2,235	A145R-30-11-84	2,250
250	156	50	60	125	150	1	1	A185-30-11-84	1,290	A185M-30-11-84	3,360	A185R-30-11-84	3,375
300	192	60	75	150	200	1	1	A210-30-11-84	1,635	A210M-30-11-84	4,035	A210R-30-11-84	4,050
350	248	75	100	200	250	1	1	A260-30-11-84	1,815	A260M-30-11-84	4,485	A260R-30-11-84	4,500
400	302	100	100	250	300	1	1	A300-30-11-84	1,875	A300M-30-11-84	5,460	A300R-30-11-84	5,475
550	414	125	150	350	400	1	1	See Type AF contactors, page 1.9					
650	480	150	200	400	500	1	1						
750	602	200	250	500	600	1	1						
900	810	250	300	600	700	1	1						
1350	960	—	400	800	900	1	1						
1650	1080	—	450	900	1000	1	1						

See Type AF contactors, page 1.9

Coil voltage selection

All AC operated catalog numbers include a 120VAC coil. To select other coil voltages, substitute the code from the Coil Voltage Selection Chart for the two digits after the last dash in the catalog number.

Ex.: A 240V coil is required for an A75 contactor: A75-30-11-80

Auxiliary contact blocks

For additional auxiliary contact blocks, see catalog number explanation on page 1.2. Add \$ 20 to list price for each additional auxiliary, and see page 1.32 for available combinations. Only side-mounted blocks are allowed to be factory installed. If auxiliary contacts are not required for A50 - A300, subtract \$ 40 from list price and change catalog number to "00" instead of "11."

Mechanical interlock

Mechanically interlocked contactors are designed for reversing, 2 speed, reduced voltage, etc. type starter applications. The complete assembly consists of two mechanically and electrically interlocked contactors mounted as follows with line and load terminals:

- A9 - A16 — mounted on 35mm DIN rail
- A26 - A300 — mounted on common baseplate

Power wiring is not included. The NC electrical interlock is provided with the mechanical interlock for A9 - A110 contactors.

Coil voltage selection chart

Hz	Cntr type	Volts													
		12	24	48	110	120	125	208	220	240	277	380	415	440	480
60	A	81	83	84	84			34	36	80	42		86	86	51
50	A	81	83	84					80			85	86		55

For other voltages, see page 1.24.

Reversing

Reversing contactors are designed for reversing type starter applications. The complete assembly consists of two mechanically and electrically interlocked contactors mounted as follows with line and load terminals:

- A9 - A16 — mounted on 35mm DIN rail
- A26 - A300 — mounted on common baseplate

The NC electrical interlock is provided with the mechanical interlock for A9 - A110 contactors.

AE9 - AE110

General information


DC operated, UL rated, 3 phase

Application


A-Line contactors are mainly used for controlling 3-phase motors and for controlling power circuits corresponding to their operating characteristics up to 690 and even 1000 VAC, and 440 VDC.

Control circuit types

AE types: with laminated magnetic circuit and double-winding coil fed from DC supply via a CDL5 insertion contact mounted on the device. The CDL5 has an NC lagging contact for insertion of the second winding. (See schematic.)

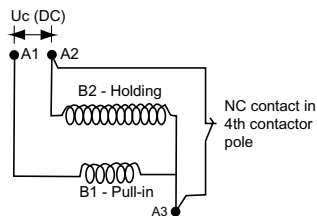

AE9 to AE40

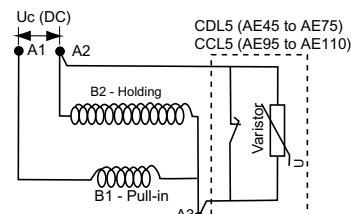

AE45 to AE110

Quick mounting on DIN rail: EN 50022 and EN 50023 standards:

35 x 7.5mm for AE9 - AE40

35 x 15mm for AE9 - AE75

75mm for AE45 - AE110

Location of side mounted accessories: on right or left hand side. Factory mounted on left hand side for CAL5 on A50 - A300

- right hand side for CDL5/CCL5 on AE45 - AE110


Holes for screw mounting (screws not supplied). Distance between holes according to EN 50003.

Terminals delivered in open position with captive screws (unused terminal screws must be tightened).

Screwdriver guidance for all terminals makes it possible to use motorized screwdrivers.

All terminals provide protection against accidental direct contact with live parts according to VDE0106 - Part. 100.

All AE9 - AE40 contactor terminals as well as AE45 - AE110 contactor auxiliary contact and coil terminals ensure IP20 degree of protection according to IEC 947-1.

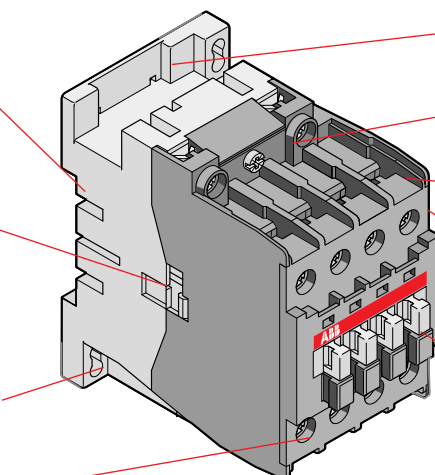

AE9 - AE110

Location of surge suppressors.

Clear marking of coil voltages and frequencies.

Connecting point for control leads in top part of main terminals of AE50 - AE75 contactors. For AE95 & AE110 contactors these are additional power connections.

Terminal marking according to IEC 947-4-1, EN 50005, EN 50012 and NEMA standards.

Location of function marker.

Stops for attaching front mounted accessories.

Terminal screws:

- Posidrive (+,-) No° 2 for all AE9 - AE75
- M8 hex threaded socket screw for AE95 & AE110

Catalog number explanation

AE9-30-00-81

Frame size

Power pole

30 = 3 NO
40 = 4 NO
22 = 2 NO & 2 NC

Coil voltage

(see coil voltage selection chart)

Auxiliary contacts

00 = No auxiliary provided
11 = 1 NO & 1 NC

Coil voltage selection chart

Hz	Contr. type	Volts						
		12	24	48	110	125	220	240
DC	AE	80	81	83	86	87	88	89

For other voltages, see page 1.24.

AE9 - AE110

Non-reversing, mechanically interlocked, reversing
DC operated, UL rated, 3 phase

Across the line
contactors


1



AE26-30-11-81



AE110M-30-11-81

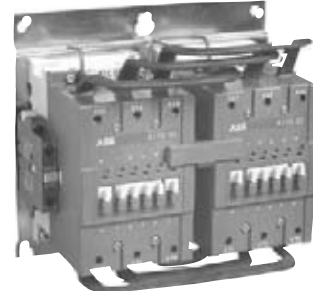

AE110R-30-11-81

General purpose current	UL motor switching current	Maximum motor horsepower ratings 				Standard Aux. contacts		Non-reversing		Mechanically interlocked		Reversing	
		208V	240V	480V	575/600V	NO	NC	Catalog number	List price	Catalog number	List price	Catalog number	List price
AC1		UL rated											
21	9	2	2	5	7.5	1	1	AE9-30-11-81	\$ 118	AE9M-30-11-81	\$ 335	AE9R-30-11-81	\$ 395
25	11	3	3	7.5	10	1	1	AE12-30-11-81	124	AE12M-30-11-81	395	AE12R-30-11-81	455
30	17	5	5	10	15	1	1	AE16-30-11-81	142	AE16M-30-11-81	425	AE16R-30-11-81	493
40	28	7.5	10	20	25	1	1	AE26-30-11-81	223	AE26M-30-11-81	485	AE26R-30-11-81	560
50	34	10	10	25	30	1	1	AE30-30-11-81	292	AE30M-30-11-81	628	AE30R-30-11-81	703
60	42	10	15	30	40	1	1	AE40-30-11-81	337	AE40M-30-11-81	720	AE40R-30-11-81	830
80	54	15	20	40	50	1	1	AE50-30-11-81	375	AE50M-30-11-81	803	AE50R-30-11-81	930
90	65	20	25	50	60	1	1	AE63-30-11-81	477	AE63M-30-11-81	1,080	AE63R-30-11-81	1,208
105	80	25	30	60	75	1	1	AE75-30-11-81	518	AE75M-30-11-81	1,365	AE75R-30-11-81	1,493
125	95	30	30	60	75	1	1	AE95-30-11-81	555	AE95M-30-11-81	1,440	AE95R-30-11-81	1,635
140	110	30	40	75	100	1	1	AE110-30-11-81	690	AE110M-30-11-81	1,785	AE110R-30-11-81	2,048
230	130	40	50	100	125	1	1						
250	156	50	60	125	150	1	1						
300	192	60	75	150	200	1	1						
350	248	75	100	200	250	1	1						
400	302	100	100	250	300	1	1						
550	414	125	150	350	400	1	1						
650	480	150	200	400	500	1	1						
750	602	200	250	500	600	1	1						
900	810	250	300	600	700	1	1						
1350	960	—	400	800	900	1	1						
1650	1080	—	450	900	1000	1	1						

See AF contactors, page 1.9

Coil voltage selection

All DC operated catalog numbers include a 24VDC coil. To select other coil voltages, substitute the code from the Coil Voltage Selection Chart for the two digits after the last dash in the catalog number.

Ex.: A 110V coil is required for an AE75 contactor: AE75-30-11-86

Auxiliary contact blocks

For additional auxiliary contact blocks, see catalog number explanation on page 1.4. Add \$ 20 to list price for each additional auxiliary, and see page 1.32 for available combinations.

Mechanical interlock

Mechanically interlocked contactors are designed for reversing, 2 speed, reduced voltage, etc. type starter applications. The complete assembly consists of two mechanically and electrically interlocked contactors mounted as follows with line and load terminals:

- AE9 - AE16 — mounted on 35mm DIN rail
- AE26 - AE110 — mounted on common baseplate

Power wiring is not included.

The NC electrical interlock is provided with the mechanical interlock.

Coil voltage selection chart

Hz	Contr. type	Volts						
		12	24	48	110	125	220	240
DC	AE	80	81	83	86	87	88	89

For other voltages, see page 1.24.

Reversing

Reversing contactors are designed for reversing type starter applications. The complete assembly consists of two mechanically and electrically interlocked contactors mounted as follows with line and load terminals:

- AE9 - AE16 — mounted on 35mm DIN rail
- AE26 - AE110 — mounted on common baseplate

The NC electrical interlock is provided with the mechanical interlock.

AL9 - AL40

General information

DC operated, UL rated, 3 phase

Application

AL and AL...Z contactors are mainly used for controlling 3-phase motors and for controlling power circuits corresponding to their operating characteristics up to 690 and even 1000 VAC, and 440 VDC.

Control circuit types

AL9 - AL40: DC coil with low power consumption of 3W to 3.5W

AL9Z - AL16Z: DC coil with low power consumption of 2.4W. Designed to be directly controlled by PLC.

Quick mounting on DIN rail: EN 50022 and EN 50023 standards:

35 x 7.5mm for AL9 - AL40
35 x 15mm for AL9 - AL40

Location of side mounted accessories: on right or left hand side.


Holes for screw mounting (screws not supplied). Distance between holes according to EN 50003.

Terminals delivered in open position with captive screws (unused terminal screws must be tightened).

Screwdriver guidance for all terminals makes it possible to use motorized screwdrivers.

All terminals provide protection against accidental direct contact with live parts according to VDE0106 - Part. 100.

All AL9 - AL40 contactor terminals as well as contactor auxiliary contacts and coil terminals ensure IP20 degree of protection according to IEC 60947-1.

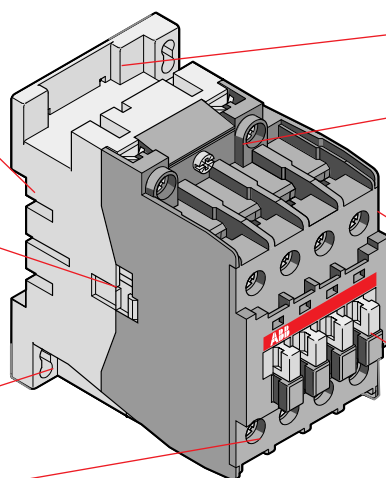

AL9 - AL40

Location of surge suppressors.

Clear marking of coil voltages and frequencies.

Terminal marking according to IEC 60947-4-1, EN 50005, EN 50012 and NEMA standards.

Location of function marker.

Stops for attaching front mounted accessories.

Terminal screws:

- Posidrive (+,-) No° 2 for all AL contactors

Catalog number explanation

AL9 - 30 - 10 - 81

Frame size

Power pole

30 = 3 NO

Coil voltage

(see coil voltage selection chart)

Auxiliary contacts

10 = 1 NO & 0 NC

01 = 0 NO & 1 NC

Coil voltage selection

Hz	Contr. type	Volts						
		12	24	48	110	125	220	240
DC	AL	80	81	83	86	87	88	89
DC	AL...Z		15	28				

For other voltages, see page 1.24.

AL9 - AL40, AL9Z - AL16Z

Non-reversing, mechanically interlocked, reversing DC operated, UL rated, 3 phase

Across the line
contactors

1



AL9-30-10-81



AL26-30-10-81



AL40-30-10-81

AL Contactors — 3W and 3.5W consumption

General purpose current	UL motor switching current	Maximum motor horsepower ratings 				Standard Aux. contacts		Non-reversing		Mechanically interlocked		Reversing	
		208V	240V	480V	575/600V	NO	NC	Catalog number	List price	Catalog number	List price	Catalog number	List price
		UL rated											
AC1													
21	9	2	2	5	7.5	1 0	0 1	AL9-30-10-81 AL9-30-01-81	\$ 138	AL9M-30-10-81 AL9M-30-01-81	\$ 411	AL9R-30-10-81 AL9R-30-01-81	\$ 433
25	11	3	3	7.5	10	1 0	0 1	AL12-30-10-81 AL12-30-01-81	169	AL12M-30-10-81 AL12M-30-01-81	490	AL12R-30-10-81 AL12R-30-01-81	498
30	17	5	5	10	15	1 0	0 1	AL16-30-10-81 AL16-30-01-81	188	AL16M-30-10-81 AL16M-30-01-81	526	AL16R-30-10-81 AL16R-30-01-81	527
40	28	7.5	10	20	25	1 0	0 1	AL26-30-10-81 AL26-30-01-81	238	AL26M-30-10-81 AL26M-30-01-81	606	AL26R-30-10-81 AL26R-30-01-81	643
50	34	10	10	20	30	1 0	0 1	AL30-30-10-81 AL30-30-01-81	326	AL30M-30-10-81 AL30M-30-01-81	781	AL30R-30-10-81 AL30R-30-01-81	826
60	42	10	15	30	40	1 0	0 1	AL40-30-10-81 AL40-30-01-81	376	AL40M-30-10-81 AL40M-30-01-81	892	AL40R-30-10-81 AL40R-30-01-81	912

ALZ Contactors — 2.4W consumption

General purpose current	UL motor switching current	Maximum motor horsepower ratings 				Standard Aux. contacts		Non-reversing		Mechanically interlocked		Reversing	
		208V	240V	480V	575/600V	NO	NC	Catalog number	List price	Catalog number	List price	Catalog number	List price
AC1		UL rated											
21	9	2	2	5	7.5	1 0	0 1	AL9Z-30-10-15 AL9Z-30-01-15	\$ 141	AL9ZM-30-10-15 AL9ZM-30-01-15	\$ 319	AL9ZR-30-10-15 AL9ZR-30-01-15	\$ 429
25	11	3	3	7.5	10	1 0	0 1	AL12Z-30-10-15 AL12Z-30-01-15	173	AL12ZM-30-10-15 AL12ZM-30-01-15	417	AL12ZR-30-10-15 AL12ZR-30-01-15	477
30	17	5	5	10	15	1 0	0 1	AL16Z-30-10-15 AL16Z-30-01-15	188	AL16ZM-30-10-15 AL16ZM-30-01-15	441	AL16ZR-30-10-15 AL16ZR-30-01-15	501

Coil voltage selection

All DC operated catalog numbers include a 24VDC coil. To select other coil voltages, substitute the code from the Coil Voltage Selection Chart for the two digits after the last dash in the catalog number.

Ex.: A 48V coil is required for an AL30 contactor: AL30-30-10-83

Auxiliary contact blocks

For additional auxiliary contact blocks, see catalog number explanation on page 1.6. Add \$ 20 to list price for each additional auxiliary, and see page 1.32 for available combinations.

Coil voltage selection

Hz	Contr. type	Volts						
		12	24	48	110	125	220	240
DC	AL	80	81	83	86	87	88	89
DC	AL...Z		15	28				

For other voltages, see page 1.24.

Mechanical interlock

Mechanically interlocked contactors are designed for reversing, 2 speed, reduced voltage, etc. type starter applications. The complete assembly consists of two mechanically and electrically interlocked contactors mounted as follows with line and load terminals:

- AL9 & AL16 — mounted on 35mm DIN rail
- AL26 & AL40 — mounted on common baseplate

Power wiring is not included.

The NC electrical interlock is provided

Reversing

Reversing contactors are designed for reversing type starter applications. The complete assembly consists of two mechanically and electrically interlocked contactors mounted with line and load terminals.

① Only coil voltages available for AL9Z – AL16Z.

AF50 - AF1650

General information

AC & DC operated, UL rated, 3 phase

Application

A-Line contactors are mainly used for controlling 3-phase motors and for controlling power circuits corresponding to their operating characteristics up to 690 and even 1000 VAC. and 440 VDC.

Description of 3 pole contactors AF50 - AF1650

All AF contactors can be assembled side by side. The add-on auxiliary contacts are suitable for low level currents.

Quick mounting on DIN rail: EN 50022 and EN 50023 standards:

35 x 15mm for AF50 - AF75

75mm for AF50 - AF110

Location of side mounted accessories: on right or left hand side. Factory mounted on left hand side for CAL5 on AF50 - AF1650

Holes for screw mounting (screws not supplied). Distance between holes according to EN 50003.

Terminals delivered in open position with captive screws (screws of unused terminals must be tightened).

Screwdriver guidance for all terminals makes it possible to use motorized screwdrivers.

All terminals provide protection against accidental direct contact with live parts according to VDE0106 - Part. 100.


All AF50- AF110 contactor terminals as well as AF50 - AF1650 contactor auxiliary contact and coil terminals ensure IP20 degree of protection according to IEC 947-1.

Control circuit types

- AF types: AC/DC operated with laminated magnetic circuit.

Contact or types

- 3 pole contactors with 1 NO or 1 NC factory assembled auxiliary contacts for AF50 - AF1650 contactors

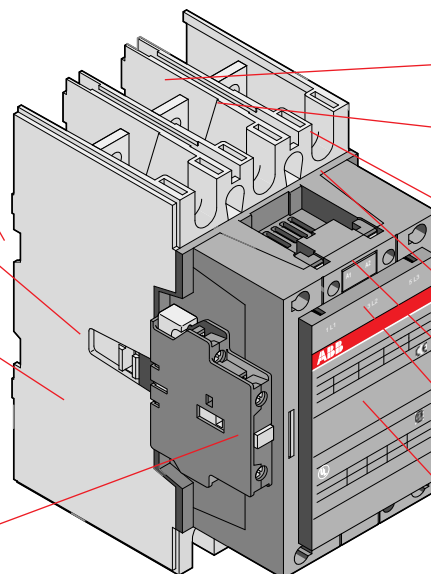

AF50 - AF1650

Surge suppressors built in as standard on the printed circuit board.

Clear marking of coil voltages and frequencies.

Connecting point for control leads in top part of main terminals of AF50 - AF75 contactors. For AF95 & AF110 contactors these are additional power connections.

Terminal marking according to IEC 947-4-1, EN 50005, EN 50012 and NEMA standards.

Location of function marker.

Stops for attaching front mounted accessories.

Terminal screws:

- Posidrive (+,-) No 2 for all AF50 - AF75
- M8 hex threaded socket screw for AF95 - AF1650 main terminals.

Catalog number explanation

AF50 - 30 - 11 - 70

Frame size

Power pole

30 = 3 NO
40 = 4 NO
22 = 2 NO & 2 NC

Coil voltage

(see coil voltage selection chart)

Auxiliary contacts

11 = 1 NO & 1 NC
00 = No auxiliary provided
22 = 2 NO & 2 NC

Coil voltage selection – AF50 to AF1650

AC/DC VOLTS, 40 - 60 Hz				
24 - 60 DC	20 - 60 DC	48 - 130 AC/DC	100 - 250 AC/DC	250 - 500 AC/DC
68 ①	72 ②	69	70 ③	71 ④

① AF400 - AF750, DC only.

② AF50 - AF300, DC only.

③ Only option for AF1350 / AF1650.

④ AF400 - AF750 only.

AF50 - AF1650

Non-reversing, mechanically interlocked, reversing
AC & DC operated, UL rated, 3 phase

Across the line
1



AF63-30-11-70



AF95-30-11-70



AF400-30-11-70



AF750-30-11-70

3 Pole

General purpose current	UL motor switching current	Maximum UL Listed motor horsepower ratings				Standard auxiliary contacts		Non-reversing		Mechanically interlocked		Reversing	
		208V	240V	480V	575/600V	NO	NC	Catalog number	List price	Catalog number	List price	Catalog number	List price
80	54	15	20	40	50	1	1	AF50-30-11-70	\$ 450	AF50M-30-11-70	\$ 953	AF50R-30-11-70	\$ 1,050
90	65	20	25	50	60	1	1	AF63-30-11-70	495	AF63M-30-11-70	1,116	AF63R-30-11-70	1,259
105	80	25	30	60	75	1	1	AF75-30-11-70	535	AF75M-30-11-70	1,399	AF75R-30-11-70	1,542
125	95	30	30	60	75	1	1	AF95-30-11-70	570	AF95M-30-11-70	1,470	AF95R-30-11-70	1,665
140	110	30	40	75	100	1	1	AF110-30-11-70	600	AF110M-30-11-70	1,605	AF110R-30-11-70	1,868
230	130	40	50	100	125	1	1	AF145-30-11-70	1,110	AF145M-30-11-70	2,655	AF145R-30-11-70	2,670
250	156	50	60	125	150	1	1	AF185-30-11-70	1,635	AF185M-30-11-70	3,870	AF185R-30-11-70	3,375
300	192	60	75	150	200	1	1	AF210-30-11-70	1,980	AF210M-30-11-70	4,545	AF210R-30-11-70	4,560
350	248	75	100	200	250	1	1	AF260-30-11-70	2,235	AF260M-30-11-70	5,055	AF260R-30-11-70	5,070
400	302	100	100	250	300	1	1	AF300-30-11-70	2,385	AF300M-30-11-70	6,030	AF300R-30-11-70	6,045
550	414	125	150	350	400	1	1	AF400-30-11-70	3,120	AF400M-30-11-70	6,705	AF400R-30-11-70	6,720
650	480	150	200	400	500	1	1	AF460-30-11-70	4,425	AF460M-30-11-70	13,275	AF460R-30-11-70	13,290
750	602	200	250	500	600	1	1	AF580-30-11-70	6,900	AF580M-30-11-70	18,375	AF580R-30-11-70	18,390
900	810	250	300	600	700	1	1	AF750-30-11-70	7,200	AF750M-30-11-70	19,725	AF750R-30-11-70	19,740
1260	—	—	—	—	—	1	1	AF1250-30-11-70	8,120	—	—	—	—
1350	960	—	400	800	900	1	1	AF1350-30-11-70	8,490	—	—	—	—
1650	1080	—	450	900	1000	1	1	AF1650-30-11-70	10,230	—	—	—	—
2050	—	—	—	—	—	1	1	AF2050-30-11-70	12,820	—	—	—	—

Coil voltage selection – wide range AC/DC coils

All catalog numbers include a 100-250V AC/DC coil. To select other coil voltages, substitute the code from the Coil Voltage Selection Chart for the two digits after the last dash in the catalog number.

Ex.: A 24V coil is required for a AF110 contactor: AF110-30-11-72

Coil voltage selection – AF50 to AF1650

AC/DC VOLTS, 40 - 60 Hz				
24 - 60 DC	20 - 60 DC	48 - 130 AC/DC	100 - 250 AC/DC	250 - 500 AC/DC
68 ①	72 ②	69	70 ③	71 ④

① AF400 – AF1250, DC only.

② AF50 – AF300, DC only.

③ Only option for AF1350 - AF2050.

④ AF400 - AF750 only.

A/AF/AL9 - A/AF/AL110

Contactors for ring tongue termination
AC & DC operated, UL rated, 3 phase

UL general purpose current AC1	UL Motor switching current	UL/CSA horsepower ratings			Auxiliary contacts		AC operated		DC operated	
		240V	480V	575/600V	NO	NC	Catalog number	List price	Catalog number	List price
21	9	2	5	7.5	1 0	0 1	A93010RT-84 A93001RT-84	\$ 83	AL93010RT-81 AL93001RT-81	\$ 152
25	11	3	7.5	10	1 0	0 1	A123010RT-84 A123001RT-84	90	AL123010RT-81 AL123001RT-81	186
30	17	5	10	15	1 0	0 1	A163010RT-84 A163001RT-84	122	AL163010RT-81 AL163001RT-81	207 211
40	28	10	20	25	1 0	0 1	A263010RT-84 A263001RT-84	172	AL263010RT-81 AL263001RT-81	262
80	54	20	40	50	0	0	A503000RT-84	363	AF503000RT-70	582
90	65	25	50	60	0	0	A633000RT-84	417	AF633000RT-70	647
105	80	30	60	75	0	0	A753000RT-84	475	AF753000RT-70	687
125	95	30	60	75	0	0	AF95B3011RT-70	927	AF95B3011RT-70	927
140	110	40	75	100	0	0	AF110B3011RT-70	986	AF110B3011RT-70	986

Coil voltage selection – AC coils

All AC operated catalog numbers include a 120VAC coil. To select other coil voltages, substitute the code from the AC coils Coil Voltage Selection Chart for the two digits after the last dash in the catalog number.

Ex.: A 240V coil is required for an A75 contactor: A753000RT-80

Coil voltage selection – DC coils

All DC operated catalog numbers include a 24VDC coil. To select other coil voltages, substitute the code from the DC coils Coil Voltage Selection Chart for the two digits after the last dash in the catalog number.

Ex.: A 110V coil is required for an AE75 contactor: AE753000RT-86

Auxiliary contact blocks

For additional auxiliary contact blocks, see catalog number explanation on page 1.2. Add \$ 20 to list price for each additional auxiliary, and see page 1.32 for available combinations. Only side-mounted blocks are allowed to be factory installed.

Auxiliary contact block with ring tongue termination

Positioning	Maximum number of contact blocks	Contact description	Catalog number	List price
Front mounting (C4-pole)	1 block A/AE9 – A/AE110	2 NO & 2 NC 3 NO & 1 NC 4 NO	CA5-22ERT CA5-31ERT CA5-40ERT	\$ 35

Coil voltage selection chart – AC coils

Hz	Cntr. type	Volts															
		12	24	48	110	120	125	208	220	240	277	380	415	440	480	500	600
60	A		81	83	84	84		34	36	80	42		86	86	51	53	55
50	A		81	83	84				80				85	86		55	

For other voltages, see page 1.24.

Coil voltage selection chart – DC coils

Hz	Contr. type	Volts					
		24	48	110	125	220	240
DC	AE	81	83	86	87	88	89

For other voltages, see page 1.24.

A9 – AF1650

Non-reversing, mechanically interlocked, reversing
NEMA rated, AC operated, 3 phase

Across the line
contactors

1



A26N1-30-10-84



A145N4-30-11-84



AF400N6-30-11-70

NEMA size	Continuous current	Maximum motor horsepower ratings 			Standard Aux. contacts		Non-reversing		Mechanically interlocked		Reversing	
		200V	230V	460/575V	NO	NC	Catalog number	List price	Catalog number	List price	Catalog number	List price
		NEMA rated										
00	9	1.5	1.5	2	1	0	A9N00-30-10-84	\$ 78	A9N00M-10-84	\$ 255	A9N00R-10-84	\$ 315
0	18	3	3	5	1	0	A16N0-30-10-84	102	A16N0M-10-84	345	A16N0R-10-84	413
1	27	7.5	7.5	10	1	0	A26N1-30-10-84	183	A26N1M-10-84	405	A26N1R-10-84	480
2	45	10	15	25	1	1	A50N2-30-11-84	330	A50N2M-11-84	713	A50N2R-11-84	810
3	90	25	30	50	1	1	A75N3-30-11-84	413	A75N3M-11-84	1,155	A75N3R-11-84	1,298
4	135	40	50	100	1	1	A145N4-30-11-84	825	A145N4M-11-84	2,235	A145N4R-11-84	2,250
5	270	75	100	200	1	1	A260N5-30-11-84	1,815	A260N5M-11-84	4,485	A260N5R-11-84	4,500
6	540	150	200	400	1	1	AF460N6-3011-70	4,425	AF460N6M-11-70	13,275	AF460N6R-11-70	13,290
7	810	—	300	600	1	1	AF750N7-3011-70	7,200	AF750N7M-11-70	19,725	AF750N7R-11-70	19,740
8	1215	—	450	900	1	1	AF1650N83011-70	10,230	—	—	—	—

Coil voltage selection – A contactors

All AC operated catalog numbers include a 120VAC coil. To select other coil voltages, substitute the code from the Coil Voltage Selection Chart for the two digits after the last dash in the catalog number.

Ex.: A 240V coil is required for an A75 contactor: A75N3-30-11-**80**

Coil voltage selection – wide range AC/DC coils

The NEMA size 6, 7 and 8 contactors are provided with a wide range coil voltage. They are shown with the standard 100-250V AC/DC coil. To select other ranges substitute the code from the coil voltage selection chart for the two digits after the last dash in the catalog number.

Ex.: A 24V coil is required for the AF460N6 contactor: AF460N6-3011-**68**

Auxiliary contact blocks

For additional auxiliary contact blocks, see catalog number explanation on page 1.2. Add \$ 20 to list price for each additional auxiliary, and see page 1.32 for available combinations.

Mechanical interlock

Mechanically interlocked contactors are designed for reversing, 2 speed, reduced voltage, etc. type starter applications. The complete assembly consists of two mechanically and electrically interlocked contactors mounted as follows with line and load terminals:

- A9 - A16 — mounted on 35mm DIN rail
- A26 - A750 — mounted on common baseplate

Power wiring is not included.

For A9 - A110 contactors the NC electrical interlock is provided with the mechanical interlock.

Reversing

Reversing contactors are designed for reversing type starter applications. The complete assembly consists of two mechanically and electrically interlocked contactors mounted as follows with line and load terminals:

- A9 - A16 — mounted on 35mm DIN rail
- A26 - A750 — mounted on common baseplate

For A9 - A750 contactors the NC electrical interlock is provided with the mechanical interlock.

Coil voltage selection – A contactors

Hz	Cntr type	Volts													
		12	24	48	110	120	125	208	220	240	277	380	415	440	480
60	A		81	83	84	84		34	36	80	42		86	86	51
50	A		81	83	84				80			85	86		55

For other voltages, see page 1.24.

Coil voltage selection – AF460N6 to AF1650N8

AC/DC VOLTS, 40 - 60 HZ			
24 - 60 DC	48 - 130 AC/DC	100 - 250 AC/DC	250-500 AC/DC
68 ①	69	70 ③	71 ②

① AF400 – AF750, DC only.

② AF400 - AF750 only.

③ Only option for AF1650.

AE9 – AF1650, AL9 – AL26

Non-reversing, mechanically interlocked, reversing
NEMA rated, DC operated, 3 phase



AE26N1-30-11-81



AF145N4-30-11-68



AF460N6R-11-68

AE & AF Contactors

NEMA size	Continuous current	Maximum motor horsepower ratings 			Standard Aux. contacts		Non-reversing		Mechanically interlocked		Reversing	
		200V	230V	460/575V	NO	NC	Catalog number	List price	Catalog number	List price	Catalog number	List price
		NEMA rated										
00	9	1.5	1.5	2	1	0	AE9N00-30-11-81	\$ 118	AE9N00M-11-81	\$ 325	AE9N00R-11-81	\$ 395
0	18	3	3	5	1	0	AE16N0-30-11-81	142	AE16N0M-11-81	425	AE16N0R-11-81	493
1	27	7.5	7.5	10	1	0	AE26N1-30-11-81	223	AE26N1M-11-81	485	AE26N1R-11-81	560
2	45	10	15	25	1	1	AE50N2-30-11-81	375	AE50N2M-11-81	803	AE50N2R-11-81	930
3	90	25	30	50	1	1	AE75N3-30-11-81	518	AE75N3M-11-81	1,365	AE75N3R-11-81	1,493
4	135	40	50	100	1	1	AF145N4-3011-70	1,110	AF145N4M-11-70	2,655	AF145N4R-11-70	2,670
5	270	75	100	200	1	1	AF260N5-3011-70	2,235	AF260N5M-11-70	5,055	AF260N5R-11-70	5,070
6	540	150	200	400	1	1	AF460N6-3011-70	4,425	AF460N6M-11-70	13,275	AF460N6R-11-70	13,290
7	810	—	300	600	1	1	AF750N7-3011-70	7,200	AF750N7M-11-70	19,725	AF750N7R-11-70	19,740
8	1215	—	450	900	1	1	AF1650N83011-70	10,230	—	—	—	—

AL Contactors

NEMA size	Continuous current	Maximum motor horsepower ratings 			Standard Aux. contacts		Non-reversing		Mechanically interlocked		Reversing	
		208V	240V	460/575V	NO	NC	Catalog number	List price	Catalog number	List price	Catalog number	List price
		NEMA rated										
00	9	1.5	1.5	2	1	0	AL9N00-30-10-81	\$ 155	AL9N00M-10-81	\$ 319	AL9N00R-10-81	\$ 379
0	18	3	3	5	1	0	AL16N0-30-10-81	205	AL16N0M-10-81	441	AL16N0R-10-81	501
1	27	7.5	7.5	10	1	0	AL26N1-30-10-81	253	AL26N1M-10-81	473	AL26N1R-10-81	533

Coil voltage selection – AE contactors

All DC operated catalog numbers include a 24VDC coil. To select other coil voltages, substitute the code from the Coil Voltage Selection Chart for the two digits after the last dash in the catalog number.

Ex.: A 125V coil is required for an AE75 contactor: AE75N3-30-11-**87**

Coil voltage selection – AF wide range AC/DC coils

All catalog numbers include a 100-250V AC/DC coil. To select other coil voltages, substitute the code from the Coil Voltage Selection Chart for the two digits after the last dash in the catalog number.

Ex.: A 24V coil is required for a AF145 contactor: AF145N4-30-11-**72**

Auxiliary contact blocks

For additional auxiliary contact blocks, see catalog number explanation on page 1.2. Add \$ 20 to list price for each additional auxiliary, and see page 1.32 for available combinations.

Mechanical interlock

Mechanically interlocked contactors are designed for reversing, 2 speed, reduced voltage, etc. type starter applications. The complete assembly consists of two mechanically and electrically interlocked contactors mounted as follows with line and load terminals:

- AE9 - AE16 — mounted on 35mm DIN rail
- AE26 - AE75 — mounted on common baseplate

Power wiring is not included.

For AE9 - AE75 contactors the NC electrical interlock is provided with the mechanical interlock.

Reversing

Reversing contactors are designed for reversing type starter applications. The complete assembly consists of two mechanically and electrically interlocked contactors mounted as follows with line and load terminals:

- AE9 - AE16 — mounted on 35mm DIN rail
- AE26 - AE75 — mounted on common baseplate

For AE9 - AE75 contactors the NC electrical interlock is provided with the mechanical interlock.

Coil voltage selection – AF50 to AF1650

AC/DC VOLTS, 40 - 60 Hz				
24 - 60 DC	20 - 60 DC	48 - 130 AC/DC	100 - 250 AC/DC	250 - 500 AC/DC
68 ①	72 ②	69	70 ④	71 ③

Coil voltage selection – AE & AL contactors

Hz	Contactor type	Volts						
		12	24	48	110	125	220	240
DC	AE, AL	—	81	83	86	87	88	89

① AF400 – AF750, DC only.
② AF50 – AF300, DC only.


③ AF400 - AF750 only.
④ Only option for AF1650.

A9 – A/AE75 , EK110 – EK1000, AL9 – AL26 AC & DC operated, UL rated, 4 pole


Across the line
1



A9-40-00



A75-40-00

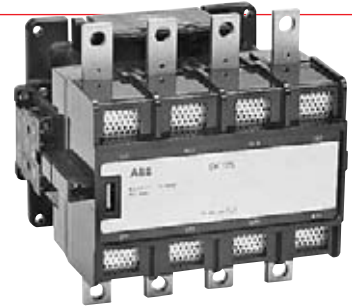

EK175C4P-PL

4 Pole – 4 NO power poles

UL general purpose current		AC operated		DC operated	
AC operated	DC operated	Catalog number	List price	Catalog number	List price
21	21	A9-40-00-84	\$ 120	AL9-40-00-81	\$ 141
30	30	A16-40-00-84	165	AL16-40-00-81	192
40	40	A26-40-00-84	228	AL26-40-00-81	246
65	65	A45-40-00-84	360	AE45-40-00-86	420
80	80	A50-40-00-84	413	AE50-40-00-86	473
105	105	A75-40-00-84	525	AE75-40-00-86	570
150	150	EK110C4P-1L	743	EK110C4P-PL	953
200	200	EK150C4P-1L	1,013	EK150C4P-PL	1,238
250	250	EK175C4P-1L	1,763	EK175C4P-PL	1,988
300	300	EK210C4P-1L	2,025	EK210C4P-PL	2,280
400	400	EK370C4P-1L	4,650	EK370C4P-PL	5,010
600	600	EK550C4P-1L	6,510	EK550C4P-PL	7,005
1000 ①	1000 ①	EK1000C4P-1L	9,000	EK1000C4P-PL	9,700

4 Pole – 4 NC power poles

UL general purpose current	AC operated	
AC operated	Catalog number	List price
30	A16-04-00-84	\$ 165

4 Pole – 2 NO & 2 NC power poles

UL general purpose current		AC operated		DC operated	
AC operated	DC operated	Catalog number	List price	Catalog number	List price
21	21	A9-22-00-84	\$ 120	AL9-22-00-81	\$ 141
30	21	A16-22-00-84	165	AL16-22-00-81	215
40	30	A26-22-00-84	228	AL26-22-00-81	278
65	65	A45-22-00-84	360	AE45-22-00-86	420
105	105	A75-22-00-84	525	AE75-22-00-86	570

Coil voltage selection

All AC operated catalog numbers include a 120VAC coil. All DC operated catalog numbers include a 110VDC coil. To select other coil voltages, substitute the code from the Coil Voltage Selection Chart for the two digits after the last dash in the catalog number.

Ex.: A 240V coil is required for an A75 contactor: A75-30-00-80

Auxiliary contact blocks

For additional auxiliary contact blocks, see catalog number explanation on page 1.2. Add \$ 20 to list price for each additional auxiliary, and see page 1.32 for available combinations.

Accessories for EK

Please consult factory.

Coil voltage selection – A contactors

Hz	Contr.	Volts													
	type	12	24	48	110	120	125	208	220	240	277	380	415	440	480
60	A		81	83	84	84		34	36	80	42		86	86	51
50	A		81	83	84				80			85	86		55

For other voltages, see page 1.24.

Coil voltage selection – EK contactors

Hz	Contr.	Volts													
	type	24	48	110	120	125	208	220	240	277	380	415	440	480	500
60	EK	F	G		1		B		2	C	Z		3	4	6
50	EK	N		1				J			3	M			5
DC	EK	Y	W	P		Q		R					T		

- For other voltages, consult factory.
- 24 & 48VAC coils are not available for sizes EK550. For these applications, use an interposing control relay.

Coil voltage selection – AE & AL contactors

Hz	Contr.	Volts							
	type	12	24	48	110	125	220	240	
DC	AE, AL	–	81	83	86	87	88	89	

For other voltages, see page 1.24.

① Not UL Listed. IEC value AC1 for 40°C.

AF45 - AF75

AC & DC operated, UL rated, 4 pole

Auxiliary contact blocks

For additional auxiliary contact blocks, see catalog number explanation on page 1.8. Add \$ 20 to the list price for each additional auxiliary and see page 1.32 for available combinations. If auxiliary contacts are required for AF50 – AF750 contactors, add \$ 40 to the list price and change the 8th & 9th digits in the catalog number from "00" to "11".

4 Pole – 4 NO power poles

General purpose	Auxiliary contacts		Catalog number	List price
	NO	NC		
AC1				
65	0	0	AF45-40-00-70	\$ 385
80	0	0	AF50-40-00-70	435
105	0	0	AF75-40-00-70	645



4 Pole – 2 NO - 2 NC power poles

General purpose	Auxiliary contacts		Catalog number	List price
	NO	NC		
AC1				
65	0	0	AF45-22-00-70	\$ 385
105	0	0	AF75-22-00-70	645

These contactors (2 NO & 2 NC power poles) can be used for controlling either 2 separate circuits, i.e. 2 loads with 2 separate supplies, or 1 circuit comprising 2 separate loads with 1 single supply (see diagrams below).

When the contactor operates, there is no mechanical overlapping between the NO main poles and NC main poles: Break before Make.

These contactors (2 NO & 2 NC power poles) are not suitable for a reversing starter or a wye-delta starter or for controlling a single load from 2 separate supplies.

1 single supply and 2 separate loads**2 separate supplies and 2 separate loads****Coil voltage selection – wide range AC/DC coils**

All catalog numbers include a 100-250V AC/DC coil. To select other coil voltages, substitute the code from the Coil Voltage Selection Chart for the two digits after the last dash in the catalog number.

Ex.: A 24V coil is required for a AF45 contactor: AF45-22-00-**72**

Coil voltage selection – AF50 to AF75

AC/DC VOLTS, 40 - 60 HZ			
24 - 60 DC	20 - 60 DC	48 - 130 AC/DC	100 - 250 AC/DC
68 ①	72 ②	69	70

① AF400 – AF750, DC only.

② AF50 – AF300, DC only.

UA26 – UA110

for 3 phase capacitor switching, 3 phase
AC operated

Across the line
1



UA75-30-00-84



UA95-30-00-84

Max kvar switching capacity			Standard auxiliary contacts		Catalog number	List price
240V	480V	575/600V	NO	NC		
12.5	25	30	1	0	UA26-30-10-84	\$ 225
16	32	40	1	0	UA30-30-10-84	338
20	40	50	0	0	UA50-30-00-84	345
			1	1	UA50-30-11-84	375
27.5	55	70	0	0	UA75-30-00-84	450
			1	1	UA75-30-11-84	480
35	70	75	0	0	UA95-30-00-84	465
			1	1	UA95-30-11-84	495
40	80	85	0	0	UA110-30-00-84	525
			1	1	UA110-30-11-84	570

For 3 phase capacitors carrying out single bank or stepped bank compensation.
Max. peak current $\hat{I}$: 100 times the capacitor nominal r.m.s. current at $U_e \leq 500V$ or 90 times for $U_e > 500V$
Electrical durability: 100,000 operating cycles.

Power in kvar

Contactor	208V	240V	480V	600V	Max amps
UA26	3.5	4.0	8.0	10.0	10
UA30	7.0	8.0	16.5	20.5	20
UA50	10.5	12.5	25.0	31.0	30
UA75	21.5	25.0	50.0	62.0	60
UA95	25.0	29.0	58.0	72.0	70
UA110	28.5	33.0	66.0	83.0	80
A145	43	50	100	125	120
A185	57	66	133	166	160
A210	66	77	153	192	185
A260	75	87	174	218	210
A300	88	101	203	254	245
AF400	119	137	274	343	330
AF460	142	164	329	410	396
AF580	178	205	411	514	495
AF750	214	247	495	618	595

Coil voltage selection

All AC operated catalog numbers include a 120VAC coil. To select other coil voltages, substitute the code from the Coil Voltage Selection Chart for the two digits after the last dash in the catalog number.

Auxiliary contact blocks

For additional auxiliary contact blocks, see catalog number explanation on page 1.2. Add \$20 to list price for each additional auxiliary, and see page 1.32 for available combinations.

Coil voltage selection chart

Hz		Volts															
		12	24	48	110	120	125	208	220	240	277	380	415	440	480	500	600
60	A		81	83	84	84		34	36	80	42		86	86	51	53	55
50	A		81	83	84				80			85	86			55	

For other voltages, see page 1.24.

Accessories for A/AF/AL & AE contactors



CAL5-11



CA5-10

Auxiliary contact blocks – Standard

Positioning	Maximum number of contact blocks	Contact Description	Catalog number	List price
Front mounting (single pole)	4 blocks: A9 – A26 AE9 – AE26 AL9 – AL26	1 N.O. 1 N.C.	CA5-10 CA5-01	\$ 15
	5 blocks: A30, A40, AE30, AE40, AL30, AL40 6 blocks: A45 – A110 AE45 – AE110 AF45 – AF110	1 N.O. Early make 1 N.C. Late break	CC5-10 CC5-01	
Front mounting (4 pole)	1 block: A9 – A26-40-00 A30 – A110 AE9 – AE110	4 N.O. 3 N.O. & 1 N.C. 2 N.O. & 2 N.C. 4 N.C. 2 N.O./2 N.C.①	CA5-40E CA5-31E CA5-22E CA5-04E CA5-11/11E	30
	1 block: A9 – A40-30-10 AL9 – AL40-30-10	3 N.O. & 1 N.C. 2 N.O. & 2 N.C. 1 N.O. & 3 N.C. 4 N.C. 4 N.O. 2 N.O./2 N.C.①	CA5-31M CA5-22M CA5-13M CA5-04M CA5-40N CA5-11/11M	
Side mounting (2 pole)	2 blocks: A9 – A75, AE9-AE45 1 block: AE50 – AE75, AL9 – AL40	1 N.O. & 1 N.C.	CAL5-11	
	1 block: A/AE/AF95 – A/AE/AF110	1 N.O. & 1 N.C.	CAL18-11	
	2 blocks: A145 – A300, AF145-AF2050 2 blocks: A145 – A300, AF145-AF2050	1 N.O. & 1 N.C. (inside L or R) 1 N.O. & 1 N.C. (outside, L or R)	CAL18-11 CAL18-11B	

Auxiliary contact blocks – Front mounting, switching low voltage and low current

Positioning	Maximum number of contact blocks	Contact Description	Degree of protection	Catalog number	List price
Front mounting (single pole)	4 blocks: A9 – A26 AE9 – AE26 AL9 – AL26	1 N.O. 1 N.C. 1 N.O. 1 N.C.	IP40 IP40 IP40 IP40	CE5-10D0.1 CE5-01D0.1 CE5-10D2 CE5-01D2	\$ 38
	5 blocks: A30, A40, AE30, AE40, AL30, AL40 6 blocks: A45 – A110 AE45 – AE110 AF45 – AF110	1 N.O. 1 N.C. 1 N.O. 1 N.C.	IP67 IP67 IP67 IP67	CE5-10W0.1 CE5-01W0.1 CE5-10W2 CE5-01W2	

① Includes 1 N.O. & 1 N.C. overlapping

Accessories

Auxiliary contact block technical data


CA5/CAL5-11/CAL18-11/CC5

Across the line
contactors

1

Types	1-pole CA5, 4-pole CA5 2-pole CAL5-11 and 1-pole CC5		CAL18-11 CAL18-11B
Standards	IEC 947-5-1 and EN 60947-5-1		
Rated insulation voltage U_i according to IEC 947-5-1	V	690	690
according to UL/CSA	V	600	690
Rated operational voltage U_e	~ V	24 to 690	
Conventional thermal current I_{th}	A	16	
Rated operational current I_e in AC-15 acc. to IEC 947-5-1	24 to 127 V 220 to 240 V 380 to 440 V 500 to 690 V	A	6 4 3 2
in DC-13 acc. to IEC 947-5-1	24 V 48 V 72 V 125 V 250 V	A	6 2.8 1 0.55 0.3
Connecting terminals (delivered in open position. Screws of unused terminals should be tightened).	M 3.5 (+,-) pozidriv 2 screw with cable clamp		
Connecting capacity			
• Rigid solid	1 or 2 x mm ²	1 to 4	
• Flexible with cable end	1 x mm ² 2 x mm ²	0.75 to 2.5 0.75 to 2.5	
Mechanical durability	cycles	10 million, A9 - A75;	5 million, A/AF95 - A/AF185; 3 million, A/AF210 - AF750; 0.5 million, AF1350 & AF1650
Max. switching frequency	cycles/h	3600	
Electrical durability		See curve below	
Max. switching frequency	cycles/h	1200	
Rated making capacity		10 x I_e AC-15	
Rated breaking capacity		10 x I_e AC-15	
Rated short-time withstand current I_{cw} $q = 40^\circ\text{C}$	1 s 0.1 s	A	100 140
Min. switching capacity		17 V / 1 mA	24V / 50 mA
Short-circuit protection - gG (gl) fuses	A	10	
Power loss per pole at 6 A	W	0.15	
Degree of protection according to IEC 529, IEC 144, DIN 40 050 and NFC 20-010		IP 20	

CAL18

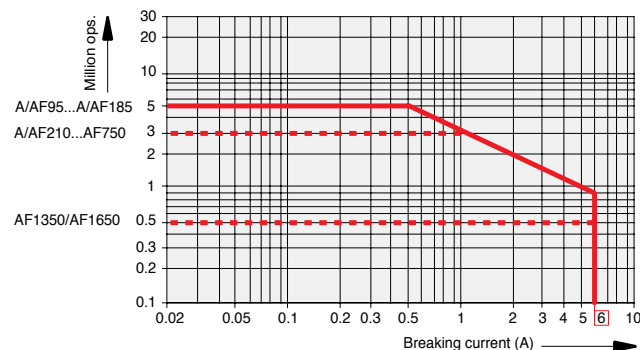

Electrical durability

AC-15 according to IEC 947-5-1


making current: 10 x I_e where $\cos \phi = 0.7$ and U_e

breaking current: I_e where $\cos \phi = 0.4$ and U_e

The curves opposite show the electrical durability of the auxiliary contact blocks according to breaking current I_e .

These curves have been plotted for resistive and inductive loads up to 690 V, 40 to 60 Hz.

CA5, CAL5

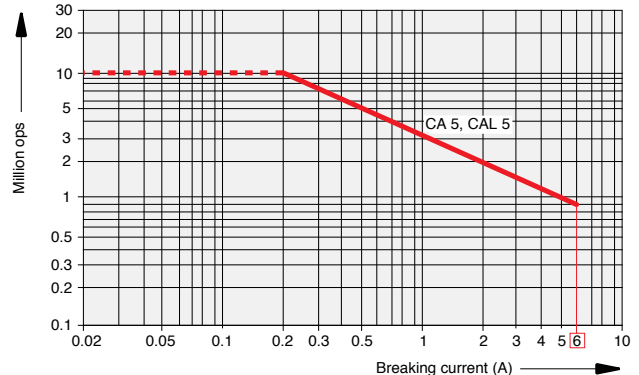

Accessories

Auxiliary contact block technical data
CE5

Auxiliary contact blocks for switching low level voltage and current

Types		CE5-10D0.1 CE5-01D0.1 CE5-10W0.1 CE5-01W0.1 Version 100 mA	CE5-10DZ CE5-01DZ CE5-10WZ CE5-01WZ Version 2 A
Standards		IEC 947-5-1 and EN 60947-5-1	
Approvals		UL / CSA	
Rated insulation voltage U_i			
according to IEC 947-5-1	V	250	250
according to UL/CSA	V	125	250
Rated operational voltage U_e		125	250
Rated operational current I_e			
in AC-15 or AC-14 acc. to IEC 947-5-1	A	0.1	2
in DC-12 acc. to IEC 947-5-1	A	0.1	2
24 V	A	0.1	0.5
60 V	A	0.1	0.2
110 V	A	0.1	0.1
220 V	A	0.1	
Minimal switching		3 V / 1 mA	17 V / 1 mA
Reliability for the minimal switching		10 ⁻⁸	
Connecting terminals		M3.5 (+,-) posidriv 2 screw with cable clamp	
Connecting capacity		1 ou 2 (1...4) mm ² 1 ou 2 (0.75... 2.5) mm ²	
Short circuit protection		100 mA	10 A
Degree of protection			
according to IEC529, IEC 144, DIN 40 050, NFC 20-010	IP 20		
Mounting		Front mounting on contactors: A, AE, TAE9...110, AL, AF, GA, N, NE	
Dimensions		Identical to those of CA5 single pole	

Accessories for A/AF/AL & AE contactors

Across the line
contactors

1



TP40DA



VE5-1




VM300H



LK75-L

LK75-F

LK110



Pneumatic timers

Mounting on	Timing range	Contacts N.O. N.C.	Catalog number	List price
A9 – A75	On delay 0.1 – 40 s	1 1	TP40DA	\$ 108
AE9 – AE75	On delay 10 – 180 s	1 1	TP180DA	
AL9 – AL40	Off delay 0.1 – 40 s	1 1	TP40IA	
	Off delay 10 – 180 s	1 1	TP180IA	

Interlocks for two horizontally mounted contactors – A9 - A110

Feature	Mounting on	Contacts N.O. N.C.	Catalog number	List price
Mechanical/electrical	A/AE/AL9 – A/AE/AL40	– 2	VE5-1	\$ 45
Mechanical/electrical	A45 – A110	– 2	VE5-2 ①	45
Mechanical	A/AE/AL9 – A/AE/AL40	– –	VM5-1	21

Interlocks for two horizontally mounted contactors – A95 - AF1250 contactors

Feature	Left contactors	Right contactors	Catalog number	List price
Mechanical	A95 – A300	A145 – A300	VM300H	\$ 110
Mechanical	A210 – A300	AF400 – AF460	VM300/460H	130
Mechanical	AF400 – AF1250	AF400 – AF1250	VM750H	150

Interlocks for two vertically mounted contactors – A95 - AF1250 contactors

Feature	Top contactor	Bottom Contactor	Catalog number	List price
Mechanical	A95 – A300	A145 – A300	VM300V	\$ 205
Mechanical	A210 – A300	AF400 – AF460	VM300/460V	250
Mechanical	AF400 – AF1250	AF400 – AF1250	VM750V	270

Interlocks for two horizontally mounted contactors – AF1350 - AF2050 contactors

Feature	Left contactor	Right Contactor	Catalog number	List price
Mechanical	AF1350 – AF2050	AF1350 – AF2050	VM1650H	\$ 655

Auxiliary lead terminals

Connections	Mounting on	Catalog number	List price
Connects from side	A50 – A75	LK75-L	\$ 15
Connects from top	A50 – A75	LK75-F	15
Connects from side	A95 – A110	LK110	23

① Use type VE 5-2 for mechanical and electrical interlocking between A30/A40 and A50 - A75 contactors.


Accessories for A/AE/AL/AF contactors



ATK185



ATK750/3



ZL75



ZL145



WB75A-04



BA5-50

Terminal lug kits (Set of 3)

Wire range	For contactor	Catalog number	List price
6 – 300 MCM	A145 – A185	ATK185	\$ 45
4 – 400 MCM	A210 – A300	ATK300	68
(2) 4-500 MCM	A210 – A300	ATK300/2	110
(2) 2/0 – 500 MCM	AF400 – AF580	ATK580/2	150
(3) 2/0 – 500 MCM	AF580 – AF1250	ATK750/3	225
(4) 4/0 – 500 MCM	AF1350	ATK1350/4	235
(4) 1/0 – 750 MCM	AF1350 – AF2050	ATK1650/4	335
(6) 1/0 – 750 MCM	AF1350 – AF2050	ATK1650/6	560

Contact kits

For contactors	Catalog number	List price
3 Pole		
A/AE/AF50	ZL50	\$ 113
A/AE/AF63	ZL63	135
A/AE/AF75	ZL75	158
A/AE/AF95	ZL95	225
A/AE/AF110	ZL110	255
A/AF145	ZL145	300
A/AF185	ZL185	420
A/AF210	ZL210	525
A/AF260	ZL260	855
A/AF300	ZL300	1,020
AF400	ZL400	1,716
AF460	ZL460	2,434
AF580	ZL580	3,795
AF750	ZL750	3,960
AF1250	ZL1250	5,280
AF1350	ZL1350	4,255
AF1650	ZL1650	4,890
AF2050	ZL2050	6,290
4 Pole		
A/AE45	ZLT45	150
A/AE50	ZLT50	150
A/AE75	ZLT75	210
3 Pole		
UA50	ZLU50	150
UA75	ZLU75	215
UA95	ZLU95	306
UA110	ZLU110	347

Mechanical latches

For contactors	Catalog number	List price
A9 – A75, AE45 – AE75, & AL9 – AL40	WB75A-Δ	\$ 84

Δ - Coil voltage suffix. Refer to Coil Voltage Selection chart and substitute the desired coil voltage suffix for the Δ.

Coil voltage selection chart – mechanical latches for A, AE & AL contactors

50 Hz (AC/DC)	60 Hz (AC)	Voltage code	50 Hz (DC)	60 Hz (AC)	Voltage code
24	24 – 28	01	220 – 230	220 – 255	06
42	42 – 48	02	230 – 240	230 – 277	05
48	48 – 55	03	380 – 415	380 – 440	07
110	110 – 127	04	415 – 440	440 – 480	08

Range: WB75A for contactors A9 – A75, AL9 – AL40, AE45 – AE75 and control relays N and NL.

Description: WB75A block: contains a mechanical latching device with electromagnetic impulse unlatching (AC or DC) or manual unlatching. Captive screw type connecting terminals, built-in cable clamps, M 3.5 (=, -) posidrive 1 screw with screwdriver guidance, delivered untightened and protected against accidental direct contact.

Operation: After closing, the contactor continues to be held in the closed position by the latching mechanism should the supply voltage fail at the contact coil terminals.

Contact opening can be controlled:

- Electrically by an impulse* (AC or DC) on the WB75A block coil. The coil is not designed to permanently energized.
- Manually by pressing the pushbutton on the front face of the WB75A block.

Mounting: WB75A is clipped onto the front face of the contactor.


Identification markers

Mounting on	Coil voltage	Catalog number	List price
A/AE/AL/AF9 – A/AE/AL/AF110	Pack of 50	BA5-50	\$ 15

Accessories for A/AE/AL/AF contactors

Across the line
contactors

1

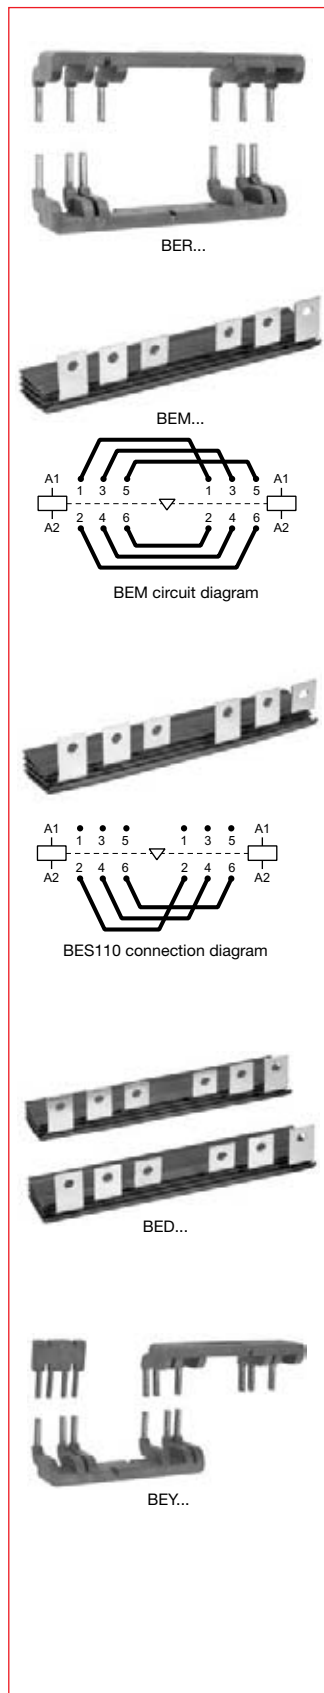

Connection kits for reversing

Mounting on 3 pole contactors	Catalog number	List price
A/AE/AL9 – A/AE/AL16 A/AE/AL26 – A/AE/AL40	BER16V BER40V	\$ 35 49
A/AE/AF50 – A/AE/AF75 A/AE/AF95, A/AE/AF110 A/AF145 – A/AF185 A/AF210 – A/AF300	BEM75-30 BEM110-30 BEM185-30 BEMA300-30	165 180 260 470
AF400 – AF460 AF580 – AF750	BEM460-30 BEM750-30	850 1,200

Application

Connections between the main poles of **two 3 pole contactors** mounted side by side so that they operate as reversing contactors.

Description

The connection kits for reversing contactors are made up of three reversing connections and three phase to phase connections.

- | | |
|------------------|-------------------------------------|
| BER16V | – Molded plastic, solid copper bars |
| BER40V | – Molded plastic, solid copper bars |
| BEM75 and 110-30 | – Insulated, solid copper bars |

Connection kits for phase to phase

Mounting on 3 pole contactors	Catalog number	List price
A/AE/AF50, A/AE/AF95, A/AF145 – A/AF185 A/AF210 – A/AF300	BES75-30 BES110-30 BES185-30 BESA300-30	\$ 75 90 130 200
AF400 – AF460 AF580 – AF750	BES460-30 BES750-30	425 650

The connection kit for phase to phase contactors is made up of three phase to phase bus bars.

Connection kits for wye-delta starters

Mounting on contactors		Catalog number	List price
Line and delta contactor	Wye contactor		
A9	A9	BEY16V-2	\$ 46
A12	A9		
A16	A12		
A26	A16	BEY26-2	76
A30	A26	BEY40-2	76
A40	A26		
A50	A30	BED50U	165
A63	A40		
A75	A50	BED75U	180
A95	A75	BED95U	195
A110	A95	BED110U	225
A145	A110	BED145U	250
A185	A145	BED185U	290
A210	A185	BED210U	375
A260/A300	A210	BED300U	500
AF400/AF460	A260/A300	BED400U	850
AF460	AF400	BED460U	900
AF580	AF400/AF460	BED580U	1,250
AF750	AF580	BED750U	1,450

Application

Connections between the main poles of a wye-delta starter.

Description


- The connection kits for wye-delta starters are made up of:
- Three line contactor/wye contactor connections – line side.
 - Three wye contactor/delta contactor connections – load side.
 - The shorting connection for the “S” contactor.

BEY16V-2, BEY26-2, BEY40-2 – Molded plastic, solid copper bars

BED50U thru BED750U – Insulated, solid copper bars.

The above connection sets allow a mechanical interlock unit to be mounted between the wye and delta contactors if required.

Accessories for A/AE/AL/AF contactors

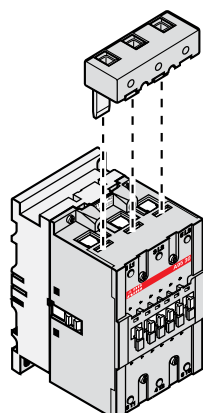

LD110




BEXT-75



LX...



LT185-AC



LT185-AL



LW...

Additional terminal blocks

Mounting on 3 pole contactors	Wire range	Catalog number	List price
A/AE/AL9 – A/AE/AL16 (set of 2)	16 – 6	LD-16	\$ 20
A/AE/AL26 (set of 2)	14 – 6	LD-26	22
A/AE/AL30 – A/AE/AL40	12 – 4	LD-40	26
A/AE/AF50 – A/AE/AF75	10 – 2	LD-75	28
A/AE/AF95 – A/AE/AF110	8 – 1	LD-110	30

Utilization – The LD series terminal block is designed to increase the connection capacity of the contactor on which it is mounted. The LD 75 and LD110 terminal blocks are mounted in the three independent apertures located above the built-in connectors.

Terminal extensions

Mounting on contactors	Catalog number	List price
A/AE/AF50 – A/AE/AF75	BEXT-75	\$ 15
A/AE/AF95, A/AE/AF110	LW110	95
A/AF145 – A/AF185	LX185	90
A/AF210 – A/AF300	LX300	140
AF400 – AF460	LX460	195
AF580 – AF750	LX750	225

Application

They are designed to increase the width of the contactor terminal pads to allow larger connectors to be mounted.

Description

Terminal extension sets contain 3 bars.

Terminal shrouds – two pieces

For contactor	Catalog number	List price
A/AF145 – A/AF185 for flush mount A/AF145 – A/AF185 for extended mount A/AF145 – A/AF185 for shorting bar LY... between A(F)145 / A(F)185 & TA200DU A/AF210 – A/AF300 for flush mount A/AF210 – A/AF300 for extended mount A/AF210 – A/AF300 for shorting bar LY300	LT185-AC LT185-AL LT185-AY LT300-AC LT300-AL LT300-AY	\$ 10
AF400 – AF460 for flush mount AF400 – AF460 for extended mount AF580 – AF1250 for flush mount AF580 – AF1250 for extended mount	LT460-AC LT460-AL LT750-AC LT750-AL	20

Terminal enlargements

For contactor	Catalog number	List price
A/AF95 – A/AF110	LW110	\$ 95
A/AF145 – A/AF185	LW185	120
A/AF210 – A/AF300	LW300	130
AF400 – AF460	LW460	295
AF580 – AF750	LW750	355
AF1250	LW1250	375

Arc chutes

For contactor	Catalog number	List price
A/AF145 – A/AF185	ZW185	\$ 130
A/AF210 – A/AF300	ZW300	180
A/AF400 – A/AF460	ZW460	190
A/AF580 – A/AF750	ZW750	230
AF1350 – AF1650	ZW1650	215

Accessories for A/AE/AF contactors

Across the line
contactors

1



BEA185/S3/S4



BEAD185D/S3/S4



BEA185H/S4



LP185



LY...

Vertical connection bars between contactor and MCCB – three bars

MCCB	For contactor	Catalog number	List price
T1	A/AE/AF50 – A/AE/AF75	BEA75/T1	\$ 85
T3	A/AE/AF95 – A/AE/AF110	BEA110/T3	95
T3	A/AF145 – A/AF185	BEA185/T3	60
S3, S4	A/AF145 – A/AF185	BEA185/S3/S4	60
T4	A/AF145 – A/AF185	BEA185/T4	70
T4	A/AF210 – A/AF300	BEA210/T4	70
T5	A/AF210 – A/AF300	BEA300/T5	75
T5	A/AF400 – A/AF750	BEA750/T5	115
S5	A/AF210 – A/AF300	BEA300/S5	75
S5 ^①	AF400 – AF460	BEA400/S5	95
S6	AF400 – AF750	BEA750/S6	115

Vertical connection bars between contactor and MCCB – three bars

MCCB	For contactor	Catalog number	List price
S3, S4	A/AF145 – A/AF185	BEA185D/S3/S4	\$ 70
S4	A/AF210 – A/AF300	BEA210D/S4	80
S5	A/AF210 – A/AF300	BEA300D/S5	85
S5	AF400 – AF460	BEA400D/S5	105
S6	AF400 – AF750	BEA750D/S6	125

To be used when power take off is needed (IP00) or with other bus bars. (EX: Reversing, IP20)

Horizontal connection busbars between contactor and MCCB – three bars

MCCB	For contactor	Catalog number	List price
S3, S4	A/AF145 – A/AF185	BEA185H/S4	\$ 150
S4	A/AF210 – A/AF300	BEA210H/S4	220
S5	A/AF210 – A/AF300	BEA300H/S5	220
S5	AF400 – AF460	BEA400H/S5	435
S6	AF400 – AF460	BEA460H/S6	660
S6	AF580 – AF750	BEA750H/S6	670

Shorting bars, 2 pole

For contactor	Catalog number	List price
A/AF145 – A/AF185	LP185	\$ 35
A/AF210 – A/AF300	LP300	50
AF400 – AF460	LP460	50
AF580 – AF750	LP750	50

Shorting bars, 3 pole


For contactor	Catalog number	List price
A/AE45 – A/AE/AF75	LF75	\$ 40
A/AE/AF95 – A/AE/AF110	LY110	40
A/AE/AF145 – A/AE/AF185	LY185	40
A/AE/AF210 – A/AE/AF300	LYA300	60
AF400 – AF460	LY460	60
AF580 – AF750	LY750	60

① Not for use with flange handles.

Accessories

for A/AE/AL/AF contactors

Coils & coil voltage codes

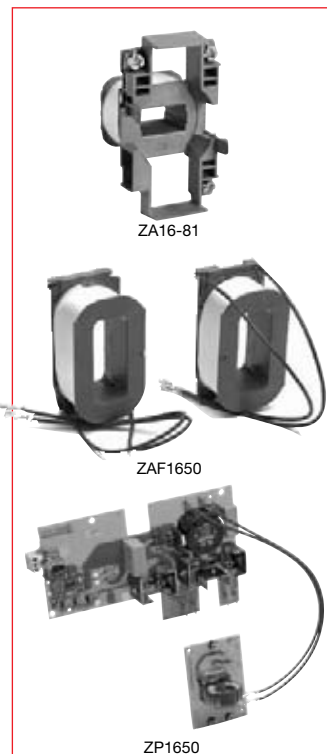

Coils – AC operated

For contactors	Catalog number	List price
A9 – A16	ZA16-Δ	\$ 24
A26 – A40	ZA40-Δ	30
A45 – A75	ZA75-Δ	57
A95 – A110	ZA110-Δ	60
A145 – A185	ZA185-Δ	150
A210 – A300	ZA300-Δ	180

Coils – DC operated

AE9 – AE16	ZAE16-Δ	24
AE26 – AE40	ZAE40-Δ	30
AE45 – AE75	ZAE75-Δ	57
AE95 – AE110	ZAE110-Δ	90
Auxiliary including an insertion contact and a varistor for DC operated contactors AE95 – AE110	CCL18-01	45

Coils – AC/DC operated (coil and printed circuit board except ZAF1650)

AF45 – AF75	ZAF75-Δ	120
AF95, AF110	ZAF110-Δ	165
AF145 – AF185	ZAF185-Δ	200
AF210 – AF300	ZAF300-Δ	240
AF400, AF460	ZAF460-Δ	450
AF580, AF750, AF1250	ZAF750-Δ	525
AF1350, AF2050 (Set of 2 coils only)	ZAF1650-Δ	920

Printed circuit board – AC/DC operated

AF1350 – AF2050	ZP1650	1,620
-----------------	--------	-------

Δ – Coil voltage suffix. Refer to Coil Voltage Selection charts below and substitute the desired coil voltage code for the Δ.

Coil voltage selection – AC operated for A9 – A300; UA26 – UA110

VAC (50Hz)	VAC (60Hz)	Voltage Code
24	24	81
26	28	16
28	32	17
42	42	82
48	48	83
60	60	73
100	100 – 110	74 ②
110	110 – 120	84
110 – 115	115 – 127	89 ③
120	140	29
125 – 127	150	30
175	208	34
190	220	36
200	200 – 220	75 ②
220 – 230	230 – 240	80
230 – 240	240 – 260	88
230 – 240	277	42
230/400	–	62 ①
–	230/400	63 ①
380 – 400	400 – 415	85
400 – 415	415 – 440	86
–	480	51
440	500	53
500	600	55
550	–	56
660 – 690	–	58

Coil voltage selection – DC operated for AE contactors

VDC	Voltage code AE contactors
12	80
24	81
42	82
48	83
50	21
60	84
75	85
110	86
125	87
220	88
240	89
250	38

Coil voltage selection – AC/DC operated for AF50 – AF2050

VAC & VDC 40-60 Hz	Suffix Code
24 – 60 VDC	68 ④
20 – 60 VDC	72 ⑤
48 – 130 VAC/VDC	69
100 – 250 VAC/VDC	70 ⑦
250 – 500 VAC/DC	71 ⑥

- ① Only for A9 – A16.
 ② Not for A145 – A300
 ③ A145 – A300 at 60 Hz, 115V only
 ④ AF400 – AF1250, DC only
 ⑤ AF45 – AF300
 ⑥ AF400 – AF750 only
 ⑦ Only option for AF2050 – AF1650

Accessories for EK contactors Coils & coil voltage codes

Across the line
contactors

1

Coils – AC & DC operated

Contactor size	AC Coils		DC Coils	
	Catalog number	List price	Catalog number	List price
EK110, EK150	KH210-Δ	\$ 200	KH210-Δ	\$ 200
EK175, EK210	KH300-Δ	240	KH300-Δ	240
EK370, EK550	KH800-Δ	580	KH800-Δ	580

Δ – Coil voltage suffix. Refer to the Coil Voltage Selection chart and substitute the desired coil voltage suffix for the Δ. AC and DC operated contactors DO NOT have the same magnet structure. Therefore, DC coils will not fit on an AC magnet structure and vice versa.

Coil voltage selection – AC operated for EK110 – EK550

VAC (50Hz)	VAC (60Hz)	Voltage Code
–	24	F
24	–	N
–	48	G
110	120	1
–	208	B
–	240	2
220 – 230	–	J
–	380	Z
380 – 400	440	3
400 – 415	–	M
–	480	4
500	–	5
–	600	6

Consult factory if other voltages are required.

Coil voltage selection – DC operated for EK110 – EK550

VDC	Voltage Code
24	Y
48	W
110	P
125	Q
220	R
440	T

Consult factory if other voltages are required.

Accessories

Surge suppressors for A/AE/AL/EK contactors



RV 5/50







RC 5-1/150

Surge suppression device

Mounting on	Voltage range	Catalog number	List price
AE9 to AE110 AL9 to AL40	12 – 32 VDC 25 – 65 VDC 50 – 90 VDC 77 – 150 VDC 150 – 264 VDC	RT5/32 RT5/65 RT5/90 RT5/150 RT5/264	\$ 30
A9 to A110; AE9 to AE110 AL9 to AL40	24 – 50 VAC/VDC 50 – 133 VAC/VDC 110 – 250 VAC/VDC 250 – 440 VAC/VDC	RV5/50 RV5/133 RV5/250 RV5/440	
A9 to A40	24 – 50 VAC 50 – 133 VAC 110 – 250 VAC 250 – 440 VAC	RC5-1/50 RC5-1/133 RC5-1/250 RC5-1/440	
A45 to A300	24 – 50 VAC 50 – 133 VAC 110 – 250 VAC 250 – 440 VAC	RC5-2/50 RC5-2/133 RC5-2/250 RC5-2/440	
EK110 to EK210	24 – 48 VAC 110 – 415 VAC	RC-EH250/48 RC-EH250/415	52
EK370 to EK550	48 – 110VAC	RC-EH800/110	
EK110 to EK550	24 – 125VDC	RC-EH800/110	
EK370 to EK550	220 – 600VAC	RC-EH800/600	

Technical data

Type	Control circuit	Opening time growth factor	Residual overvoltage or clipping voltage	Remarks
RT 5/... transil diode 	32 DC 65 DC 90 DC 150 DC 264 DC	2.5 to 3	50 V 100 V 150 V 210 V 390 V	Advantages • Good energy absorption • Unpolarized system • Simple, reliable system Drawback • A certain delay on drop out which does not however reduce contactor breaking capacity.
Varistor 	RV 5/... 50 AC/DC 133 AC/DC 250 AC/DC 440 AC/DC	1.1 to 1.5	132 V 270 V 480 V 825 V	Advantages • High energy absorption; good damping • Unpolarized system Drawback • Clipping as from U_{vdr}, thus voltage front up to this point
RC 5-1/... or RC 5-2/... RC-EH 300/... 	see table above AC	1.2 to 3	2 to 3 x U_c	Advantages • Very fast clipping • Attenuation of steep fronts and thus of high frequencies • No operating delays
Varistor + RC 	RC-EH ... 800/110 AC/DC 800/600 AC	1.1 to 1.5	205 V 1100 V	Advantages • High energy absorption: good damping • Unpolarized system • The RC system damps the voltage front under the U_{vdr} threshold.


* U_{vdr} = Varistor operating voltage (voltage dependent resistor), tolerance $\pm 10\%$

Accessories

Surge suppressors for A/AE/AL/EK contactors General information

Across the line
contactors

1



General

The operation of inductive circuits causes overvoltages, in particular on opening of the contactor coil.

The electromagnetic energy stored by the coil during contactor closing is restored on opening in the form of surges, the slope and amplitude of which may rise to several kilovolts. A number of drawbacks are observed ranging from interference on the electronic devices to breakdown of insulators and even destruction of certain sensitive components.

The graph opposite reproduces the oscillogram showing voltage discharges at the terminals of a 42V/50Hz coil without peak clipping. The coil was switched by 8 series-connected poles of a contactor relay.

Following a burst of discharges with a very steep slope a damped oscillation emerges with a peak value of 3500V.

Overvoltage factor

The overvoltage factor k is defined as the ratio of the maximum overvoltage peak value $\hat{U}_s$ to the peak value $\hat{U}_c$ of the coil rated control voltage U_c :

$$k = \frac{\hat{U}_s \text{ max.}}{\hat{U}_c}$$

in DC:

$$k = \frac{\hat{U}_s \text{ max.}}{U_c}$$

or in AC:

$$k = \frac{\hat{U}_s \text{ max.}}{U_c \sqrt{2}}$$

For example the following is obtained for the above graph: $k = \frac{3500}{42 \sqrt{2}} \approx 60$

Surge suppressors

To guard against the harmful effects of these overvoltages, ABB has developed a range of surge suppressors designed to reduce the k factor defined above and to limit or even completely eliminate the high pre-damping voltage frequencies.


Each case is different, but the technical data tolerances and the generous sizing of parts have enabled us to reduce the number of variants.

We have chosen the following solutions: transil diodes, varistors and RC blocks.


Note: A varistor is a resistor whose value increases to a very large extent when a certain voltage is applied at its terminals.

Wiring diagrams


Transil diode




Varistor (only)



RC type



Varistor + RC



General technical data

The housings and impregnation resins of the surge suppressors are made of flame-resistant materials in accordance with the UL 94 standard.

These systems are not polarized, i.e. d.c. operated devices do not have to be connected in a specific direction.

- Operating temperature: -20 to +70 °C
- Connection to the coil terminals (parallel mounting)
 - For **RT 5**, **RV 5**, **RC 5-1** and **RC 5-2**: clip-on for both fixing and connection.
- Mounting:
 - **RT 5**, **RV 5** and **RC 5**: clipped onto the top part of the contactor base. This mounting method prevents any projections and change in contactor dimensions.
 - **RC-EH**: glued to the top part of the contactor base.

Accessories

Interface relays for A contactors



A30-30-10 + RA 5



RA 5

Interface relays

Mounting on contactor types	Control voltage U_c	Coil voltages	Catalog number	List price
N, A9 – A110	24 VDC	24 – 250V, 50, 60 Hz	RA5-1	\$ 75

NOTE: The interface relays provided for the A contactors can also be used for UA, UA..., RA and GA types.

Application

RA 5-1 interface relays are designed to receive 24 VDC signals delivered by PLC's or other sources with a low output power and restore them with sufficient power to operate the coils of the relevant A9 – A110 contactors or the N control relays.

- IEC only

Description

RA5 interface relays are made up of a miniature electromechanical relay equipped with a N.O. contact and with a low consumption 24 VDC coil.

The interface relay coil is controlled by the PLC while the N.O. contact ensures switching of the power contactor.

Coil switching gives rise to overvoltages which have adverse effects on the electronic devices, insulators and, more generally, on component lifetime. The RA 5-1 is equipped with surge suppressors:

- on the 24 VDC relay coil via a diode
- on the power contactor coil via a varistor.

Furthermore, the RA 5-1 are protected against relay pole reversal by a diode inserted between the E1 and E2 input terminals.

Connection



The "E1+" and "E2–" input terminals must be connected, according to their polarity, to the PLC output.

The RA 5 is equipped with two terminal pads for connection to the A1 and A2 terminals of the contactor coil. This coil is supplied between the A0 and A2 terminals of the RA 5.

Mounting

- RA5: terminal pads clamped inside the contactor coil terminals.

RA 5-1 interface relay for the A 9 – A 110 contactors and N control relays

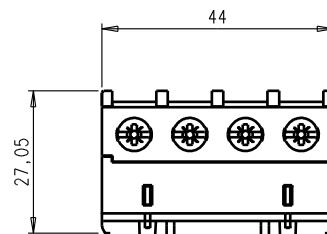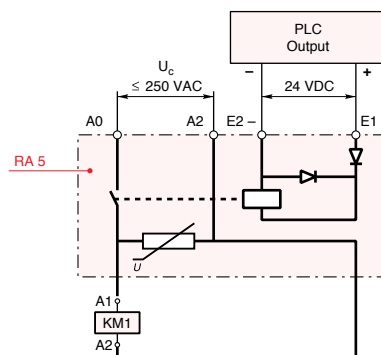

Accessories

Interface relay technical data

Across the line
contactors

1

General technical data

Compliance with standards		IEC 60255-5
Rated insulation voltage U_i according to IEC 60947-4-1	V a.c.	250
Permissible ambient temperature:		
– for free air operation:		
– at $U_e = 24$ V d.c. (between E1 and E2)	°C	-25 ... +70
– from 0.85 to 1.1 U_e	°C	-25 ... +55
– for storage	°C	-40 ... +70
Climatic withstand		Complies with that of associated contactors
Operating altitude	m	≤ 3000
Mounting position		No limitation
Fixing		Using the contactor A1 and A2 terminal connecting parts
Connecting terminals (delivered in open position)		M3.5 (+,-) pozidriv 2 screws with cable clamp
Connecting capacity (min. ... max.)		
– rigid solid	2 x mm²	1 ... 4
– flexible with cable end	2 x mm²	0.75 ... 2.5
Tightening torque		
– recommended	Nm	1.00
– max.	Nm	1.20
Degree of protection according to IEC 60947-1 / EN 60947-1 and IEC 60529 / EN 60529		Protection against direct contact in acc. with EN 50274 RA5-1 wired and mounted on the associated contactor

Working data

Surge suppression:		
– for contactor coil		Varistor
– for interface relay coil		Diode
Protection against polarity reversal between terminals E1 and E2		Diode
Interface relay operating time	ms	Closing and drop-out ≤ 10
Total operating time, interface relay + contactor:		
– between energization and:		
N.O. contact closing	ms	20 ... 37
N.C. contact opening	ms	17 ... 32
– between de-energization and:		
N.O. contact opening	ms	17 ... 25
N.C. contact closing	ms	20 ... 28

Electrical input data

Control voltage (E1 and E2 terminals) U_e		
– rated value	V d.c.	24
– max. range at ambient temperature 20 °C	V d.c.	19 ... 30
Max. consumption for $U_e = 24$ V d.c., $\theta = 20$ °C	W	0.3
"0" status (relay open) for U_e	V d.c.	≤ 2.4
or I_e	mA	< 1
"1" status (relay closed) for U_e	V d.c.	≥ 19
Max. short supply interruption immunity time	ms	2

Electrical output data


Switching voltage (A0 and A2 terminals)	V a.c.	≤ 250
Electrical durability million of operating cycles		2 (600 cycles/h) on A 9 ... A 75 contactors or N... contactor relay 0.5 (600 cycles/h) on A 95 and A 110 contactors

Accessories for A contactors


TE5S electronic timer for wye-delta starters




TE5S-*



Chart



Equivalent diagram



Front face

Electronic timer

For contactors	Rated control voltage U_c V	Packing piece	Unit weight kg	Catalog number	List price
A9 – AF750	24 AC/DC	1	0.080	TE5S-24	\$ 120
	110 – 120 AC	1	0.080	TE5S-120	
	220 – 240 AC	1	0.080	TE5S-240	
	380 – 440 AC	1	0.080	TE5S-440	

Application

Utilization

When used in wye-delta starters, the **TE5S** lags the wye connection and provides a lapse of 50 ms before the switchover to the delta connection.

Description

According to the type of device chosen, the electronic circuit has a 24 VAC/VDC, 110 – 120 VAC or 220 – 230 VAC supply. An output relay with reversing contact ensures high current switching. A two-position switch allows selection of one of the two time delay ranges: 0.8 to 8 s or 6 to 60 s. The 0.1 to 1.0 adjustable knob allows an initial setting without steps within the previously selected range which can then be adjusted using a stopwatch.

Note: We recommend that you allow for temperature drift for the final adjustment of the time delay setting. Drift: -0.2% per $^{\circ}\text{C}$. For example, a setting made at 20°C will yield a time delay shorter by 7% at 55°C in an enclosure. (-0.2% per $^{\circ}\text{C}$ i.e. $-0.2 \times 35 = -7\%$).

The TE5S, which is not affected by these settings, establishes a fixed "lapse" of 50 ms between the opening of contact 15 – 16 and the closing of contact 15 – 18. It is this time delay that prevents from arc short-circuit during wye to delta switching.

Operation

On energization, the green U indicator light (voltage applied) comes on. Contact 15 – 16 then immediately moves to the closed position.

Count-down of the programmed time immediately commences.

When the time delay has elapsed, contact 15 – 16 opens and at the same time the 50 ms lapse, t_2 , begins after which contact 15 – 18 moves to the closed position. The yellow R indicator light comes on.

On de-energization, the U and R indicator lights go out and, after the 250 ms resetting time, the device is ready for a new cycle.

Mounting

Mounts on 35mm DIN rail.

Accessories for A contactors

TE5S electronic timer for wye-delta starters, technical data

Across the line
contactors


1

Technical Data

Types	TE5S-24	TE5S-120	TE5S-240	TE5S-440
Compliance with standards	IEC 60947-5-1, EN 60947-5-1			
Rated insulation voltage U_i according to IEC 60947-5-1	V	440		
Rated operational voltage U_e according to IEC 60947-5-1	V d.c. V a.c.	24 24 ... 240		– 440
Conventional free air thermal current I_{th}	A	10		
Rated operational current I_e acc. to IEC 60947-5-1				
AC-15	24-120 V a.c. 220-240 V a.c. 380-440 V a.c.	A A A	5 4 –	– – 3
DC-13	24 V d.c.	A	4	–
Short-circuit protection - gG type fuses	A	10		
Rated supply voltage U_c	V d.c. V a.c.	24 24	– 110 ... 120	– 220 ... 240
– Rated frequency limits	Hz	48 ... 63		
– Supply voltage range		0.85 ... 1.1 U_c		
– Overvoltage protection		Built-in varistor		
– Load factor	%	100		
– Average consumption	– in d.c. – in a.c.	W VA	0.7 1.5	– 3.5
Time delay range (t_1) selected by switch	s	0.8 ... 8 and 6 ... 60		
– Temperature drift	% per °C	–0.2		
– Mechanical setting accuracy		±15 % of the setting range		
– On-load reiteration accuracy under constant conditions		±2 % after 1 million operating cycles		
Minimum time lapse (t_2)	ms	50		
Min. time lapse after 1 million operating cycles	ms	40		
Resetting time (maximum)	ms	250		
Front panel display:	– green indicator light – yellow indicator light	Energization	Output relay activated	
Permissible air temperature				
– for operation	°C	–25 ... +60		
– for storage	°C	–40 ... +85		
Vibration withstand acc. to IEC 60068-2-6, EN 60068-2-6		3 g from 10 to 300 Hz in the 3 directions		
Shock withstand acc. to IEC 60068-2-27, EN 60068-2-27		20 g / 11 ms in directions A and C 15 g / 11 ms in direction B		
Electrical durability	in millions of op. cycles	1		
Mechanical durability	in millions of op. cycles	5		
On-load maximum switching frequency	cycles/h	720		600
Fixing on mounting rail acc. to IEC/EN 60715		35 x 7.5 or 35 x 15		
Connecting terminals		(+, -) pozidriv 1 screw		
Connecting capacity				
– rigid solid	1 or 2 x mm ²	1 ... 2.5		
– flexible with cable end	1 or 2 x mm ²	0.75 ... 2.5		
Tightening torque	Nm	0.6 ... 0.8 max.		
Degree of protection according to IEC 60947-1 / EN 60947-1 and IEC 60529 / EN 60529	Terminals	IP 20		

Accessories

Possible accessory combinations for A contactors

Positioning	Accessories – Front face mounting			Accessories – Side mounting		
	Auxiliary contacts 1 – pole	Auxiliary contacts 4 – pole	Pneumatic timers	Auxiliary contacts	Electrical or mechanical interlock ^①	
	CA5-10 or CA5-01	CA5-40 or CA5-22 or CA5-31	TP – D or TP – I	CAL 5-11 CAL18-11 CAL18-11B	VE5-1 or VM 5-1	VE 5-2 VM300H VM300/460H VM750H

Configurations of accessories are different depending on whether front or side mounted.

N Contactor relays A and AE Contactors			Accessories – Front mounting			Accessories – Side mounting	
Type	Main poles	Built-in auxiliary contacts	Auxiliary contact blocks	TP - A Pneumatic timer block		Auxiliary contact Blocks	Interlock units
			1-pole CA5-	4-pole CA5-		2-pole CAL5-11, CAL18-11	
							
A9 – A26	– 3 0 – 1 0		1 to 4 CA5- 1-pole blocks	OR 1 CA5- 4-pole block	OR 1 TP - A block	+ 1 to 2 CAL5-11 blocks	OR 1 VM/E 5-1 block + 1 CAL5-11 block
A9 – A26	– 3 0 – 0 1 ①						
A9 – A26	– 4 0 – 0 0						
A9 – A26	– 2 2 – 0 0 ①						
AE9 – AE26	– 3 0 – 0 0						
AL9 – AL26	– 3 0 – 1 0		1 to 4 CA5- 1-pole blocks	OR 1 CA5- 4-pole block	OR –	OR 1 CAL5-11 block	OR 1 VM/E 5-1 block + 1 CAL5-11 block
AL9 – AL26	– 3 0 – 0 1						
AL9 – AL16	– 4 0 – 0 0						
AL9 – AL16	– 2 2 – 0 0		1 to 4 CA5- 1-pole blocks	OR 1 CA5- 4-pole block	OR –	OR 1 CAL5-11 block	OR 1 VM/E 5-1 block + 1 CAL5-11 block
AL26	– 4 0 – 0 0						
AL26	– 2 2 – 0 0						
A9 – A16	– 3 0 – 2 2		–	–	–	+ 1 to 2 CAL5-11 blocks	OR 1 VM/E 5-1 block + 1 CAL5-11 block
A9 – A26	– 3 0 – 3 2						
A30, A40	– 3 0 – 1 0		1 to 5 CA5- 1-pole blocks	OR 1 CA5- 4-pole block + 1 CA5- 1-pole block	OR 1 TP - A block + 1 CA5- 1-pole block	+ 1 to 2 CAL5-11 blocks	OR 1 VM/E 5-1 block + 1 CAL5-11 block
A30, A40	– 3 0 – 0 1						
AE30, AE40	– 3 0 – 1 0						
AE30, AE40	– 3 0 – 0 1		1 to 5 CA5- 1-pole blocks	OR 1 CA5- 4-pole block + 1 CA5- 1-pole block	OR –	OR 1 CAL5-11 block	OR 1 VM/E 5-1 block + 1 CAL5-11 block
AE30, AE40	– 3 0 – 0 1						
A30, A40	– 3 0 – 3 2		1 CA5- 1-pole block	–	–	+ 1 to 2 CAL5-11 blocks	OR 1 VM/E 5-1 block + 1 CAL5-11 block
A50 – A75	– 3 0 – 0 0		1 to 6 CA5- 1-pole blocks	OR 1 CA5- 4-pole block + 2 CA5- 1-pole blocks	OR 1 TP - A block + 2 CA5- 1-pole blocks	+ 1 to 2 CAL5-11 blocks	OR 1 VE5-2 block + 1 CAL5-11 block
A45 – A75	– 4 0 – 0 0						
A45, A75	– 2 2 – 0 0 ②					2 CAL18-11 blocks	1 VE5-2 + CAL5-11
A95, A110	– 3 0 – 0 0						
A50 – A75	– 3 0 – 2 2		2 CA5- 1-pole blocks	–	–	+ 1 to 2 CAL5-11 blocks	OR 1 VE5-2 block + 1 CAL5-11 block
A95, A110	– 3 0 – 2 2						
AE50 – AE75	– 3 0 – 0 0		1 to 6 CA5- 1-pole blocks	OR 1 CA5- 4-pole block + 2 CA5- 1-pole blocks	OR 1 TP - A block + 2 CA5- 1-pole blocks	+ 1 CAL5-11 block	OR 1 VE5-2 block
AE45 – AE75	– 4 0 – 0 0						
AE45, AE75	– 2 2 – 0 0 ②					1 CAL5-11 block	
AE95, AE110	– 3 0 – 0 0					1 CAL18-11 block	
A50 – A75	– 3 0 – 1 1		1 to 6 CA5- 1-pole blocks	OR 1 CA5- 4-pole block + 2 CA5- 1-pole blocks	OR 1 TP - A block + 2 CA5- 1-pole blocks	+ 1 CAL18-11 block	OR 1 VE5-2 block
AE50, AE75	– 3 0 – 1 1						
A95, A110	– 3 0 – 1 1						
AE95, AE110	– 3 0 – 1 1						
A145 – AF2050	– 3 0 – 0 0		–	–	–	1 to 2 CAL18-11 blocks + 1 to 2 CAL18-11B blocks	OR 1 CAL18-11 block + 1 CAL18-11B block + VM300H or VM300/460H or VM750H interlock

Contactor mounting configurations (standard from factory)

Auxiliary contacts are mounted on the contactor in the following order:

- Left – 1st
- Right – 2nd
- Top – 3rd (L to R)

① In mounting position 5 (see page 1.36), there should be no more than 2 "N.C." front-mounted auxiliary contacts – The CAL 5-11 side-mounted blocks offer additional "N.C." contacts.

② Whatever the mounting position (see page 1.36), there should be no more than 2 "N.C." front-mounted auxiliary contacts – The CAL 5-11 side-mounted blocks offer additional "N.C." contacts.


Accessories

Terminal markings

CA/CC/CAL/CCL auxiliary contacts


Across the line
1

One pole auxiliary contacts (top mounted)

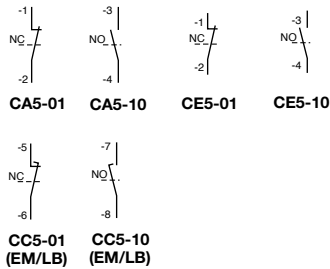


Legend
L.H.S. = Left hand side mounted
R.H.S. = Right hand side mounted
EM/LB = Early make / Late break

Two pole auxiliary contacts

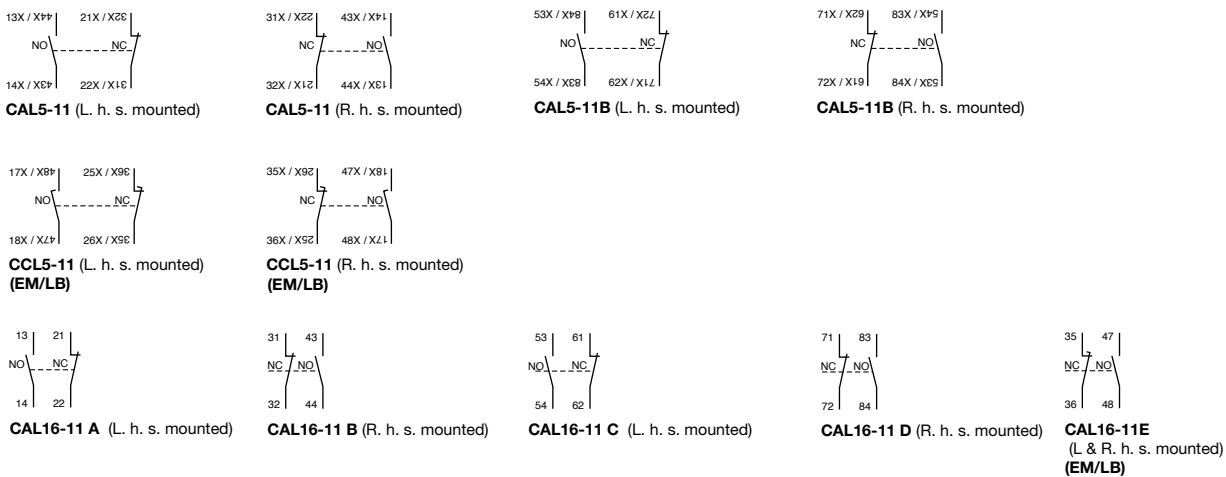


Four pole auxiliary contacts (Top mounted)

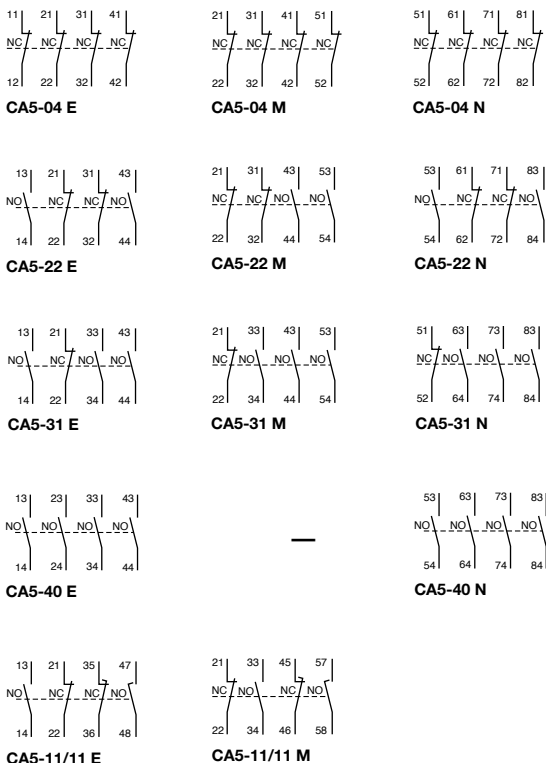


Accessories

Terminal markings & positioning
for A/UA contactors



Standard devices without addition of auxiliary contacts




A9 - A40-30-01








A9 - A40-30-10

A50 - A110-30-00
UA50 - UA110-30-00


A9 - A40-30-01






A9 - A40-30-10

A50 - A110-30-00
UA50 - UA110-30-00A9 - A26-22-00
A45 - A75-22-00A9 ... A26-40-00
A45 ... A75-40-00A9 - A26-22-00
A45 - A75-22-00A9 - A26-40-00
A45 - A75-40-00



Standard 3 pole devices with factory mounted auxiliary contacts




A9 - A16-30-22

Combination
22A9 - A16-30-22
A50 - A110-30-22



A9 - A40-30-32

A50 ... A110-30-11
UA50 ... UA110-30-11



A9 - A40-30-32

A50 - A110-30-11
UA50 - UA110-30-11



Other possible contact combinations with auxiliary contacts added by the user

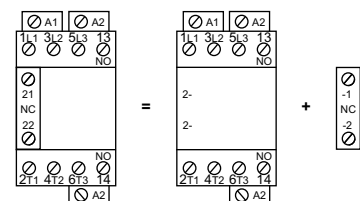Combination
11


A9 - A40-30-10 + CA5-01

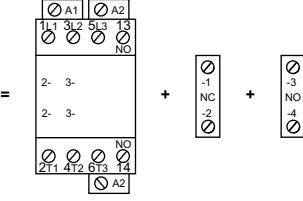Combination
21


A9 - A40-30-10 + CA5-01 + CA5-10

Combination
10


A45 - A75-40-00 + CA5-10




Combination 11



Combination 21



Combination 22



Combination 10









$$\text{A50 - A110-30-22} = \text{A50 - A75-30-11} + \text{CAL5-11}$$

Accessories

Terminal marking and positioning for AE/AL contactors






Across the line
1

AE Contactors – D.C. operated

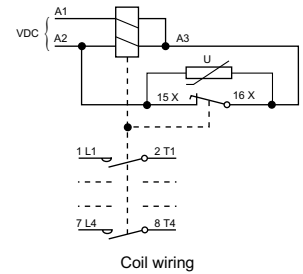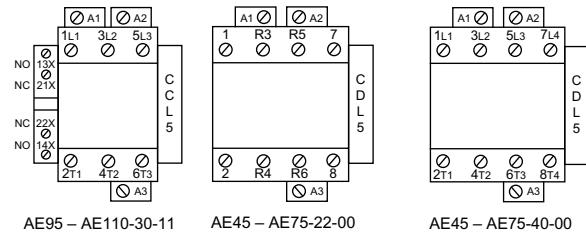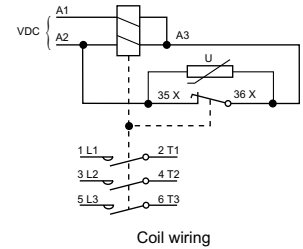
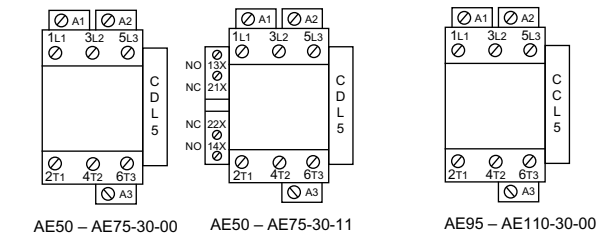


AL Contactors – D.C. operated

Standard devices without addition of auxiliary contacts

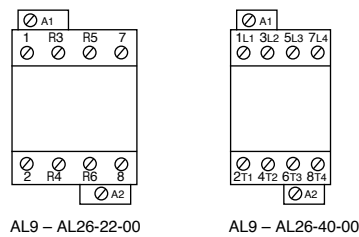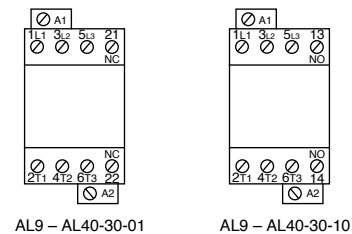

Other possible contact combinations with auxiliary contacts added by the user

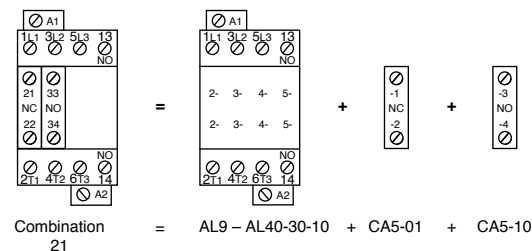


UL & CSA Technical data

A/AE9 – A/AE/AF110, AL9 – AL40

AC & DC operated

ABB contactor frame size		A/AE/AL 9	A/AE/AL 12	A/AE/AL 16	A/AE/AL 26	A/AE/AL 30	A/AE/AL 40	A/AE/AF 45	A/AE/AF 50	A/AE/AF 63	A/AE/AF 75	A/AE/AF 95	A/AE/AF 110
NEMA size		00	—	0	1	1P	—	—	2	—	3	—	—
Number of poles		3 OR 4	3	3 OR 4	3 OR 4	3	3	4	3 OR 4	3	3 OR 4	3	3
AC rating information													
NEMA cont. amp rating	thermal current	9	—	18	27	36	—	—	45	—	90	—	—
NEMA maximum H.P. ratings	1 phase												
115	VAC	1/3	—	1	2	3	—	—	3	—	—	—	—
230	VAC	1	—	2	3	5	—	—	7.5	—	—	—	—
NEMA maximum H.P. ratings	3 phase												
200	VAC	1.5	—	3	7.5	—	—	—	10	—	25	—	—
230	VAC	1.5	—	3	7.5	—	—	—	15	—	30	—	—
460/575	VAC	2	—	5	10	—	—	—	25	—	50	—	—
U.L. general purpose current	40°C	21	25	30	40	50	60	65	80	90	105	125	140
Max. 3 Ph Switching motor loads	A	9	11	17	28	34	42	—	54	65	80	95	110
U.L. maximum H.P. ratings	1 phase												
115	VAC	1/2	3/4	2HP, 24A	2	3	3	—	3	5	7.5	7.5	10
230	VAC	2	2	3	5	7.5	7.5	—	7.5	10	15	20	25
U.L. maximum H.P. ratings	3 phase												
200-208	VAC	2	3	5	7.5	10	10	—	15	20	25	30	30
220-240	VAC	2	3	5	10	10	15	—	20	25	30	30	40
440-480	VAC	5	7.5	10	20	25	30	—	40	50	60	60	75
550-600	VAC	7.5	10	15	25	30	40	—	50	60	75	75	100
U.L. maximum H.P. ratings													
120	VDC	1	1.5	2	3	3	5	—	7.5	10	10	—	—
240	VDC	2	3	3	5	7.5	10	—	15	20	25	—	—
Lighting — ballast and incandescent	600VAC	15	15	20 ①	35	50	60	65	65	85	105	120	—
Resistive heating applications	600VAC	15	15	20	35	50	60	65	65	85	105	—	—
CSA Elevator ratings													
220 – 240VAC	3 phase	—	—	5	—	—	10	—	15	—	20	20	—
440 – 480VAC	3 phase	—	—	10	—	—	20	—	30	—	30	40	—
550 – 600VAC	3 phase	—	—	10	—	—	20	—	30	—	40	50	—
230VAC	1 phase	—	—	2	—	—	5	—	7.5	—	10	10	—
Auxiliary contacts													
NEMA rating	AC	A600	A600	A600	A600	A600	A600	—	A600	A600	A600	A600	A600
AC rated voltage	VAC	600	600	600	600	600	600	—	600	600	600	600	600
AC thermal rated current	A	10	10	10	10	10	10	—	10	10	10	10	10
AC maximum volt-ampere making	VA	7200	7200	7200	7200	7200	7200	—	7200	7200	7200	7200	7200
AC maximum volt-ampere breaking	VA	720	720	720	720	720	720	—	720	720	720	720	720
NEMA rating	DC	P600	P600	P600	P600	P600	P600	—	P600	P600	P600	P600	P600
DC rated voltage	VDC	600	600	600	600	600	600	—	600	600	600	600	600
DC thermal rated current	A	5	5	5	5	5	5	—	5	5	5	5	5
DC Maximum make-break	A	0.2	0.2	0.2	0.2	0.2	0.2	—	0.2	0.2	0.2	0.2	0.2
Approximate weight													
Contactor	lbs.	0.7	0.7	0.7	1.01	1.2	2.25	2.25	2.25	2.25	2.25	3.5	5
Starter	lbs.	1.04	1.04	1.04	1.35	1.54	3	—	3	3	3	6	7
Terminal wire range													
Number of wires per phase	AWG	18-10 2	18-10 2	18-10 2	12-8 2	8-4 2	8-4 2	8-1 1	8-1 1	8-1 1	8-1 1	6-2/0 1	6-2/0 1
Maximum short circuit ratings													
MCCB, MCP, Amps/kA	480VAC	50/35	50/35	50/35	100/35	150/65	150/65	—	150/85	250/85	250/85	250/85	250/85
MCCB, MCP, Amps/kA	600VAC	10/35	10/35	10/35	100/35	150/25	150/25	—	—	—	—	250/35	250/35
Fuse, Amps — type/kA	600VAC	30J/200	30J/200	30J/200	60J/200	60J/200	100J/200	—	100J/200	200J/200	200J/200	200J/200	200J/200

Mounting positions

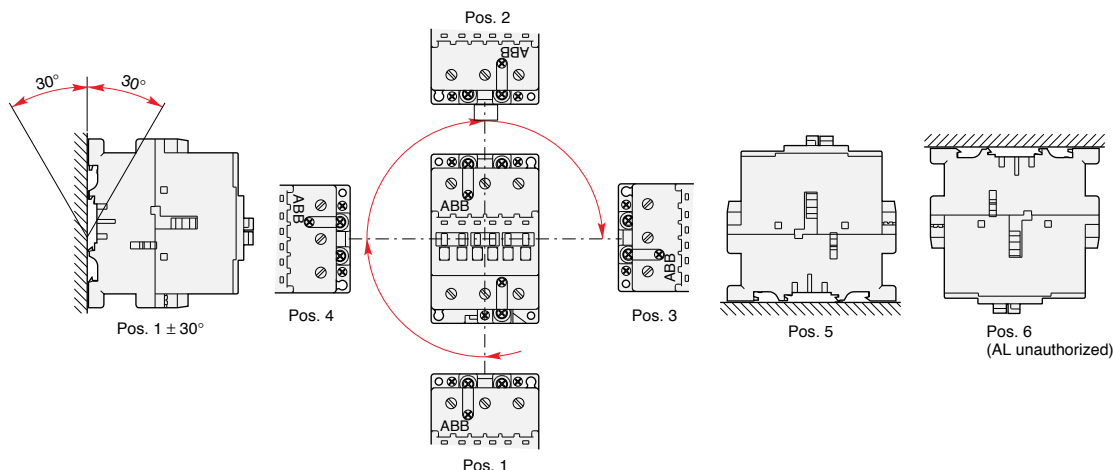

① 30A Ballast

UL & CSA Technical data

A/AF145 – AF750

AC & DC operated

Across the line
contactors

1

ABB contactor frame size		A/AF 145	A/AF 185	A/AF 210	A/AF 260	A/AF 300	AF 400	AF 460	AF 580	AF 750
NEMA size		4	—	—	5	—	—	6	—	7
Number of poles		3	3	3	3	3	3	3	3	3
AC rating information										
NEMA maximum H.P. ratings										
200	3 phase VAC	40	—	—	75	—	—	150	—	—
230	VAC	50	—	—	100	—	—	200	—	300
460/575	V	100	—	—	200	—	—	400	—	600
U.L. general purpose current										
40°C		230	250	300	350	400	550	650	750	900
Max. 3 Ph switching motor loads	Amps	130	156	192	248	302	414	480	590	720
U.L. maximum H.P. ratings										
115	1 phase VAC	10	15	—	—	—	—	—	—	—
230	VAC	25	30	40	50	—	—	—	—	—
U.L. maximum H.P. ratings										
200–208	3 phase VAC	40	50	60	75	100	125	150	200	250
220–240	VAC	50	60	75	100	100	150	200	250	300
440–480	VAC	100	125	150	200	250	350	400	500	600
550–600	VAC	125	150	200	250	300	400	500	600	700
Lighting – ballast and incandescent	600VAC	200	—	300	—	400	—	—	—	—
CSA Elevator ratings										
220 – 240VAC	3 phase			40	50	60	—	—	—	—
240 – 480VAC	3 phase	Consult factory	Consult factory	75	100	125	—	—	—	—
550 - 600VAC	3 phase			100	125	150	—	—	—	—
230VAC	1 phase			—	—	—	—	—	—	—
Auxiliary contacts										
NEMA rating	AC	A600	A600	A600	A600	A600	A600	A600	A600	A600
AC rated voltage	VAC	600	600	600	600	600	600	600	600	600
AC thermal rated current	A	10	10	10	10	10	10	10	10	10
AC maximum volt—ampere making	VA	7200	7200	7200	7200	7200	7200	7200	7200	7200
AC maximum volt—ampere breaking	VA	720	720	720	720	720	720	720	720	720
NEMA rating	DC	P600	P600	P600	P600	P600	P600	P600	P600	P600
DC rated voltage	VDC	600	600	600	600	600	600	600	600	600
DC thermal rated current	A	5	5	5	5	5	5	5	5	5
DC Maximum make—break	A	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Approximate weight										
Contactor	lbs.	7.1	7.1	13	13	13	26	26	33	33
Starter	lbs.	9.11	9.11	17.67	17.67	17.67	35	35	45	45
Terminal wire range										
Number of wires per phase	AWG	6-250MCM 1	6-250MCM 1	4-400MCM 1	4-400MCM 1	4-500MCM 2	250-500MCM 2	250-500MCM 2	2/0-500MCM 2	2/0-500MCM 3
Maximum short circuit ratings										
MCCB,MCP,amps/kA	480VAC	400/85	400/85	800/85	800/85	800/85	800/80	800/80	1200/42	1200/42
MCCB,MCP,amps/kA	600VAC	400/35	400/35	800/35	800/35	800/35	800/42	800/42	—	—
Fuse, amps—Type/kA	600VAC	400J/200	400J/200	600J/200	600J/200	600J/200	1000L/80	1000L/80	1200L/80	1200L/80

UL & CSA Technical data

AF1350 – AF1650

AC & DC operated


ABB contactor frame size		AF 1350	AF 1650
NEMA size		—	8
Number of poles		3	3
AC rating information			
NEMA maximum H.P. ratings	3 phase		
200	VAC	—	—
230	VAC	—	450
460/575	V	—	900
U.L. general purpose current	40°C	1350	1650
Max. 3 Ph switching motor loads	Amps	960	1080
U.L. maximum H.P. ratings	1 phase		
115	VAC	—	—
230	VAC	—	—
U.L. maximum H.P. ratings	3 phase		
200—208	VAC	—	—
220—240	VAC	400	450
440—480	VAC	800	900
550—600	VAC	900	1000
Auxiliary contacts			
NEMA rating	AC	A600	A600
AC rated voltage	VAC	600	600
AC thermal rated current	A	10	10
AC maximum volt—ampere making	VA	7200	7200
AC maximum volt—ampere breaking	VA	720	720
NEMA rating	DC	P600	P600
DC rated voltage	VDC	600	600
DC thermal rated current	A	5	5
DC Maximum make—break	A	0.2	0.2
Approximate weight			
Contactor	lbs.	75	75
Starter	lbs.	—	—
Terminal wire range			
	AWG	1/0-750 MCM	1/0-750 MCM
Number of wires per phase		4	6
Maximum short circuit ratings			
MCCB, MCP, amps/kA	480VAC	2000/42	2000/42
MCCB, MCP, amps/kA	600VAC	—	—
Fuse, amps—Type/kA	600VAC	1600L/82	2000L/82

UL/CSA & IEC Technical data

A/AE9 – A/AE/AF/TAE110

Across the line
contactors

1

Contactor types: A..., AE... AF..., TAE...		9	12	16	26	30	40	45	50	63	75	95	110																		
		–	–	–	–	–	–	45	50	63	75	95	110																		
Rated insulation voltage U _i according to IEC 60947-4-1	V	1000																													
according to UL/CSA	V	600																													
Rated impulse withstand voltage U _{imp.}	kV	8																													
Standards		Devices complying with international standards IEC 60947-1 / 60947-4-1 and European standards EN 60947-1 / 60947-4-1																													
Air temperature close to contactor		see "Conditions for use" page 1.50, for control voltage limits and authorized mounting positions																													
– fitted with thermal O/L relay	°C	-25 to +55																													
– without thermal O/L relay	°C	-40 to +70 (55 max. for TAE... contactors)																													
– for storage	°C	-60 to +80																													
Climatic withstand 68-2-30		acc. to IEC 60068-2-30 and 60068-2-11 - UTE C 63-100 specification II											acc. to IEC																		
Operating altitude	m	≤ 3000																													
Shock withstand acc. IEC 60068-2-27 and EN 60068-2-27		1/2 sinusoidal shock for 11 ms: no change in contact position																													
Mounting position 1 (see page 1.50)		<table><tr><td>Shock direction</td><td>Making position</td><td>Breaking position</td></tr><tr><td>A</td><td>20 g</td><td>20 g</td></tr><tr><td>B1</td><td>10 g</td><td>5 g ①</td></tr><tr><td>B2</td><td>15 g ②</td><td>15 g ②</td></tr><tr><td>C1</td><td>20 g</td><td>20 g</td></tr><tr><td>C2</td><td>20 g</td><td>20 g</td></tr></table>												Shock direction	Making position	Breaking position	A	20 g	20 g	B1	10 g	5 g ①	B2	15 g ②	15 g ②	C1	20 g	20 g	C2	20 g	20 g
Shock direction	Making position	Breaking position																													
A	20 g	20 g																													
B1	10 g	5 g ①																													
B2	15 g ②	15 g ②																													
C1	20 g	20 g																													
C2	20 g	20 g																													
																															
Not valid for DIN-rail mounting																															


① 3 g for AF 45-22, AE 45-22, AF 75-22 and AE 75-22.
② 10 g for AF 45-22, AE 45-22, AF 75-22 and AE 75-22.

UL/CSA & IEC Technical data

A/AF145 – AF1650


A/AF145 – AF750

Contactor types:	A...	145	185	210	260	300	–	–	–	–
	AF...	145	185	210	260	300	400	460	580	750
Rated insulation voltage U_i according to IEC 60947-4-1 according to UL/CSA	V	1000 V600								
Rated impulse withstand voltage U_{imp} . Standards	kV	8 Devices complying with international standards IEC 60947-1 / 60947-4-1 and European standards EN 60947-1 / 60947-4-1								
Air temperature close to contactor – fitted with thermal O/L relay – without thermal O/L relay – for storage	°C °C °C	see "Conditions for use" page 1.51 , for control voltage limits and authorized mounting positions -25 to +55 -40 to +70 -40 to +70								
Climatic withstand		acc. to IEC 60068-2-30								
Operating altitude	m	≤ 3000								
Shock withstand acc. IEC 60068-2-27 and EN 60068-2-27 Mounting position 1 (see page 1.51)		1/2 sinusoidal shock for 30 ms: no change in contact position 5 g in all directions (A, B1, B2, C1, C2)								

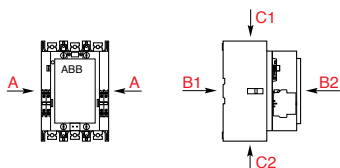

AF1350 – AF1650

Contactor types:	AF...	1350	1650
Rated insulation voltage U_i according to IEC 60947-4-1 according to UL/CSA	V	1000 600	
Rated impulse withstand voltage U_{imp} . Standards	kV	8 Devices complying with international standards IEC 60947-1 / 60947-4-1 and European standards EN 60947-1 / 60947-4-1	
Air temperature close to contactor – fitted with thermal O/L relay – without thermal O/L relay – for storage		see "Conditions for use" page 1.51 , for control voltage limits and authorized mounting positions °C-25 to +55 °C-40 to +70 °C-40 to +70	
Climatic withstand		acc. to IEC 60068-2-30	
Operating altitude	m	≤ 3000	
Shock withstand acc. IEC 60068-2-27 and EN 60068-2-27 Mounting position 1 (See page 1.51)		1/2 sinusoidal shock for 30 ms: no change in contact position 5 g in all directions (A, B1, B2, C1, C2)	

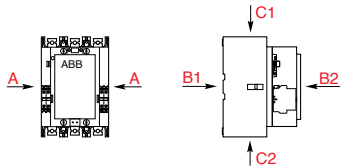

IEC Technical data

A/AE9 – GAE75

DC circuit switching

Across the line
contactors

1

General

The arc switching on d.c. is more difficult than on a.c.

- For selecting a contactor it is essential to determine the current, the voltage and the L/R time constant of the controlled load.
- For information, typical time constant values are quoted hereafter: non-inductive loads such as resistance furnaces ($L/R \approx 1$ ms), inductive loads such as shunt motors ($L/R \approx 2$ ms) or series motors ($L/R \approx 7.5$ ms).
- The addition of a resistor in parallel with an inductive winding helps in the elimination of the arcs.
- All the poles required for breaking must be connected in series between the load and the source polarity not linked to earth (or chassis).

a.c. operated contactors a.c. / d.c. operated (electronic coil interface) d.c. operated contactors		A9 – AE9	A12 – AE12	A16 – AE16	A26 – AE26	A30 – AE30	A40 – AE40	A45 AF45 AE45	A50 AF50 AE50	A63 AF63 AE63	A75 AF75 AE75	GAE75 – GAE75
Utilization category DC-1, $L/R \leq 1$ ms												
	≤ 72 V	A	25	27	30	45	55	60	70	100	110	120
	110 V	A	10	15	20	–	–	–	–	–	–	120
	220 V	A	–	–	–	–	–	–	–	–	–	120
	440 V	A	–	–	–	–	–	–	–	–	–	100
	600 V	A	–	–	–	–	–	–	–	–	–	75
	≤ 72 V	A	25	27	30	45	55	60	70	100	110	120
	110 V	A	25	27	30	45	55	60	70	100	110	120
	220 V	A	10	15	20	–	–	–	–	–	–	–
	≤ 72 V	A	25	27	30	45	55	60	70	100	110	120
	110 V	A	25	27	30	45	55	60	70	100	110	120
	220 V	A	25	27	30	45	55	60	70	100	110	120
	≤ 72 V	A	25	27	30	45	–	–	70	100	–	120
	110 V	A	25	27	30	45	–	–	70	100	–	120
	220 V	A	25	27	30	45	–	–	70	100	–	120
	440 V	A	10	15	20	–	–	–	–	–	–	–
Utilization category DC-3, $L/R \leq 2$ ms												
	≤ 72 V	A	25	27	30	45	55	60	70	100	110	120
	110 V	A	6	7	8	–	–	–	–	–	–	120
	220 V	A	–	–	–	–	–	–	–	–	–	100
	440 V	A	–	–	–	–	–	–	–	–	–	85
	≤ 72 V	A	25	27	30	45	55	60	70	100	110	120
	110 V	A	25	27	30	45	55	60	70	100	110	120
	220 V	A	6	7	8	–	–	–	–	–	–	–
	≤ 72 V	A	25	27	30	45	55	60	70	100	110	120
	110 V	A	25	27	30	45	55	60	70	100	110	120
	220 V	A	25	27	30	45	55	60	70	100	110	120
	≤ 72 V	A	25	27	30	45	–	–	70	100	–	120
	110 V	A	25	27	30	45	–	–	70	100	–	120
	220 V	A	25	27	30	45	–	–	70	100	–	120
	440 V	A	6	7	8	–	–	–	–	–	–	–
Utilization category DC-5, $L/R \leq 7.5$ ms												
	≤ 72 V	A	9	12	16	25	30	40	50	50	63	75
	110 V	A	4	4	4	–	–	–	–	–	–	85
	220 V	A	–	–	–	–	–	–	–	–	–	85
	440 V	A	–	–	–	–	–	–	–	–	–	35
	≤ 72 V	A	25	27	30	45	55	60	70	100	110	120
	110 V	A	10	15	20	30	45	50	70	80	90	100
	220 V	A	4	4	4	–	–	–	–	–	–	–
	≤ 72 V	A	25	27	30	45	55	60	70	100	110	120
	110 V	A	25	27	30	45	55	60	70	100	110	120
	220 V	A	9	12	16	25	30	40	50	50	63	75
	≤ 72 V	A	25	27	30	45	–	–	70	100	–	120
	110 V	A	25	27	30	45	–	–	70	100	–	120
	220 V	A	10	15	20	30	–	–	70	70	–	100
	440 V	A	4	4	4	–	–	–	–	–	–	–

IEC Technical data

A/AF/AE95 – AF750

DC circuit switching

Technical Data

- The tables indicate for the standard contactors the I_g max. operating currents depending on: the utilization category (i.e. L/R) DC-1, DC-3, DC-5 as defined in the IEC 60947-4-1 publication, the operating voltage U_g and the pole coupling details. See page 1.81.
Ampere values quoted in the tables below are valid for a -25 ... +70 °C temperature close to the contactors, as long as the AC-1 Ampere values (see pages 1.45 - 146) for the corresponding ambient temperature are not exceeded.
- Max. switching frequency: 300 ops/h.
- For switching higher d.c. ratings, we recommend the use of bar mounted contactors, R series (63 ... 2000 A).

The selection table for AE 50 ... AE 110 contactors can be used for the TAE 50 ... TAE 110 types.

a.c. operated contactors a.c. / d.c. operated (electronic coil interface) d.c. operated contactors			A95 AF95 AE95	A110 AF110 AE110	A145 AF145 –	A185 AF185 –	A210 AF210 –	A260 AF260 –	A300 AF300 –	– AF400 –	– AF460 –	– AF580 –	– AF750 –
Utilization category DC-1, L/R ≤ 1 ms													
	≤110 V	A	–	–	–	–	–	–	–	600	700	800	1050
	≤110 V	A	145	160	250	275	350	400	450	600	700	800	1050
	220 V	A	–	–	–	–	–	–	–	600	700	800	1050
	≤110 V	A	145	160	250	275	350	400	450	600	700	800	1050
	220 V	A	145	160	250	275	350	400	450	600	700	800	1050
	440 V	A	–	–	–	–	–	–	–	600	700	800	1050
	600 V	A	–	–	–	–	–	–	–	600	700	800	1050
	600 V	A	–	–	–	–	–	–	–	600	700	800	1050
Utilization category DC-3, L/R ≤ 2.5 ms													
	≤110 V	A	–	–	–	–	–	–	–	600	700	800	1050
	≤110 V	A	145	160	250	275	350	400	450	600	700	800	1050
	220 V	A	–	–	–	–	–	–	–	600	700	800	1050
	≤110 V	A	145	160	250	275	350	400	450	600	700	800	1050
	220 V	A	145	160	250	275	350	400	450	600	700	800	1050
	440 V	A	–	–	–	–	–	–	–	600	700	800	1050
	600 V	A	–	–	–	–	–	–	–	600	700	800	1050
	600 V	A	–	–	–	–	–	–	–	600	700	800	1050
Utilization category DC-5, L/R ≤ 15 ms													
	≤110 V	A	–	–	–	–	–	–	–	600	700	800	1050
	≤110 V	A	145	160	250	275	350	400	450	600	700	800	1050
	220 V	A	–	–	–	–	–	–	–	600	700	800	1050
	≤110 V	A	145	160	250	275	350	400	450	600	700	800	1050
	220 V	A	145	160	250	275	350	400	450	600	700	800	1050
	440 V	A	–	–	–	–	–	–	–	600	700	800	1050
	600 V	A	–	–	–	–	–	–	–	600	700	800	1050
	600 V	A	–	–	–	–	–	–	–	600	700	800	1050

IEC Technical data

AL9 – AL40

DC circuit switching



Across the line
contactors

1

General

The arc switching on d.c. is more difficult than on a.c.

- For selecting a contactor it is essential to determine the current, the voltage and the L/R time constant of the controlled load.
- For information, typical time constant values are quoted hereafter: non inductive loads such as resistance furnaces ($L/R \approx 1$ ms), inductive loads such as shunt motors ($L/R \approx 2$ ms) or series motors ($L/R \approx 7.5$ ms).
- The addition of a resistor in parallel with an inductive winding helps in the elimination of the arcs.
- All the poles required for breaking must be connected in series between the load and the source polarity not linked to earth (or chassis).

A.C. operated contactors			AL9	AL12	AL16	AL26	AL30	AL40
Utilization category DC-1, $L/R \leq 1$ ms								
	≤ 72 V	A	25	27	30	45	55	60
	110 V	A	10	15	20	–	–	–
	220 V	A	–	–	–	–	–	–
	440 V	A	–	–	–	–	–	–
	600 V	A	–	–	–	–	–	–
	≤ 72 V	A	25	27	30	45	55	60
	110 V	A	25	27	30	45	55	60
	220 V	A	10	15	20	–	–	–
	≤ 72 V	A	25	27	30	45	55	60
	110 V	A	25	27	30	45	55	60
	220 V	A	25	27	30	45	55	60
	≤ 72 V	A	25	27	30	45	–	–
	110 V	A	25	27	30	45	–	–
	220 V	A	25	27	30	45	–	–
	440 V	A	10	15	20	–	–	–
Utilization category DC-3, $L/R \leq 2$ ms								
	≤ 72 V	A	25	27	30	45	55	60
	110 V	A	6	7	8	–	–	–
	220 V	A	–	–	–	–	–	–
	440 V	A	–	–	–	–	–	–
	≤ 72 V	A	25	27	30	45	55	60
	110 V	A	25	27	30	45	55	60
	220 V	A	6	7	8	–	–	–
	≤ 72 V	A	25	27	30	45	55	60
	110 V	A	25	27	30	45	55	60
	220 V	A	25	27	30	45	55	60
	≤ 72 V	A	25	27	30	45	–	–
	110 V	A	25	27	30	45	–	–
	220 V	A	25	27	30	45	–	–
	440 V	A	6	7	8	–	–	–
Utilization category DC-5, $L/R \leq 7.5$ ms								
	≤ 72 V	A	9	12	16	25	30	40
	110 V	A	4	4	4	–	–	–
	220 V	A	–	–	–	–	–	–
	440 V	A	–	–	–	–	–	–
	≤ 72 V	A	25	27	30	45	55	60
	110 V	A	10	15	20	30	45	50
	220 V	A	4	4	4	–	–	–
	≤ 72 V	A	25	27	30	45	55	60
	110 V	A	25	27	30	45	55	60
	220 V	A	9	12	16	25	30	40
	≤ 72 V	A	25	27	30	45	–	–
	110 V	A	25	27	30	45	–	–
	220 V	A	10	15	20	30	–	–
	440 V	A	4	4	4	–	–	–

IEC Technical data

EK110 – EK1000

DC circuit switching

General

The arc switching on d.c. is more difficult than on a.c.

- For selecting a contactor it is essential to determine the current, the voltage and the L/R time constant of the controlled load.
- For information, typical time constant values are quoted hereafter: non inductive loads such as resistance furnaces ($L/R \leq 1$ ms), inductive loads such as shunt motors ($L/R \leq 2$ ms) or series motors ($L/R \leq 7.5$ ms).
- The addition of a resistor in parallel with an inductive winding helps in the elimination of the arcs.
- All the poles required for breaking must be connected in series between the load and the source polarity not linked to earth (or chassis).

Technical Data

- The tables indicate for the standard contactors the I_e max. operating currents depending on: the utilization category (i.e. L/R) DC-1, DC-3, DC-5 as defined in the IEC 60947-4-1 publication (see page 1.75 for more details), the operating voltage U_e and the pole coupling details. Ampere values quoted in the tables below are valid for a $-25 \dots +70$ °C temperature close to the contactors, as long as the AC-1 Ampere values (see page 1.61) for the corresponding ambient temperature are not exceeded.
- Max. switching frequency: 300 ops/h.
- For switching higher d.c. ratings, we recommend the use of bar mounted contactors, R series (63 ... 2000 A).

Selection Table

a.c. / d.c. operated contactors

Utilization category DC-1, $L/R \leq 1$ ms

			EK110	EK150	EK175	EK210	EK370	EK550	EK1000
	≤ 72 V	A	120	145	210	210	370	550	–
	110 V	A	120	145	210	210	370	550	–
	≤ 72 V	A	200	200	300	300	550	800	–
	110 V	A	200	200	300	300	550	800	–
	220 V	A	200	200	300	300	550	800	–
	≤ 72 V	A	200	200	300	300	550	800	–
	110 V	A	200	200	300	300	550	800	–
	220 V	A	200	200	300	300	550	800	–
	440 V	A	–	–	210	210	450	650	–
	600 V	A	–	–	–	–	450	650	–
	≤ 72 V	A	200	200	300	300	550	800	–
	110 V	A	200	200	300	300	550	800	–
	220 V	A	200	200	300	300	550	800	–
	440 V	A	200	200	260	300	450	650	–
	600 V	A	–	–	260	300	450	650	–

Utilization category DC-3, $L/R \leq 2$ ms

	≤ 72 V	A	120	145	210	210	370	550	–
	≤ 72 V	A	135	145	210	210	450	650	–
	110 V	A	135	135	210	210	450	650	–
	220 V	A	135	135	210	210	450	650	–
	≤ 72 V	A	135	145	210	210	450	650	–
	110 V	A	135	135	210	210	450	650	–
	220 V	A	135	135	210	210	450	650	–
	440 V	A	–	–	210	210	450	650	–
	600 V	A	–	–	–	–	450	650	–
	≤ 72 V	A	135	145	210	210	450	650	–
	110 V	A	135	135	210	210	450	650	–
	220 V	A	135	135	210	210	450	650	–
	440 V	A	135	135	210	210	450	650	–
	600 V	A	–	–	170	210	450	650	–

Utilization category DC-5, $L/R \leq 7.5$ ms

	≤ 72 V	A	135	145	210	210	450	650	–
	110 V	A	135	135	210	210	450	650	–
	220 V	A	135	135	210	210	450	650	–
	≤ 72 V	A	135	145	210	210	450	650	–
	110 V	A	135	135	210	210	450	650	–
	220 V	A	135	135	210	210	450	650	–
	440 V	A	–	–	210	210	450	650	–
	600 V	A	–	–	–	–	450	650	–
	≤ 72 V	A	135	145	210	210	450	650	–
	110 V	A	135	135	210	210	450	650	–
	220 V	A	135	135	210	210	450	650	–
	440 V	A	135	135	210	210	450	650	–
	600 V	A	–	–	170	210	450	650	–

IEC Technical data

A/AE9 – A/AE/AF/TAE110

Across the line
contactors

1

Main Pole - Utilization Characteristics

Contactor types:		A..., AE...	9	12	16	26	30	40	45	50	63	75	95	110	
		AF..., TAE...	–	–	–	–	–	–	45	50	63	75	95	110	
Rated operational voltage U _e max.	V		690						1000 (690 for AF... contactors)						
Rated frequency limits	Hz		25-400												
Conventional free-air thermal current I _{th} acc. to IEC 60947-4-1, open contactors $\sigma \leq 40\text{ }^{\circ}\text{C}$			A	26	28	30	45	65	65	100	100	125	125	145	160
with conductor cross-sectional area	mm ²	4	4	4	6	16	16	35	35	50	50	50	70		
Rated operational current I _e / AC-1 for air temperature close to contactor															
U _e max. 690 V	$\left\{ \begin{array}{l} \sigma \leq 40\text{ }^{\circ}\text{C} \\ \sigma \leq 55\text{ }^{\circ}\text{C} \\ \sigma \leq 70\text{ }^{\circ}\text{C} \text{ ③} \end{array} \right.$	A	25	27	30	45	55	60	70	100	115	125	145	160	
		A	22	25	27	40	55	60	60	85	95	105	135	145	
		A	18	20	23	32	39	42	50	70	80	85	115	130	
with conductor cross-sectional area	mm ²	2.5	4	4	6	10	16	25	35	50	50	50	70		
Utilization categorie AC-3															
for air temperature close to contactor $\leq 55\text{ }^{\circ}\text{C}$															
Rated operational current I _e AC-3 ①															
3-phase motors 	220-230-240 V	V	A	9	12	17	26	33	40	40	53	65	75	96	110
	380-400 V	V	A	9	12	17	26	32	37	37	50	65	75	96	110
	415 V	V	A	9	12	17	26	32	37	37	50	65	72	96	110
	440 V	V	A	9	12	16	26	32	37	37	45	65	70	93	100
	500 V	V	A	9	12	14	22	28	33	33	45	55	65	80	100
	690 V	V	A	7	9	10	17	21	25	25	35	43	46	65	82
	1000 V	V	A	–	–	–	–	–	–	–	23 ②	25 ②	28 ②	30 ②	30 ②
Rated operational power AC-3 ①															
1500 r.p.m. 50 Hz 1800 r.p.m. 60 Hz 3-phase motors 	220-230-240 V	kW	2.2	3	4	6.5	9	11	11	15	18.5	22	25	30	
	380-400 V	kW	4	5.5	7.5	11	15	18.5	18.5	22	30	37	45	55	
	415 V	kW	4	5.5	9	11	15	18.5	18.5	25	37	40	55	59	
	440 V	kW	4	5.5	9	15	18.5	22	22	25	37	40	55	59	
	500 V	kW	5.5	7.5	9	15	18.5	22	22	30	37	45	55	59	
	690 V	kW	5.5	7.5	9	15	18.5	22	22	30	37	40	55	75	
	1000 V	kW	–	–	–	–	–	–	–	30 ②	33 ②	37 ②	40 ②	40 ②	
Rated making capacity AC-3 according to IEC 60947-4-1				10 x I _e AC-3											
Rated breaking capacity AC-3 according to IEC 60947-4-1				8 x I _e AC-3											
Short-circuit protection for contactors without thermal O/L relay - Motor protection excluded															
U _e ≤ 500 V a.c. - gG type fuse	A	25	32	32	50	63		80	100	125	160	160	200		
Rated short-time withstand current I _{cw} at 40 °C ambient temp., in free air, from a cold state															
1 s	A	250	280	300	400	600		1000					1320	1320	
10 s	A	100	120	140	210	400		650					800	800	
30 s	A	60	70	80	110	225		370					500	500	
1 min	A	50	55	60	90	150		250					350	350	
15 min	A	26	28	30	45	65		110	110	135	135		160	175	
Maximum breaking capacity cos $\phi = 0.45$ (cos $\phi = 0.35$ for I _e > 100 A)															
at 440 V	A	250			420	820		900	1300				1160		
at 690 V	A	90			170	340		490	630				800		
Heat dissipation per pole	I _e / AC-1	W	0.8	1	1.2	1.8	2.5	3	2.5	5	6.5	7	6.5	7.5	
	I _e / AC-3	W	0.1	0.2	0.35	0.6	0.9	1.3	0.65	1.3	1.5	2	2.7	3.6	
Max. electrical switching frequency															
– for AC-1	cycles/h	600							600 (300 for AF..., AE... TAE...)				300		
– for AC-3	cycles/h	1200 (600 for AE...)							600 (300 for AF..., AE... TAE...)				300		
– for AC-2, AC-4	cycles/h	300							150				150		
Electrical durability			see pages 1.70 - 1.73												
Mechanical durability															
– millions of operating cycles			10 (5 for AE... and TAE... contactors)												
– max. mechanical switching frequency	cycles/h		3600 (300 for AF... contactors)												

① For the corresponding hp/A values of 1500 r.p.m., 50Hz, 3-phase motors, see page 1.76.

② AF... contactors excluded

③ Unauthorized for TAE... contactors.

IEC Technical data

A/AF145 – AF750

Main Pole - Utilization Characteristics


Contactor types:	A...	145	185	210	260	300	–	–	–	–	
	AF...	145	185	210	260	300	400	460	580	750	
Rated operational voltage U _e max.	V	690									
Rated frequency limits	Hz	25 ... 400									
Conventional free-air thermal current I _{th} acc. to IEC 60947-4-1, open contactors ϕ ≤ 40 °C											
	A	250	275	350	400	500	600	700	800	1050	
with conductor cross-sectional area ①	mm ²	120	150	185	240	300 ③	2 x 185	2 x 240	2 x 240	2 x 80 x 5 ②	
Rated operational current I _e / AC-1 for air temperature close to contactor											
U _e max. 690 V	{ ϕ ≤ 40 °C ϕ ≤ 55 °C ϕ ≤ 70 °C	A	250	275	350	400	500	600	700	800	1050
		A	230	250	300	350	400	500	600	700	800
		A	180	180	240	290	325	400	480	580	720
with conductor cross-sectional area	mm ²	120	150	185	240	300 ③	2 x 185	2 x 240	2 x 240	2 x 80 x 5 ②	

Utilization categorie AC-3

for air temperature close to contactor $\leq 55^\circ\text{C}$ Rated operational current I_e AC-3

	220-230-240 V	A	145	185	210	260	305	400	460	580	750
	380-400 V	A	145	185	210	260	305	400	460	580	750
	415 V	A	145	185	210	260	300	400	460	580	750
	440 V	A	145	185	210	240	280	400	460	580	750
	500 V	A	145	170	210	240	280	400	460	580	750
	690 V	A	120	170	210	220	280	350	400	500	650
	1000 V	A	–	–	–	–	–	–	–	–	–

Rated operational power AC-3

	220-230-240 V	kW	45	55	59	80	90	110	132	160	220
	380-400 V	kW	75	90	110	140	160	200	250	315	400
	415 V	kW	75	90	110	140	160	220	250	355	425
	440 V	kW	75	90	110	140	160	220	250	355	450
	500 V	kW	90	110	132	180	200	250	315	400	520
	690 V	kW	110	132	160	200	250	315	355	500	600
	1000 V	kW	–	–	–	–	–	–	–	–	–

Rated making capacity AC-3

according to IEC 60947-4-1 10 x I_e AC-3

Rated breaking capacity AC-3

according to IEC 60947-4-1 8 x I_e AC-3

Short-circuit protection for contactors

without thermal O/L relay - Motor protection excluded

 $U_e \leq 500$ V a.c. - gG type fuseRated short-time withstand current I_{cw} at 40°C ambient temp., in free air,

from a cold state

1 s	A	1800	2000	2500	3500	4600	7000
10 s	A	1200	1500	1700	2400	4400	6400
30 s	A	800	1000	1200	1500	3100	4500
1 min	A	600	800	1000	1100	2500	3500
15 min	A	280	320	400	500	840	1300

Maximum breaking capacity

 $\cos \varphi = 0.45$ ($\cos \varphi = 0.35$ for $I_e > 100$ A)

at 440 V	A	1500	2000	2300	2600	3000	4000	5000	6000	7500
at 690 V	A	1200	1600	2000	2400	2500	3500	4500	5000	7000

Heat dissipation per pole

I_e / AC-1	W	13	16	18	25	32	30	42	32	50
I_e / AC-3	W	5	8	9	14	18	16	21	17	28

Max. electrical switching frequency

– for AC-1	cycles/h	300	300	300	300
– for AC-3	cycles/h	300	300	300	300
– for AC-2, AC-4	cycles/h	150	150	60	60

Electrical durability

see pages 1.65 ... 1.69

Mechanical durability

– millions of operating cycles	5	3
– max. mechanical switching frequency	cycles/h	3600 (300 for AF... contactors)

① Conductors with preparation.

② Dimensions of the bars (in mm).

③ For currents above 450A, use terminal extension / enlargement pieces LX 300 / LW 300 see page 1.31).

IEC Technical data

AF1350 – AF1650

Across the line
contactors

1

Main Pole - Utilization Characteristics

Contactor types: AF...		1350	1650
Rated operational voltage U_e max.	V	1000	1000
Rated frequency limits	Hz	25-400	25-400
Conventional free-air thermal current I_{th} acc. to IEC 60947-4-1, open contactors $\theta \leq 40^\circ\text{C}$ with conductor cross-sectional area ^①	A mm ²	1350 2/100x5	1650 3/100x5
Rated operational current I_e / AC-1 for air temperature close to contactor			
U_e max. 690 V	$\theta \leq 40^\circ\text{C}$ A	1350	1650
	$\theta \leq 55^\circ\text{C}$ A	1150	1450
	$\theta \leq 70^\circ\text{C}$ A	1000	1270
with conductor cross-sectional area	mm ²	2 x 80 x 5 ^①	2 x 80 x 5 ^①
Utilization categorie AC-3 for air temperature close to contactor $\leq 55^\circ\text{C}$			
Rated operational current I_e AC-3			
3-phase motors			
220-230-240 V		A	860
380-400 V		A	860
415 V		A	860
440 V		A	860
500 V		A	—
690 V		A	—
1000 V		A	—
			
Rated operational power AC-3			
220-230-240 V		kW	257
380-400 V		kW	475
415 V		kW	500
440 V		kW	560
500 V		kW	—
690 V		kW	—
1000 V		kW	—
			
1500 r.p.m. 50 Hz			
1800 r.p.m. 60 Hz			
3-phase motors			
Rated making capacity AC-3 according to IEC 60947-4-1		10 x I_e , AC-3	
Rated breaking capacity AC-3 according to IEC 60947-4-1		8 x I_e , AC-3	
Short-circuit protection for contactors without thermal O/L relay - Motor protection excluded $U_e \leq 500$ V a.c. - gG type fuse		Product coordination with ABB circuit breaker Consult factory	
Rated short-time withstand current I_{cw} at 40°C ambient temp., in free air, from a cold state			
1 s		A	10,000
10 s		A	8000
30 s		A	6000
1 min		A	4500
15 min		A	1600
Maximum breaking capacity $\cos \phi = 0.45$ ($\cos \phi = 0.35$ for $I_e > 100$ A)			
at 440 V		A	10,000
at 690 V		A	—
Max. electrical switching frequency			
– for AC-1		cycles/h	60
– for AC-3		cycles/h	60
– for AC-2, AC-4		cycles/h	
Electrical durability			50,000
Mechanical durability			
– millions of operating cycles			500,000
– max. mechanical switching frequency		cycles/h	60

① Dimensions of the bars (in mm).

IEC Technical data

A/AF9 – AF110

Magnet System Characteristics for A... Contactors

Contactor types: A...			9	12	16	26	30	40	45	50	63	75	95	110
Rated control circuit voltage U _c														
– at 50 Hz		V	20 ... 690											
– at 60 Hz		V	24 ... 600											
Coil operating limits			ø ≤ 55 °C										ø ≤ 70 °C	
according to IEC 60947-4-1			0.85 ... 1.1 x U _c										0.85 ... 1.1 x U _c	
Drop-out voltage in % of U _c			roughly 40 ... 65 %											
Coil consumption														
Average pull-in value	50 Hz	VA	70					120					350	
	60 Hz	VA	80					140					450	
	50/60 Hz ①	VA/VA	74/70					125/120					410/365	
Average holding value	50 Hz	VA/W	8/2					12/3					22/6.5	
	60 Hz	VA/W	8/2					12/3					26/8	
	50/60 Hz ①	VA/W	8/2					12/3					27/7.5	
Operating time														
between coil energization and:														
– N.O. contact closing		ms	10 ... 26				8 ... 21		8 ... 27				10 ... 25	
– N.C. contact opening		ms	7 ... 21				6 ... 18		7 ... 22				7 ... 22	
between coil de-energization and:														
– N.O. contact opening		ms	4 ... 11				4 ... 11		4 ... 11				7 ... 15	
– N.C. contact closing		ms	9 ... 16				7 ... 14		7 ... 14				10 ... 18	

Magnet System Characteristics for AF... Contactors

Contactor types: AF...			-	-	-	-	-	-	45	50	63	75	95	110
Rated control circuit voltage U _c														
- at 50 Hz		V							48 ... 250		48 ... 250			
- at 60 Hz		V							48 ... 250		48 ... 250			
- d.c.		V							20 ... 250		20 ... 250			
Coil operating limits according to IEC 60947-4-1									θ ≤ 70 °C 0.85 ... 1.1 x U _c					
Drop-out voltage in % of U _c									55 %					
Coil consumption														
Average pull-in value		50 Hz	VA						210		350			
		60 Hz	VA						210		350			
		d.c.	W						190		400			
Average holding value		50 Hz	VA/W						7/2.8		7/3.5			
		60 Hz	VA/W						7/2.8		7/3.5			
		d.c.	W						2.8		2			
Operating time														
between coil energization and:														
- N.O. contact closing		ms						30 ... 100		30 ... 80				
- N.C. contact opening		ms						27 ... 95		27 ... 77				
between coil de-energization and:														
- N.O. contact opening		ms						30 ... 110		55 ... 125				
- N.C. contact closing		ms						35 ... 115		60 ... 130				

① 50/60 Hz coils: voltage codes 8 0 to 8 8. see page 1.28.

IEC Technical data

A145 – AF750

Across the line
contactors

1

Magnet System Characteristics for A... Contactors

Contactor types: A...			145	185	210	260	300	-	-	-	-
Rated control circuit voltage U _c											
- at 50 Hz		V	24 ... 690								
- at 60 Hz		V	24 ... 690								
Coil operating limits according to IEC 60947-4-1			σ ≤ 70 °C 0.85 ... 1.1 x U _c								
Drop-out voltage in % of U _c			roughly 25 ... 65 %								
Coil consumption											
Average pull-in value	50 Hz	VA	550		1350						
	60 Hz	VA	600		1550						
	50/60 Hz ①	VA/VA	700/650		1700/1550						
Average holding value	50 Hz	VA/W	35/11		60/16						
	60 Hz	VA/W	40/12		65/19						
	50/60 Hz ①	VA/W	44/13		80/21						
Operating time											
between coil energization and:											
- N.O. contact closing		ms	13 ... 27		17 ... 35						
- N.C. contact opening		ms	8 ... 22		12 ... 30						
between coil de-energization and											
- N.O. contact opening		ms	5 ... 10		7 ... 13						
- N.C. contact closing		ms	9 ... 13		10 ... 16						

Magnet System Characteristics for AF... Contactors

Contactor types: AF...			145	185	210	260	300	400	460	580	750	
Rated control circuit voltage U _c												
– at 50 Hz	V		48 ... 250									
– at 60 Hz	V		48 ... 250									
– d.c.	V		24 ... 250									
Coil operating limits according to IEC 60947-4-1			ø ≤ 70 °C 0.85 ... 1.1 x U _c									
Drop-out voltage in % of U _c			55 %									
Coil consumption												
Average pull-in value	50 Hz	VA	430			470			890			850
	60 Hz	VA	430			470			890			850
	d.c.	W	500			520			990			950
Average holding value	50 Hz	VA/W	12/3.5			10/2.5			12/4			12/4.5
	60 Hz	VA/W	12/3.5			10/2.5			12/4			12/4.5
	d.c.	W	2			2			4			4.5
Operating time												
between coil energization and:												
– N.O. contact closing	ms		30 ... 115						50 ... 120			
– N.C. contact opening	ms		30 ... 115						50 ... 120			
between coil de-energization and												
– N.O. contact opening	ms		25 ... 80						40 ... 70			
– N.C. contact closing	ms		25 ... 80						40 ... 70			

① 50/60 Hz coils: voltage codes 8 0 to 8 8. see page 1.28.

IEC Technical data

AF1350 – AF1650

Magnet System Characteristics for AF... Contactors

Contactor types: AF...			1350	1650
Rated control circuit voltage U_c				
– at 50 Hz	V		100 - 250	
– at 60 Hz	V		100 - 250	
– d.c.	V		100 - 250	
Coil operating limits according to IEC 60947-4-1			$\varnothing \leq 70\text{ °C}$ $0.85 \dots 1.1 \times U_c$	
Drop-out voltage in % of U_c			55 %	
Coil consumption				
Average pull-in value	50 Hz	VA	1900	
	60 Hz	VA	1900	
	d.c.	W	1700	
Average holding value	50 Hz	VA/W	48/17	
	60 Hz	VA/W	48/17	
	d.c.	W	16	
Operating time				
between coil energization and:				
– N.O. contact closing	ms		50 - 80	
– N.C. contact opening			ms	50 - 80
between coil de-energization and				
– N.O. contact opening			ms	35 - 55
– N.C. contact closing	ms		35 - 55	
With PLC				
between coil energization and				
– N.O. contact opening			ms	40 - 65
– N.C. contact closing	ms		40 - 65	
between coil de-energization and				
– N.O. contact opening			ms	10 - 30
– N.C. contact closing	ms		10 - 30	

① 50/60 Hz coils: voltage codes 8 0 to 8 8. see page 1.28.

IEC Technical data

AE9 — AE110

TAE45 — TAE110

Across the line
contactors

1

Magnet System Characteristics for AE... Contactors

Contactor types:	AE...		9	12	16	26	30	40	45	50	63	75	95	110
Rated control circuit voltage U _c	V d.c.		12 ... 250											
Coil operating limits according to IEC 60947-4-1			ø ≤ 55 °C 0.85 ... 1.1 x U _c										ø ≤ 70 °C	
Drop-out voltage in % of U _c			roughly 10 ... 30 %						roughly 15 ... 40 %					
Coil consumption - Average values														
– pull-in value	W		90			110			200				400	
– holding value	W		2			2.5			4				2.4	
Coil time constant														
– open	L/R	ms	2			3			3				6	
– closed	L/R	ms	9			16			15				30 ... 40	
Operating time														
between coil energization and:														
– N.O. contact closing	ms		10 ... 16			13 ... 21			13 ... 30				15 ... 25	
– N.C. contact opening	ms		8 ... 12			11 ... 16			10 ... 27				12 ... 22	
between coil de-energization and														
– N.O. contact opening	ms		5 ... 14 ①			6 ... 12 ①			5 ... 15 ①				15 ... 20 ①	
– N.C. contact closing	ms		11 ... 17 ①			8 ... 16 ①			8 ... 18 ①				18 ... 23 ①	

Magnet System Characteristics for TAE... Contactors

Contactor types:	TAE...	-	-	-	-	-	-	45	50	-	75	95	110
Rated control circuit voltage U_c	V d.c.	17 ... 264											
Coil operating limits according to IEC 60947-4-1		$\varnothing \leq 55^\circ\text{C}$ U_c min. ... U_c max.											
Drop-out voltage in % of U_c max.		roughly 20 ... 35 %											
Coil consumption values for U_c min. ... U_c max.													
- pull-in value	W							120 ... 250				300 ... 1000	
- holding value	W							1.7 ... 6.5				2 ... 7	
Coil time constant													
- open	L/R	ms						3				6	
- closed	L/R	ms						15				40	
Operating time between coil energization and:													
- N.O. contact closing	ms							13 ... 30				15 ... 25	
- N.C. contact opening	ms							10 ... 27				12 ... 22	
Operating time between coil de-energization and:													
- N.O. contact opening	ms							5 ... 15 ②				15 ... 20 ②	
- N.C. contact closing	ms							8 ... 18 ②				18 ... 23 ②	

① The use of surge suppressors increases the opening time on a scale of 1.1 to 1.5 for a varistor suppressor and on a scale of 4 to 8 for a diode suppressor.
AE 9 ... AE 40 contactors and $U_c \geq 110$ V: table values for contactors with RV 5 surge suppressor (factory mounted).

② The use of surge suppressors increases the opening time on a scale of 1.1 to 1.5 for a varistor suppressor and on a scale of 4 to 8 for a diode suppressor.

IEC Technical data

A9 – A110

Built-in Auxiliary Contacts - Utilization Characteristics

Contactor types: A...		9	12	16	26	30	40	45	50	63	75	95	110
Rated operational voltage U_e max.	V	690						-	-	-	-	-	-
Conventional free air thermal current I_{th} - $\theta \leq 40$ °C	A	16						-	-	-	-	-	-
Rated frequency limits	Hz	25 ... 400					-	-	-	-	-	-	-
Rated operational current I_e / AC-15 according to IEC 60947-5-1													
24-127 V 50/60 Hz	A	6						-	-	-	-	-	-
220-240 V 50/60 Hz	A	4						-	-	-	-	-	-
380-440 V 50/60 Hz	A	3						-	-	-	-	-	-
500 V 50/60 Hz	A	2						-	-	-	-	-	-
690 V 50/60 Hz	A	2						-	-	-	-	-	-
Rated operational current I_e / DC-13 according to IEC 60947-5-1													
24 V d.c.	A / W	6 / 144						-	-	-	-	-	-
48 V d.c.	A / W	2.8 / 134						-	-	-	-	-	-
72 V d.c.	A / W	2 / 144						-	-	-	-	-	-
125 V d.c.	A / W	1.1 / 138						-	-	-	-	-	-
250 V d.c.	A / W	0.55 / 138					-	-	-	-	-	-	-
Rated making capacity acc. to IEC 60947-5-1		10 x I_e / AC-15						-	-	-	-	-	-
Rated breaking capacity acc. to IEC 60947-5-1		10 x I_e / AC-15						-	-	-	-	-	-
Short-circuit protection gG type fuse	A	10						-	-	-	-	-	-
Rated short-time withstand current I_{cw} for 1.0 s	A	100						-	-	-	-	-	-
for 0.1 s	A	140						-	-	-	-	-	-
Minimum switching capacity	V / mA	17 / 5						-	-	-	-	-	-
Non-overlapping time between N.O. and N.C. contacts	ms	≥ 2						-	-	-	-	-	-
Insulating resistance at 500 V d.c. after durability test	MOhm	5						-	-	-	-	-	-
Heat dissipation per pole at 6 A	W	0.10						-	-	-	-	-	-

IEC Technical data

A/AE9 – AF/TAE110

Across the line
contactors

1

Mounting characteristics

Contactor types:	A..., AE...	9	12	16	26	30	40	45	50	63	75	95	110
	AF..., TAE...	–	–	–	–	–	–	45	50	63	75	95	110
Mounting positions	see "Conditions for use"												
Mounting distances	The contactors can be assembled side by side												
Mounting													
on DIN rail		35 x 7.5 mm						35 x 15 mm					
according to IEC 715 and EN 50022 / EN 50023		35 x 15 mm						75 x 25 mm			75 x 25 mm		
by screws (not supplied)		2 x M4						2 x M6					

Conditions for Use

Sustainable utilization conditions for contactors involving at the same time the Mounting position, Ambient temperature and Control voltage operating limits are summarized in the table below.

Contactors	Mounting position	Ambient temperature	Control voltage
A 9 ... A 110, AE 9 ... AE 110	1, 1 ± 30°, 2, 3, 4, 5	≤ 55 °C	0.85 ... 1.1 x U _c
		55 ... 70 °C	U _c
	6	≤ 55 °C	0.95 ... 1.1 x U _c
AF 45 ... AF 110		> 55 °C unauthorized	–
	1, 1 ± 30°, 2, 3, 4, 5	≤ 70 °C	0.85 U _c min. ... 1.1 x U _c max.
	6 unauthorized	–	–
TAE 45 ... TAE 110		≤ 55 °C	U _c min. ... U _c max.
	1, 1 ± 30°, 2, 3, 4, 5	> 55 °C unauthorized	–
	6 unauthorized	–	–

Notes for 4-pole contactors

Whatever the coil voltage: Pos. 5 unauthorized for A 45-22-00, AE 45-22-00, A 75-22-00, AE 75-22-00 contactors.

For 60 Hz coil voltage: (only for devices fitted with CA 5-.. and CAL 5-11 auxiliary contacts or TP timer)

– A 45-40-00, A 50-40-00 and A 75-40-00 contactors


Mounting positions 1 to 5 and ambient temperature ≤ 55 °C: tolerance reduced to 0.9 ... 1.1 U_c (instead of 0.85 ... 1.1 U_c) for coil voltage codes 7 □ and 8 □.

– A 45-22-00 and A 75-22-00 contactors

Mounting positions 1 to 4 (pos. 5 unauthorized) and ambient temperature ≤ 55 °C: tolerance reduced to 0.9 ... 1.1 U_c (instead of 0.85 ... 1.1 U_c) for coil voltage codes 7 □ and 8 □.

For mounting position 6 or ambient temperature of 55 to 70 °C the information given on this page remains applicable.

Mounting Positions (see the above table for authorized positions)

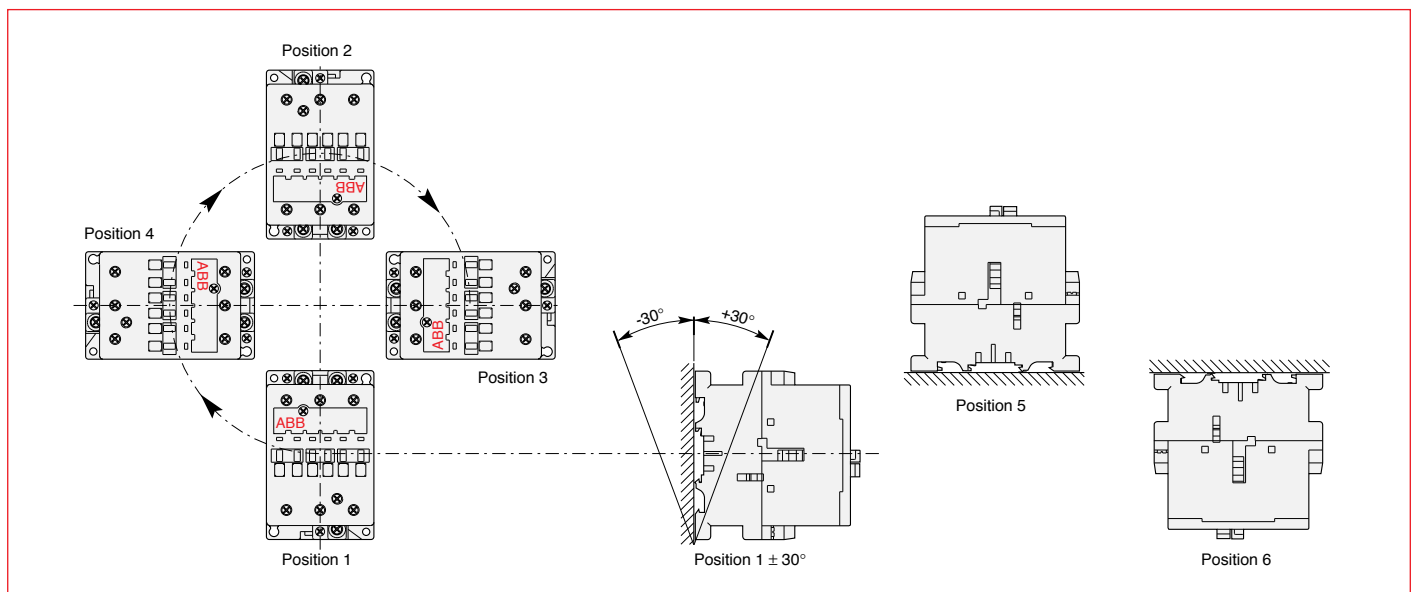

IEC Technical data

A/AF145 – AF1650

Mounting Characteristics – A/AF145 – AF750

Contactor types:	A...	145	185	210	260	300	–	–	–	–
	AF...	145	185	210	260	300	400	460	580	750
Mounting positions	see "Condition for use"									
Mounting distances	The contactors can be assembled side by side									
Fixing										
on DIN rail	–									
according to IEC 715 and EN 50022 / EN 50023										
by screws (not supplied)	4 x M5					4 x M6				

Mounting Characteristics – AF1350 – AF1650


Contactor types:	AF	1350	1650
Mounting positions	see "Condition for use"		
Mounting distances	The contactors can be assembled side by side		
Fixing			
on DIN rail	–	–	
according to IEC 715 and EN 50022 / EN 50023			
by screws (not supplied)	4 x M8		

Conditions for Use

Sustainable utilization conditions for contactors involving at the same time the Mounting position, Ambient temperature and Control voltage operating limits are summarized in the table below.

Contactors	Mounting position	Ambient temperature	Control voltage
A 145 ... A 300	1, 1 ± 30°, 2, 3, 4, 5	≤ 70 °C	0.85 ... 1.1 x U _c
	6 unauthorized	–	–
AF 145 ... AF 750	1, 1 ± 30°, 2, 3, 4, 5	≤ 70 °C	0.85 x U _c min. ... 1.1 x U _c max.
	6 unauthorized	–	–

Mounting Positions (see the above table for authorized positions)

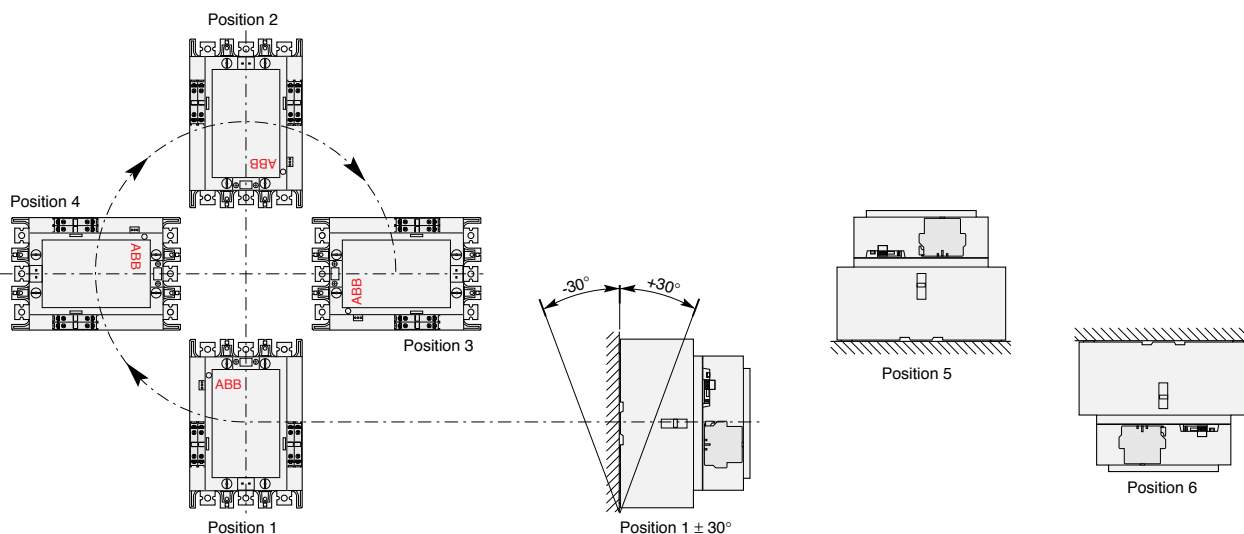

IEC Technical data

A/AE9 – AF/TAE110



Across the line
contactors

1

Connecting Characteristics

Contactor types:	A..., AE...	9	12	16	26	30	40	45	50	63	75	95	110
	AF..., TAE...	–	–	–	–	–	–	45	50	63	75	95	110

Main terminals

			
with cable clamp	with double connector 2 x (5.6 x 6.5 mm)	with single connector (13 x 10 mm)	with single connector (14 x 14 mm)

Connecting capacity (min. ... max.)

Main conductors (poles)

Rigid: solid ($\leq 4 \text{ mm}^2$)		1 ... 4	1.5 ... 6	2.5 ... 16	6 ... 50	10 ... 95
stranded ($\geq 6 \text{ mm}^2$)		1 ... 4	1.5 ... 6	2.5 ... 16	6 ... 16	6 ... 35
Rigid with connector single for Cu cable		–	–	–	–	–
single for Al/Cu cable		–	–	–	–	–
double for Al/Cu cable		–	–	–	–	–
Flexible with cable end		0.75 ... 2.5	0.75 ... 4	2.5 ... 10	6 ... 35	10 ... 70
		0.75 ... 2.5	0.75 ... 4	2.5 ... 10	6 ... 25	6 ... 35
Bars or lugs		8	10	–	–	30 ②
		3.7	4.2	–	–	6

Auxiliary conductors

(built-in auxiliary terminals + coil terminals)

Rigid solid		1 ... 4	0.75 ... 2.5
		1 ... 4	0.75 ... 2.5
Flexible with cable end		0.75 ... 2.5	1 ... 2.5
		0.75 ... 2.5	0.75 ... 2.5
Lugs		8	① 8
		3.7	① 3.7

Degree of protection acc. to IEC 60947-1 / EN 60947-1 and IEC 60529 / EN 60529

– Main terminals	IP 20	IP 10
– Coil terminals	IP 20	
– Built-in auxiliary terminals	IP 20	– – – – –

Screw terminals

Main terminals	(delivered in open position, screws of unused terminals must be tightened) (+, -) pozidriv 2 screws M3.5	M4	M5	M6	hexagon socket M8 (s = 4 mm)
Coil terminals	M3.5 (+, -) pozidriv 2 screws with cable clamp				
Built-in auxiliary terminals	(+, -) pozidriv 2 screws with cable clamp M3.5	M4	M5	– – – – –	– –

Tightening torque

Main pole terminals					
– recommended	Nm / lb.in	1.00 / 9	1.7 / 15	2.30 / 20	4.00 / 35
– max.	Nm	1.20	2.20	2.60	4.50
Coil terminals					
– recommended	Nm / lb.in	1.00 / 9			
– max.	Nm	1.20			
Built-in auxiliary terminals					
– recommended	Nm / lb.in	1.00 / 9	1.7 / 15	1.00 / 9	– – – – –
– max.	Nm	1.20	2.20	1.20	– – – – –

Terminal marking and positioning

see pages 1.34

① $L \leq 8$ and $l > 3.7$ for coil terminal - $L \leq 10$ and $l > 4.2$ for built-in auxiliary terminals.
② With LW 110 enlargement piece. See page 1.31.


IEC Technical data

A/AF145 – AF750

Connecting Characteristics

Contactor types:	A...	145	185	210	260	300	–	–	–	–
	AF...	145	185	210	260	300	400	460	580	750

Main terminals
Flat type

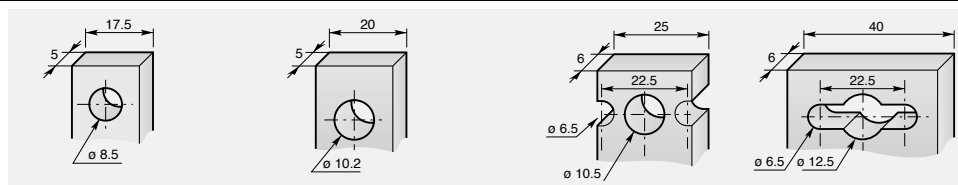

Connecting capacity (min. ... max.)

Main conductors (poles)

Rigid:		1 x mm ²	–	–	–	–	–	–	–	–
		2 x mm ²	–	–	–	–	–	–	–	–
Rigid with connector										
single for Cu cable		mm ²	6 ... 185		16 ... 240		240		300	
single for Al/Cu cable		mm ²	25 ... 150		120 ... 240		240		300	
double for Al/Cu cable		mm ²	–		2 x 95 ... 120		2 x 240		3 x 185	
Flexible		1 x mm ²	–	–	–	–	–	–	–	–
		2 x mm ²	–	–	–	–	–	–	–	–
Bars or lugs		L mm ≤ Ø mm >	24 8		32 10		47 / 45 10		52 / 50 12	

Auxiliary conductors
(coil terminals)

Rigid solid		1 x mm ²	1 ... 4							
		2 x mm ²	1 ... 4							
Flexible with cable end		1 x mm ²	0.75 ... 2.5							
		2 x mm ²	0.75 ... 2.5							
Lugs		L mm ≤ l mm >	8 3.7							

Degree of protection acc. to IEC 60947-1 /
EN 60947-1 and IEC 60529 / EN 60529

- Main terminals
- Coil terminals
- Built-in auxiliary terminals

Protection against direct contact acc. to VDE 0106 - part 100

IP 00
IP 20
–

Screw terminals

Main terminals		Screws and bolts								
		M8	M10		M10		M12			
Coil terminals (delivered in open position)		M3.5 (+,-) pozidriv 2 screws with cable clamp								
Built-in auxiliary terminals		–	–	–	–	–	–	–	–	–

Tightening torque

Main pole terminals										
– recommended	Nm / lb.in	18 / 160	28 / 240		40 / 354		45 / 443			
– max.	Nm	20	30		44		49			
Coil terminals										
– recommended	Nm / lb.in	1.00 / 9								
– max.	Nm	1.20								
Built-in auxiliary terminals										
– recommended	Nm / lb.in	–	–	–	–	–	–	–	–	–
	– max.	Nm	–	–	–	–	–	–	–	–

Terminal marking and positioning

see pages 1.36 & 1.37

IEC Technical data

AF1350 – AF1650

Across the line
contactors

1


Connecting Characteristics

Contactor types:	AF...	1350	1650
Main terminals Flat type			
Connecting capacity (min. ... max.) Main conductors (poles)			
Rigid:	 1 x mm ²	–	–
	 2 x mm ²	–	–
Rigid with connector			
single for Cu cable	 mm ²	–	–
single for Al/Cu cable	 mm ²	–	–
double for Al/Cu cable	 mm ²	–	–
Flexible	 1 x mm ²	–	–
	 2 x mm ²	–	–
Bars or lugs	 L mm ≤ Ø mm >	100 12	100 12
Auxiliary conductors (coil terminals)			
Rigid solid	 1 x mm ²	1...4	1...4
	 2 x mm ²	1...4	1...4
Flexible with cable end	 1 x mm ²	0.75...2.5	0.75...2.5
	 2 x mm ²	0.75...2.5	0.75...2.5
Lugs	 L mm ≤ l mm >	8 3.7	8 3.7
Degree of protection acc. to IEC 60947-1 / EN 60947-1 and IEC 60529 / EN 60529			
– Main terminals		IP 00	IP 00
– Coil terminals		IP 20	IP 20
– Built-in auxiliary terminals			
Screw terminals		Screw and bolts	
Main terminals		M12	
Coil terminals (delivered in open position)		M3.5 (+,-) pozidriv 2 screws with cable clamp	
Built-in auxiliary terminals		–	–
Tightening torque			
Main pole terminals			
– recommended	Nm / lb.in	45/443	45/443
– max.	Nm	49	49
Coil terminals			
– recommended	Nm / lb.in	1.00 / 9	1.00 / 9
– max.	Nm	1.20	1.20
Built-in auxiliary terminals			
– recommended	Nm / lb.in	–	–
– max.	Nm	–	–

UL/CSA & IEC Technical data

AL9 – AL40

Contactor types:	AL	AL9	AL12	AL16	AL26	AL30	AL40
Rated insulation voltage U_i according to IEC 60947-4-1	V				1000		
according to UL/CSA	V				600		
Rated impulse withstand voltage U_{imp}	kV				8		
Standards		Devices complying with international standards IEC 60947-1 / 60947-4-1 and European standards EN 60947-1 / 60947-4-1					
Air temperature close to contactor – fitted with thermal O/L relay	°C	see "Conditions for use" page 1.50, for control voltage limits and authorized mounting positions					
– without thermal O/L relay	°C	-25 to +55					
– for storage	°C	-40 to +70 (55 max. for TAE... contactors)					
Climatic withstand		acc. to IEC 60068-2-30 and 60068-2-11 - UTE C 63-100 specification II					
Operating altitude	m	≤ 3000					
Shock withstand acc. IEC 60068-2-27 and EN 60068-2-27 Mounting position 1 (see page 1.50)		1/2 sinusoidal shock for 11 ms: no change in contact position Shock direction Making position Breaking position A 20 g 20 g B1 10 g 5 g B2 15 g 15 g C1 20 g 20 g C2 20 g 20 g					



IEC Technical data

AL9 – AL40

Across the line
contactors

1

Main Pole - Utilization Characteristics

Contactor types:	AL	AL9	AL12	AL16	AL26	AL30	AL40
Rated operational voltage U_e max.	V	690					
Rated frequency limits	Hz	25-400					
Conventional free-air thermal current I_{th} acc. to IEC 60947-4-1, open contactors $\varnothing \leq 40\text{ }^{\circ}\text{C}$	A	26	28	30	45	65	65
with conductor cross-sectional area mm^2	4	4	4	6	16	16	35
Rated operational current I_e / AC-1 for air temperature close to contactor							
U_e max. 690 V	$\varnothing \leq 40\text{ }^{\circ}\text{C}$	25	27	30	45	55	60
	$\varnothing \leq 55\text{ }^{\circ}\text{C}$	22	25	27	40	55	60
	$\varnothing \leq 70\text{ }^{\circ}\text{C}$ ③	18	20	23	32	39	42
with conductor cross-sectional area mm^2		2.5	4	4	6	10	16
Utilization categorie AC-3							
for air temperature close to contactor $\leq 55\text{ }^{\circ}\text{C}$							
Rated operational current I_e AC-3 ①							
220-230-240 V	V A	9	12	17	26	33	40
3-phase motors 380-400 V	V A	9	12	17	26	32	37
415 V	V A	9	12	17	26	32	37
440 V	V A	9	12	16	26	32	37
500 V	V A	9	12	14	22	28	33
690 V	V A	7	9	10	17	21	25
1000 V	V A	–	–	–	–	–	–
Rated operational power AC-3 ①							
220-230-240 V	kW	2.2	3	4	6.5	9	11
380-400 V	kW	4	5.5	7.5	11	15	18.5
415 V	kW	4	5.5	9	11	15	18.5
440 V	kW	4	5.5	9	15	18.5	22
500 V	kW	5.5	7.5	9	15	18.5	22
690 V	kW	5.5	7.5	9	15	18.5	22
1000 V	kW	–	–	–	–	–	–
Rated making capacity AC-3							
according to IEC 60947-4-1		$10 \times I_e$ AC-3					
Rated breaking capacity AC-3							
according to IEC 60947-4-1		$8 \times I_e$ AC-3					
Short-circuit protection for contactors without thermal O/L relay - Motor protection excluded							
$U_e \leq 500$ V a.c. - gG type fuse	A	25	32	32	50	63	
Rated short-time withstand current I_{cw} at $40\text{ }^{\circ}\text{C}$ ambient temp., in free air, from a cold state							
1 s	A	250	280	300	400	600	
10 s	A	100	120	140	210	400	
30 s	A	60	70	80	110	225	
1 min	A	50	55	60	90	150	
15 min	A	26	28	30	45	65	
Maximum breaking capacity							
$\cos \varnothing = 0.45$ ($\cos \varnothing = 0.35$ for $I_e > 100$ A)							
at 440 V	A	250	–	–	420	820	
at 690 V	A	90	–	–	170	340	
Heat dissipation per pole							
I_e / AC-1	W	0.8	1	1.2	1.8	2.5	
I_e / AC-3	W	0.1	0.2	0.35	0.6	0.9	
Max. electrical switching frequency							
– for AC-1	cycles/h	600					
– for AC-3	cycles/h	1200					
– for AC-2, AC-4	cycles/h	300					
Mechanical durability							
– millions of operating cycles		10					
– max. mechanical switching frequency	cycles/h	3600					



IEC Technical data

AL9 – AL40, TAL9 - TAL40

Magnet system characteristics for AL contactors

Contactor types:	AL	AL9	AL12	16	26	30	40
Rated control circuit voltage U_c	V d.c.	12 ... 240 (24V & 48V for AL...Z)					
Coil operating limits according to IEC 60947-4-1		$\vartheta \leq 55^\circ\text{C}$ $0.85 \dots 1.1 \times U_c$					
Drop-out voltage in % of U_c		roughly 15 ... 30 %					
Coil consumption - Average values							
– pull-in value	W	3 (2.4 for AL9Z - AL16Z)			3.5		
– holding value	W	3 (2.4 for AL9Z - AL16Z)			3.5		
Coil time constant							
– open	L/R	ms	40				
– closed	L/R	ms	90				
Operating time between coil energization and:							
– N.O. contact closing		ms	50 ... 75				
– N.C. contact opening		ms	45 ... 70				
between coil de-energization and							
– N.O. contact opening		ms	15 ... 30				
– N.C. contact closing		ms	17 ... 32				

Magnet System Characteristics for TAL... Contactors

Contactor types:	TAL	TAL9	TAL12	TAL16	TAL26	TAL30	TAL40
Rated control circuit voltage U_c	V d.c.	9 ... 264					
Coil operating limits according to IEC 60947-4-1		$\vartheta \leq 55^\circ\text{C}$ $0.85 \dots 1.1 \times U_c$					
Drop-out voltage in % of U_c max.		roughly 20... 35 %					
Coil consumption values for U_c max. and 20°C							
– U_c max. DC	W	8.5			9		
– U_c min. DC	W	2.5			2.7		
– U_c DC	W	5			5.4		
Operating time between coil energization and:							
– N.O. contact closing	ms	50 ... 100			55 ... 110		
– N.C. contact opening	ms	20 ... 70			25 ... 75		
between coil de-energization and							
– N.O. contact opening	ms	10 ... 17 ①			12 ... 18 ①		
– N.C. contact closing	ms	16 ... 27 ①			18 ... 28 ①		

① The use of surge suppressors increases the opening time on a scale of 1.1 to 1.5 for a varistor suppressor and on a scale of 4 to 8 for a diode suppressor.

IEC Technical data

AL9 – AL40

Across the line
contactors

1

Built-in Auxiliary Contacts - Utilization Characteristics

Contactor types: AL			AL9	AL12	AL16	AL26	AL30	AL40
Rated operational voltage U_e max.	V		690					
Conventional free air thermal current I_{th} - $\theta \leq 40$ °C	A		16					
Rated frequency limits	Hz		25 ... 400					
Rated operational current I_e / AC-15 according to IEC 60947-5-1								
24-127 V 50/60 Hz	A		6					
220-240 V 50/60 Hz	A		4					
380-440 V 50/60 Hz	A		3					
500 V 50/60 Hz	A		2					
690 V 50/60 Hz	A		2					
Rated operational current I_e / DC-13 according to IEC 60947-5-1								
24 V d.c.	A / W		6 / 144					
48 V d.c.	A / W		2.8 / 134					
72 V d.c.	A / W		2 / 144					
125 V d.c.	A / W		1.1 / 138					
250 V d.c.	A / W		0.55 / 138					
Rated making capacity acc. to IEC 60947-5-1			10 x I_e / AC-15					
Rated breaking capacity acc. to IEC 60947-5-1			10 x I_e / AC-15					
Short-circuit protection gG type fuse	A		10					
Rated short-time withstand current I_{cw}								
for 1.0 s	A		100					
for 0.1 s	A		140					
Minimum switching capacity	V / mA		17 / 5					
Non-overlapping time between N.O. and N.C. contacts	ms		≥ 2					
Insulating resistance at 500 V d.c. after durability test	MOhm		5					
Heat dissipation per pole at 6 A	W		0.10					

IEC Technical data

AL9 – AL40

Mounting characteristics


Contactor types:	AL	AL9	AL12	AL16	AL26	AL30	AL40
Mounting positions	see "Conditions for use"						
Mounting distances	The contactors can be assembled side by side						
Mounting							
on DIN rail	35 x 7.5 mm						
according to IEC 715 and EN 50022 / EN 50023	35 x 15 mm						
by screws (not supplied)	2 x M4						

Conditions for Use

Sustainable utilization conditions for contactors involving at the same time the Mounting position, Ambient temperature and Control voltage operating limits are summarized in the table below.

Contactors	Mounting position	Ambient temperature	Control voltage
AL9 – AL40	1, 1 ± 30°, 2, 3, 4, 5	≤ 55 °C	0.85 ... 1.1 x U _c
	55 ... 70 °C	U _c	
	6 (Unauthorized)		

Mounting Positions (see the above table for authorized positions)

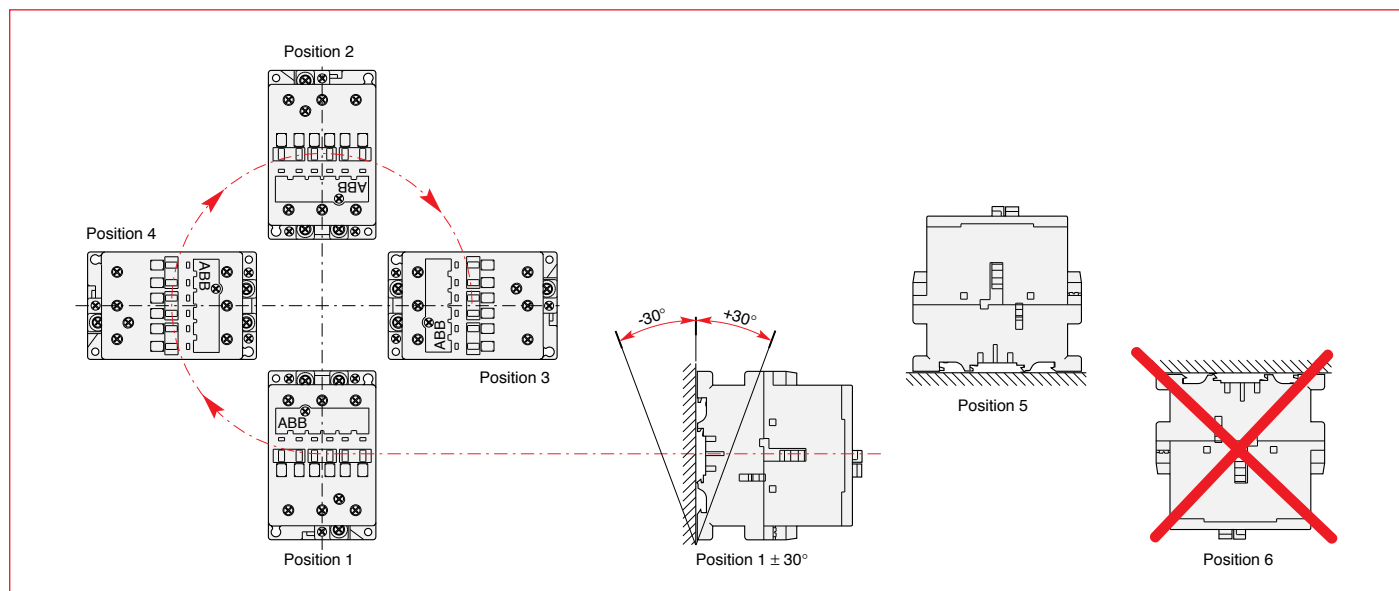

IEC Technical data

AL9 – AL40


Across the line
contactors

1


Connecting Characteristics

Contactor types: **AL** **AL9** **AL12** **AL16** **AL26** **AL30** **AL40**

Main terminals



with cable clamp



with double
connector

2 x (5.6 x 6.5 mm)

Connecting capacity (min. ... max.)

Main conductors (poles)

Rigid: solid ($\leq 4 \text{ mm}^2$)		1 x mm ²	1 ... 4			1.5 ... 6	2.5 ... 16
		2 x mm ²	1 ... 4			1.5 ... 6	2.5 ... 16
Rigid with connector		mm ²	–	–	–	–	–
single for Cu cable		mm ²	–	–	–	–	–
single for Al/Cu cable		mm ²	–	–	–	–	–
double for Al/Cu cable		mm ²	–	–	–	–	–
Flexible with cable end		1 x mm ²	0.75 ... 2.5			0.75 ... 4	2.5 ... 10
		2 x mm ²	0.75 ... 2.5			0.75 ... 4	2.5 ... 10
Bars or lugs		L mm $\leq$	8			10	–
		l mm $>$	3.7			4.2	–

Auxiliary conductors

(built-in auxiliary terminals + coil terminals)

Rigid solid		1 x mm ²	1 ... 4				
		2 x mm ²	1 ... 4				
Flexible with cable end		1 x mm ²	0.75 ... 2.5				
		2 x mm ²	0.75 ... 2.5				
Lugs		L mm $\leq$	8		①	8	
		l mm $>$	3.7		①	3.7	

Degree of protection acc. to IEC 60947-1 / EN 60947-1 and IEC 60529 / EN 60529

Protection against direct contact acc. to VDE 0106 - Part. 100

– Main terminals
– Coil terminals
– Built-in auxiliary terminals

IP 20
IP 20
IP 20

Screw terminals

(delivered in open position, screws of unused terminals must be tightened)

Main terminals		(+,-) pozidriv 2 screws M3.5	M4	M5
Coil terminals		M3.5 (+,-) pozidriv 2 screws with cable clamp		
Built-in auxiliary terminals		(+,-) pozidriv 2 screws with cable clamp M3.5	M4	M5

Tightening torque

Main pole terminals				
– recommended	Nm / lb.in	1.00 / 9	1.7 / 15	2.30 / 20
– max.	Nm	1.20	2.20	2.60
Coil terminals				
– recommended	Nm / lb.in	1.00 / 9		
– max.	Nm	1.20		
Built-in auxiliary terminals				
– recommended	Nm / lb.in	1.00 / 9	1.7 / 15	1.00 / 9
– max.	Nm	1.20	2.20	1.20


Terminal marking and positioning see pages 1.35

① L $\leq$ 8 and l $>$ 3.7 for coil terminal - L $\leq$ 10 and l $>$ 4.2 for built-in auxiliary terminals.
② With LW 110 enlargement piece. See page 1.31.

IEC Technical data

EK110 – EK1000

General Technical Data

Contactor types: EK...		110	150	175	210	370	550	1000
Rated insulation voltage U_i according to IEC 60947-4-1	V	1000						
according to UL/CSA	V	600						
Rated impulse withstand voltage U_{imp}	kV	8						
Standards		Devices complying with international standards IEC 60947-1 / 60947-4-1 and European standards EN 60947-1 / 60947-4-1						
Air temperature close to contactor – fitted with thermal O/L relay	°C	see "Conditions for use" page 1.63, for control voltage limits and authorized mounting positions						
– without thermal O/L relay	°C	-25 to +55						
– for storage	°C	-40 to +70						
Climatic withstand		acc. to IEC 60068-2-30						
Operating altitude	m	≤ 3000						
Shock withstand acc. IEC 60068-2-27 and EN 60068-2-27								
Mounting position 1 (see page 1.63)		1/2 sinusoidal shock for 15 ms: no change in contact position						
	Contactor in making or breaking position							
	Shock direction: A, C1, C2: 10 g							
	B1: 10 g							
	B2: 10 g							

IEC Technical data

EK110 – EK1000

Across the line
contactors

1

Main Pole - Utilization Characteristics

Contactor types:	EK...	110	150	175	210	370	550	1000
Rated operational voltage U_o max.	V	1000						690
Rated frequency limits	Hz	25 ... 400						
Conventional free-air thermal current I_{th} acc. to IEC 60947-4-1, open contactors $\theta \leq 40^\circ\text{C}$	A	200	250	300	350	550	800	1000
with conductor cross-sectional area	mm ²	95	150	185	240	2 x 185	2 x 240	2 x 300
Rated operational current I_o / AC-1 for air temperature close to contactor								
U_o max. 690 V								
$\theta \leq 40^\circ\text{C}$	A	200	250	300	350	550	800	1000
$\theta \leq 55^\circ\text{C}$	A	180	230	270	310	470	650	800
$\theta \leq 70^\circ\text{C}$	A	155	200	215	250	400	575	720
with conductor cross-sectional area	mm ²	95	150	185	240	2 x 185	2 x 240	2 x 300

Utilization categorie AC-3

for air temperature close to contactor $\leq 55^\circ\text{C}$

Rated operational current I_o AC-3

220-230-240 V	A	120	145	210	400	550	–
380-400 V	A	120	145	210	400	550	–
415 V	A	120	145	210	400	550	–
440 V	A	120	145	210	370	550	–
500 V	A	120	145	210	370	550	–
690 V	A	120	120	210	370	550	–
1000 V	A	64	80	113	155	175	–



Rated operational power AC-3

1500 r.p.m. 50 Hz	220-230-240 V	kW	30	45	59	110	160	–
1800 r.p.m. 60 Hz	380-400 V	kW	55	75	110	200	280	–
3-phase motors	415 V	kW	55	75	110	220	315	–
	440 V	kW	59	75	110	220	315	–
	500 V	kW	75	90	132	250	400	–
	690 V	kW	110	110	160	355	500	–
	1000 V	kW	90	110	160	220	250	–



Rated making capacity AC-3

according to IEC 60947-4-1	$10 \times I_o$ AC-3	–
----------------------------	----------------------	---

Rated breaking capacity AC-3

according to IEC 60947-4-1	$8 \times I_o$ AC-3	–
----------------------------	---------------------	---

Short-circuit protection for contactors

without thermal O/L relay - Motor protection excluded

$U_o \leq 500$ V a.c. - gG type fuse	A	250	355	630	800	1000
--------------------------------------	---	-----	-----	-----	-----	------

Rated short-time withstand current I_{cw}

at 40 °C ambient temp., in free air,						
from a cold state						
1 s	A	1700	1800	2300	5500	6800
10 s	A	900	1200	1680	5300	6400
30 s	A	600	700	1000	3700	4400
1 min	A	450	550	800	3000	3400
15 min	A	210	250	320	1000	1200

Maximum breaking capacity

$\cos \phi = 0.45$ ($\cos \phi = 0.35$ for $I_o > 100$ A)							
at 440 V	A	1400	1500	2000	5000	5400	–
at 690 V	A	1100	1200	1700	5000	5400	–

Heat dissipation per pole	I_o / AC-1	W	10	13	18	40	60	80
	I_o / AC-3	W	3	5	9	15	25	–

Max. electrical switching frequency

– for AC-1	cycles/h	300						300
– for AC-3	cycles/h	300						–
– for AC-2, AC-4	cycles/h	150		120				–

Electrical durability see pages 1.75

Mechanical durability

– millions of operating cycles		10				5		
– max. mechanical switching frequency	cycles/h	3600				3600		

IEC Technical data

EK110 – EK1000

Magnet System Characteristics for EK... Contactors - a.c. Operated

Contactor types:	EK...	110	150	175	210	370	550	1000
Rated control circuit voltage U_c								
– at 50 Hz	V	24 ... 500				48 ... 500		
– at 60 Hz	V	24 ... 600				110 ... 600		
Coil operating limits according to IEC 60947-4-1		$\vartheta \leq 70^\circ\text{C}$ 0.85 ... 1.1 x U_c						
Drop-out voltage in % of U_c		roughly 45 ... 65 %						
Coil consumption								
Average pull-in value	50 Hz① VA	800		1100		3500		
	60 Hz① VA	900		1200		4000		
	50/60 Hz② VA/VA	500/500		630/630		3800/3400		
Average holding value	50 Hz① VA/W	44/15		52/18		125/50		
	60 Hz① VA/W	52/18		65/22		140/60		
	50/60 Hz② VA/W	2.5/2.5		2.5/2.5		140/60		
Operating time								
between coil energization and:								
– N.O. contact closing	ms	20 ... 40① / 30 ... 50②				30 ... 60		
– N.C. contact opening	ms	15 ... 35① / 25 ... 45②				25 ... 55		
between coil de-energization and:								
– N.O. contact opening	ms	7.5 ... 15① / 95 ... 120②				10 ... 20		
– N.C. contact closing	ms	10 ... 18① / 100 ... 125②				13 ... 23		

Magnet System Characteristics for EK... Contactors - d.c. Operated

Contactor types:	EK...	110	150	175	210	370	550	1000
Rated control circuit voltage U_c	V d.c.	12 ... 220				24 ... 220		
Coil operating limits according to IEC 60947-4-1		$\vartheta \leq 70^\circ\text{C}$ 0.85 ... 1.1 x U_c						
Drop-out voltage in % of U_c		roughly 15 ... 50 %						
Coil consumption - Average values								
– pull-in value	W	500		630		1100		
– holding value	W	2.5		2.5		20		
Coil time constant								
– open L/R	ms	8				12		
– closed L/R	ms	50				60		
Operating time								
between coil energization and:								
– N.O. contact closing	ms	30 ... 50				60 ... 80		
– N.C. contact opening	ms	27 ... 47				55 ... 75		
between coil de-energization and:								
– N.O. contact opening	ms	10 ... 35						
– N.C. contact closing	ms	13 ... 38						

① "A" coil voltage codes see page 1.29.

② 50/60 Hz "E" coil voltage codes see page 1.29.

IEC Technical data

EK110 – EK1000

Across the line
contactors

1

Mounting Characteristics


Contactor types:	EK...	110	150	175	210	370	550	1000
Mounting positions	see "Conditions for use"							
Fixing by screws (supplied)		4 x M6			4 x M6 (1)			

Conditions for Use

Sustainable utilization conditions for contactors involving at the same time the Mounting position, Ambient temperature and Control voltage operating limits are summarized in the table below.

Contactors	Mounting position	Ambient temperature	Control voltage
E110 ... EK210	1, $1 \pm 30^\circ$, 3, 4, 5 2, 6 unauthorized	$\leq 70^\circ\text{C}$	$0.85 \dots 1.1 \times U_c$
E370 ... EK1000	1, $1 \pm 30^\circ$, 2, 3, 4, 5 6 unauthorized	$\leq 70^\circ\text{C}$	$0.85 \dots 1.1 \times U_c$

Mounting Positions (see the above table for authorized positions)

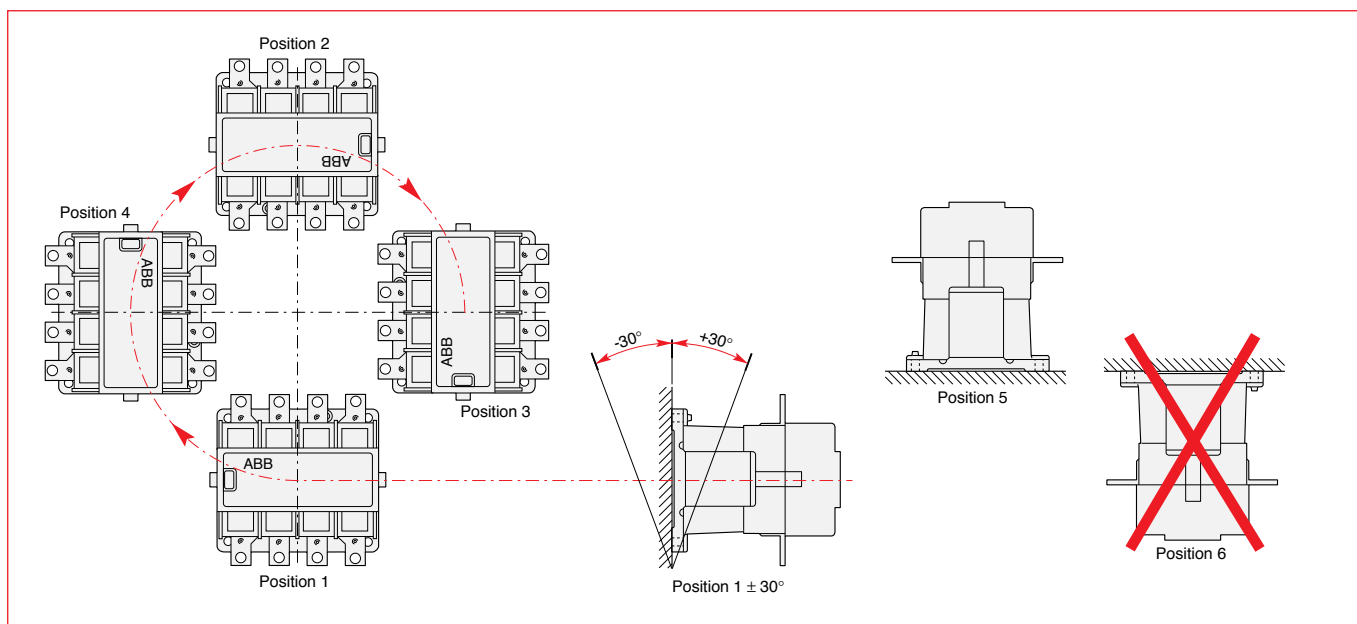

① Damping elements are supplied

IEC Technical data

EK110 – EK1000

Connecting Characteristics

Contactor types: EK...

Main terminals
Flat type

Connecting capacity (min. ... max.)
Main conductors (poles)

Rigid:  1 x mm²
2 x mm²

Rigid with connector
single for Cu cable mm²  25 ... 120
single for Al/Cu cable mm²
double for Al/Cu cable mm²

Flexible  1 x mm²
2 x mm²

Bars or lugs  L mm ≤
Ø mm >

Auxiliary conductors
(coil terminals)

Rigid solid  1 x mm²
2 x mm²

Flexible with cable end  1 x mm²
2 x mm²

Lugs  L mm ≤
l mm >

Degree of protection acc. to IEC 60947-1 /
EN 60947-1 and IEC 60529 / EN 60529

– Main terminals
– Coil terminals

Screw terminals

Main terminals

Coil terminals (delivered in open position)

Tightening torque

Main pole terminals

– recommended Nm / lb.in
– max. Nm

Coil terminals

– recommended Nm / lb.in
– max. Nm

110

150






175

210

370

550

1000



–	–	–	–	–	–
–	–	–	–	–	–
25 ... 185	–	70 ... 300	–	–	–
10 ... 70	35 ... 120	–	70 ... 300	–	95 ... 300
–	–	–	2 x 35 ... 185	–	2 x 95 ... 300
–	–	–	–	–	–
–	–	–	–	–	–
30	30	33	55	–	–
6	10	10	10	–	–
0.5 ... 2.5	0.5 ... 2.5	0.5 ... 2.5	0.5 ... 2.5	0.5 ... 2.5	0.5 ... 2.5
0.5 ... 2.5	0.5 ... 2.5	0.5 ... 2.5	0.5 ... 2.5	0.5 ... 2.5	0.5 ... 2.5
8	8	8	8	8	8
3.7	3.7	3.7	3.7	3.7	3.7
Protection against direct contact acc. to VDE 0106 - Part. 100					
IP 00					
IP 20					
Screws and bolts					
M6 M10					
M3.5 (+,-) pozidriv 2 screws with cable clamp					
5 / 44	18 / 160	–	–	–	–
6	22	–	–	–	–
1.00 / 9	–	–	–	–	–
1.20	–	–	–	–	–

IEC Technical data

Contactor electrical durability and Utilization categories

General

Utilization categories determine the current making and breaking conditions relating to the characteristics of the loads to be controlled by the contactors. International standard IEC 60947-4-1 and European standard EN 60947-4-1 are the standards to be referred to.

If I_c is the current to be broken by the contactor and I_o the rated operational current normally drawn by the load, then:

- Categories AC-1 and AC-3: $I_c = I_o$
- Category AC-2: $I_c = 2.5 \times I_o$
- Category AC-4: $I_c = 6 \times I_o$

Generally speaking $I_c = m \times I_o$ where m is a multiple of the load operational current.

On pages 1.66 - 1.71, the curves corresponding to categories AC-1, AC-2, AC-3 and AC-4 represent the electrical durability variation of standard contactors in relation to the breaking current I_c .

Electrical durability is expressed in millions of operating cycles.

These curves have been plotted for 400 V - 50 Hz 3-phase currents but remain valid up to 690 V - 40 ... 60 Hz provided that a check is carried out to make sure that at the operational voltage U_o , the current I_o normally drawn by the load does not exceed the value of the contactor rated operational current: I_o / AC-1 for category AC-1 and I_o / AC-3 for categories AC-3 and AC-4. The values are given for each type of contactor in pages 1.44, 1.45, 1.54, and 1.61 (Technical Data).

Curve Utilization Mode

Electrical durability forecast and contactor selection for categories AC-1, AC-2, AC-3 or AC-4

- Note the characteristics of the load to be controlled:
 - Operational voltage U_o
 - Current normally drawn I_o (U_o / I_o / kW relation for motors, + page 0/0).
 - Utilization category AC-1, AC-2, AC-3 or AC-4
 - Breaking current $I_c = I_o$ for AC-1 and for AC-3 ; $I_c = 2.5 \times I_o$ for AC-2 ; $I_c = 6 \times I_o$ for AC-4
- Define the number of operating cycles N required.
- On the diagram corresponding to the operational category, select the contactor with the curve immediately above the intersection point (I_c ; N).

Electrical durability forecast and contactor selection for mixed duty motor control: AC-3 ($I_c = I_o$) type switching off while "motor running" and, occasionally, AC-4 ($I_c = 6 \times I_o$) type switching off while "motor accelerating".

- Note the characteristics of the motor to be controlled:
 - Operational voltage U_o
 - Current normally drawn while "motor running" I_o (U_o / I_o / kW relation for motors, + 0/0).
 - Breaking current for AC-3 $I_c = I_o$
 - Breaking current for AC-4 while "motor accelerating" $I_c = 6 \times I_o$
 - Percentage of AC-4 operations K (on the basis of the total number of operating cycles)
- Define the total number of operating cycles N required.
- Note the smallest contactor rating compatible for AC-3 (U_o / I_o) on pages 2/62, 2/63, 2/73, and 2/79.
- For the selected contactor make a note of the following in relation to the voltage using diagram AC-3 page 2/85 and AC-4 page 2/86 or 2/87:
 - The number of operating cycles A for $I_c = I_o$ (AC-3)
 - The number of operating cycles B for $I_c = 6 \times I_o$ (AC-4)
- Calculate the estimated number of cycles N' (N' is always below A)

$$N' = \frac{A}{1 + 0.01 K (A/B - 1)}$$

- If N' is too low in relation to the target N , calculate the estimated number of cycles for a higher contactor rating.

Case of uninterrupted duty.

Among the different utilization categories, the uninterrupted duty implies the following remark. The combined effect of environmental conditions and the proper temperature of the product may require some disposals. As a matter of fact, for this duty, the use duration prevails over the number of operating cycles.

For long term service, some verifications of preventing maintenance are needed to check the functionality of the concerned product (consult us).

Over a duration of five years, in these conditions the contactor might present high internal resistance. We recommend to change the contactor or change the contacts.


IEC Technical data

A9 – AF750

Electrical durability

Electrical Durability for AC-1 Utilization Category. Ambient Temperature $\leq 55^{\circ}\text{C}$

Switching non-inductive or slightly inductive loads. The breaking current I_c for AC-1 is equal to the rated operational current of the load.

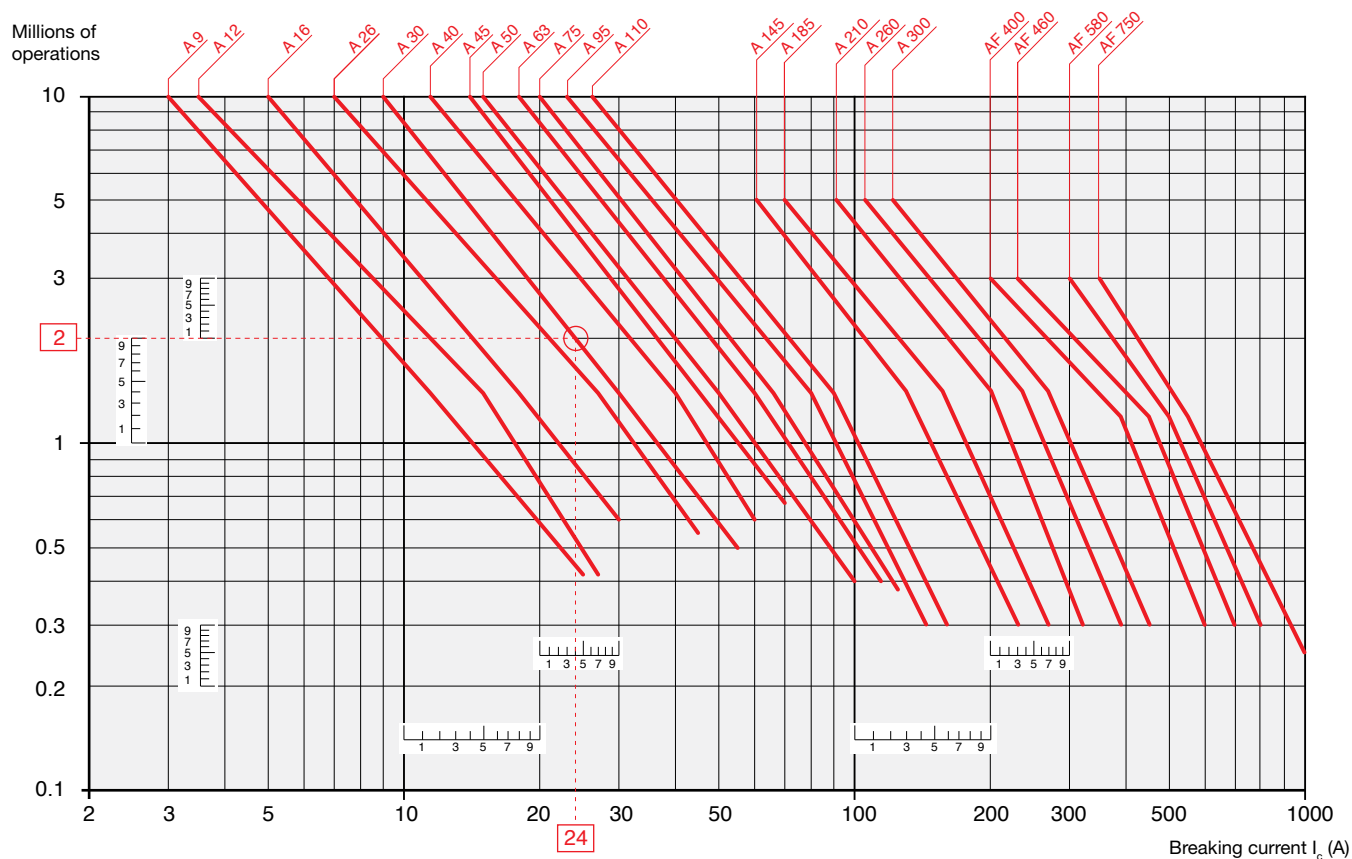

Example:

$I_c / \text{AC-1} = 24 \text{ A}$ – Electrical durability required = 2 million operations.

Using the AC-1 curves above select the A 30 contactor at intersection "O" (24 A / 2 million operations).

IEC Technical data

A9 – AF750


Electrical durability

Across the line
contactors


1

Switching cage motors: starting and switching off running motors. The breaking current I_c for AC-3 is equal to the rated operational current I_e (I_e = motor full load current).

Electrical Durability for AC-3 Utilization Category - $U_e \leq 440$ V. Ambient Temperature ≤ 55 °C

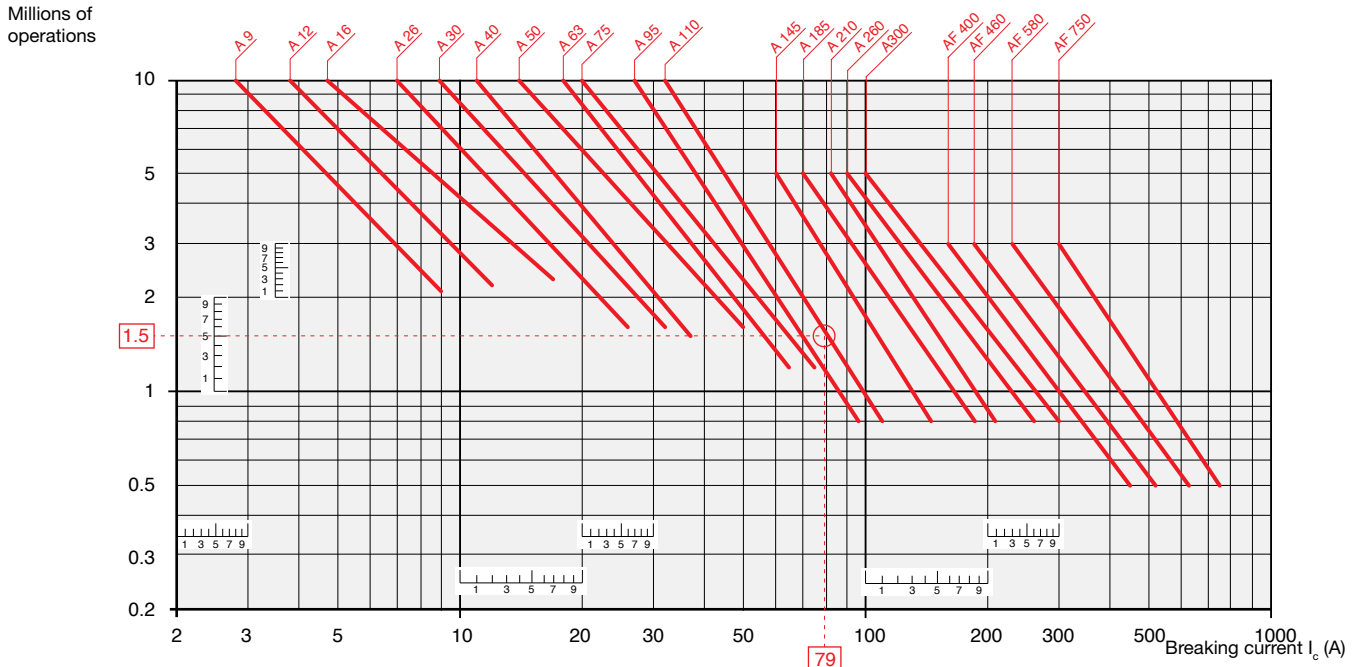

Electrical Durability for AC-3 Utilization Category - 440 V < $U_e \leq 690$ V. Ambient Temperature ≤ 55 °C

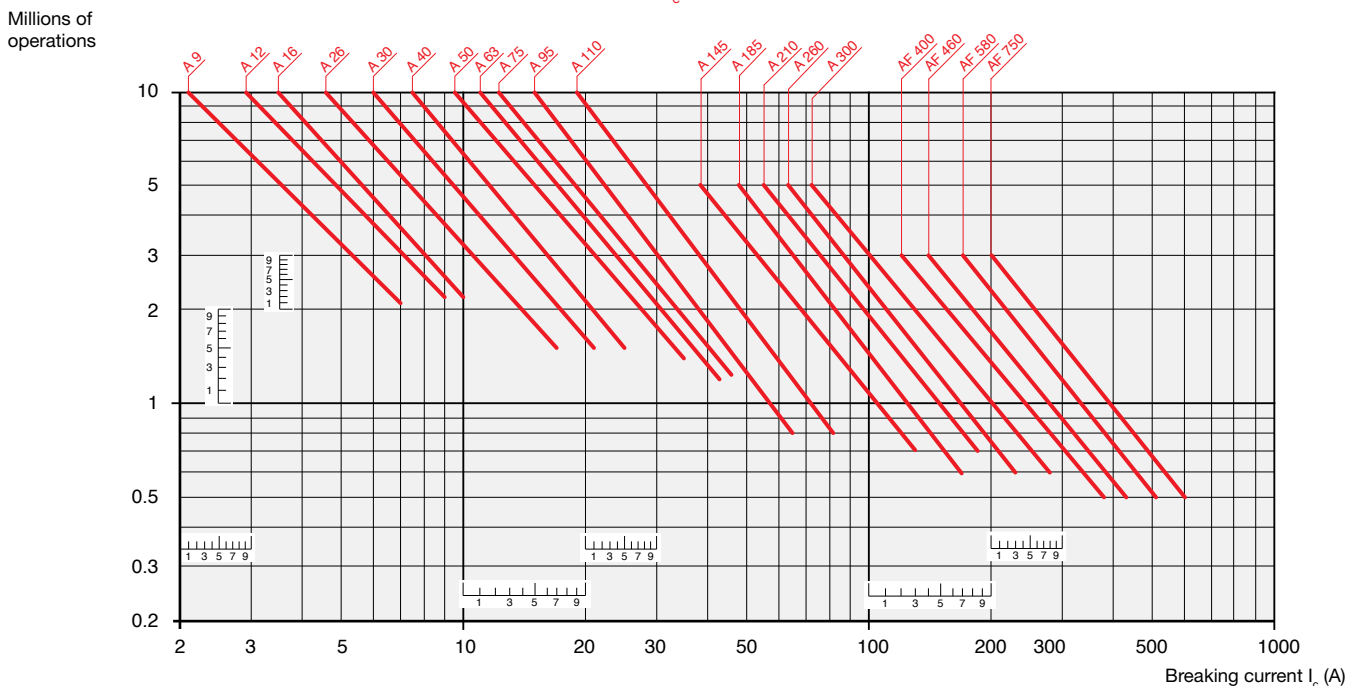

Example:

Motor power 40 kW for AC-3 - $U_e = 400$ V utilization – Electrical durability required = 1.5 million operations.

40 kW, 400 V corresponds to $I_e = 79$ A. For AC-3: $I_c = I_e$. Select the A 110 contactor at intersection "O" (79 A / 1.5 million operations) on the curves (AC-3 - $U_e \leq 440$ V).

IEC Technical data


A9 – AF750

Electrical durability

Electrical Durability for AC-2 or AC-4 Utilization Category - $U_e \leq 440$ V. Ambient Temperature ≤ 55 °C

Maximum number of AC-2 or AC-4 operations: 300 per hour for A 9 ... A 40 contactors,
150 per hour for A 50 ... A 300 contactors.

Switching cage motors: starting, reverse operation and step-by-step operation. The breaking current I_c is equal to $2.5 \times I_e$ for AC-2 and $6 \times I_e$ for AC-4, keeping in mind that I_e is the motor rated operational current (I_e = motor full-load current).

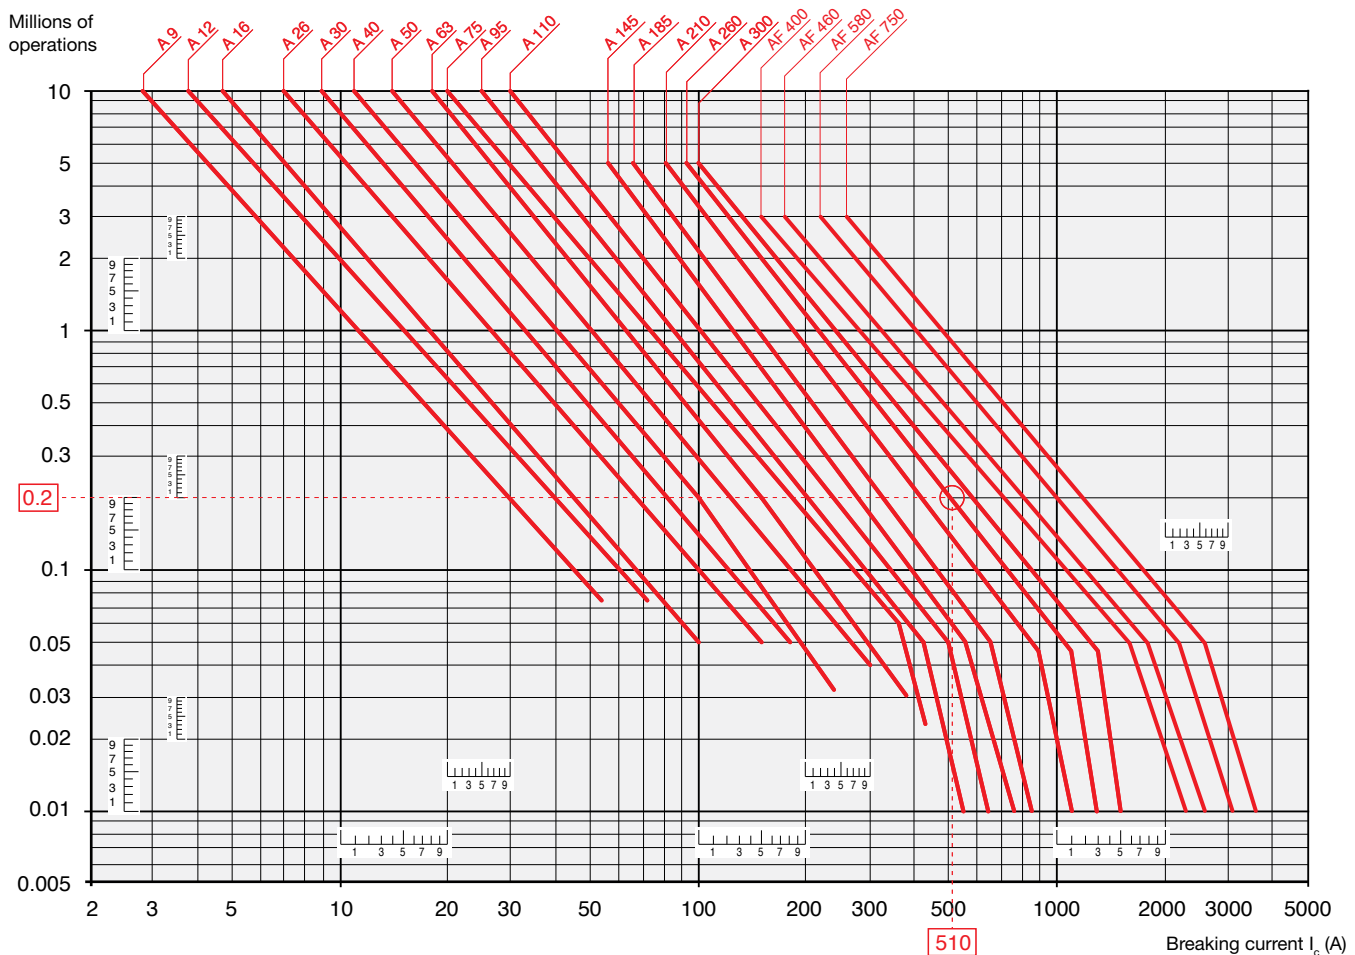

Example:

Motor power 45 kW for AC-4 - $U_e = 400$ V utilization – Electrical durability required = 0.2 million operations.

45 kW, 400 V corresponds to $I_e = 85$ A.

For AC-4: $I_c = 6 \times I_e = 510$ A - Select the A 260 contactor at intersection "O" (510 A / 0.2 million operations) on the curves (AC-4 - $U_e \leq 440$ V).

IEC Technical data

A9 – AF750

Electrical durability


Across the line
contactors

1

Electrical Durability for AC-2 or AC-4 Utilization Category - $440\text{ V} < U_e \leq 690\text{ V}$. Ambient Temperature $\leq 55\text{ }^{\circ}\text{C}$

Maximum number of AC-2 or AC-4 operations: 300 per hour for A 9 ... A 40 contactors,
150 per hour for A 50 ... A 300 contactors.

Switching cage motors: starting, reverse operation and step-by-step operation. The breaking current I_c is equal to $2.5 \times I_e$ for AC-2 and $6 \times I_e$ for AC-4, keeping in mind that I_e is the motor rated operational current (I_e = motor full-load current).

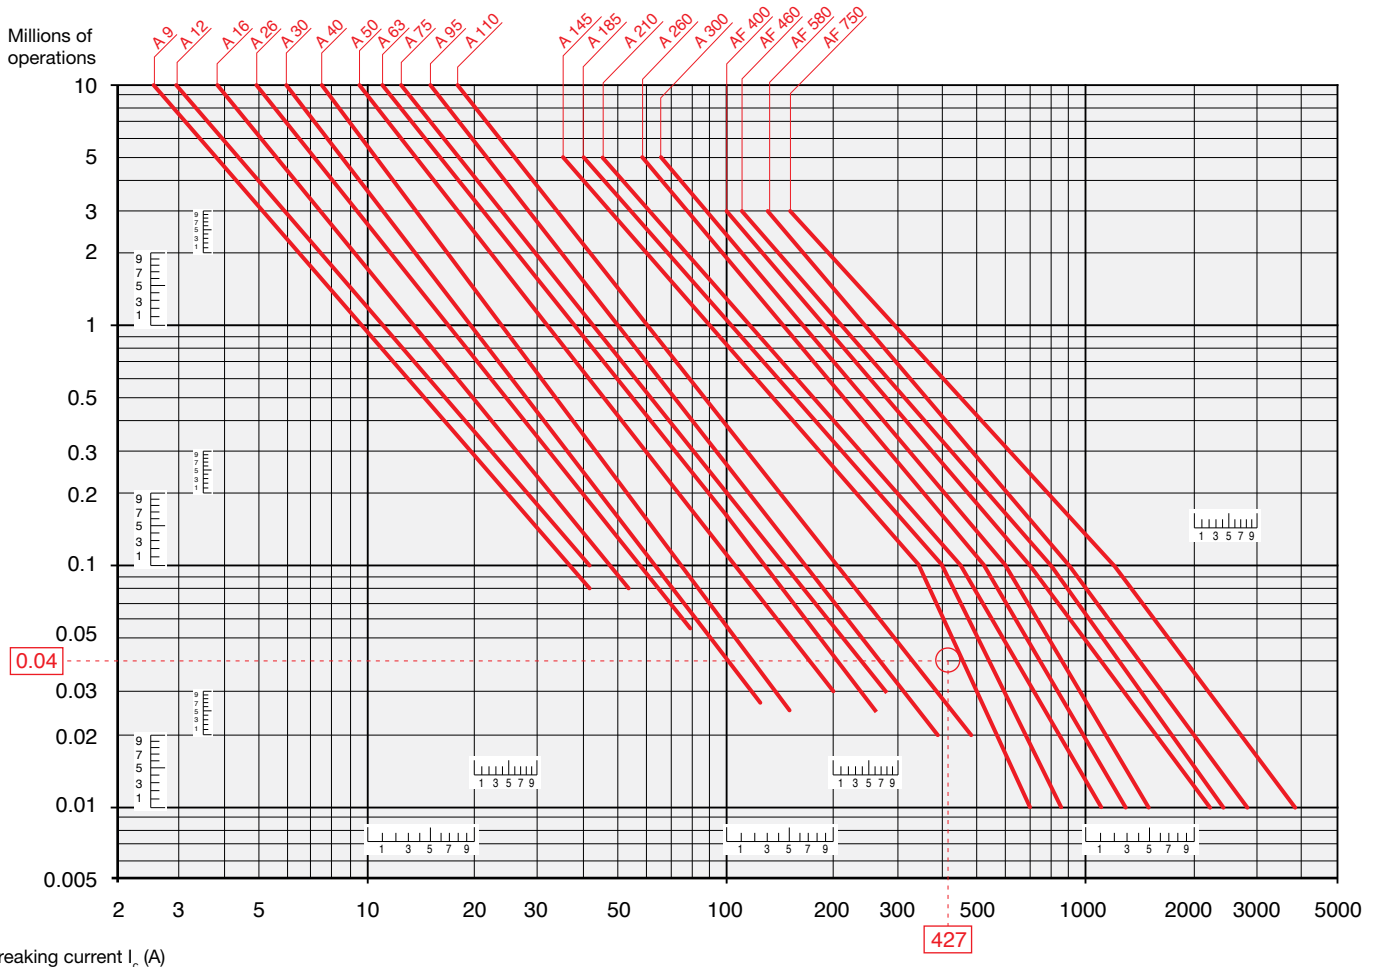

Example:

Motor power 59 kW for AC-4 - $U_e = 600\text{ V}$ utilization – Electrical durability required = 0.04 million operations.

As stated on page 0/0: 59 kW, 600 V corresponds to $I_e = 71.1\text{ A}$.

For AC-4: $I_c = 6 \times I_e = 426.6\text{ A}$ - Select the A 145 contactor at intersection "O" (427 A / 0.04 million operations) on the curves (AC-4 - $440\text{ V} < U_e \leq 690\text{ V}$).

IEC Technical data

AL9 — AL40

Electrical durability

Consult
factory

IEC Technical data

EK110 — EK1000


Electrical durability

Across the line
contactors

1

Electrical Durability for AC-1 Utilization Category. Ambient Temperature $\leq 55^\circ\text{C}$

Switching non-inductive or slightly inductive loads. The breaking current I_c for AC-1 is equal to the rated operational current of the load.

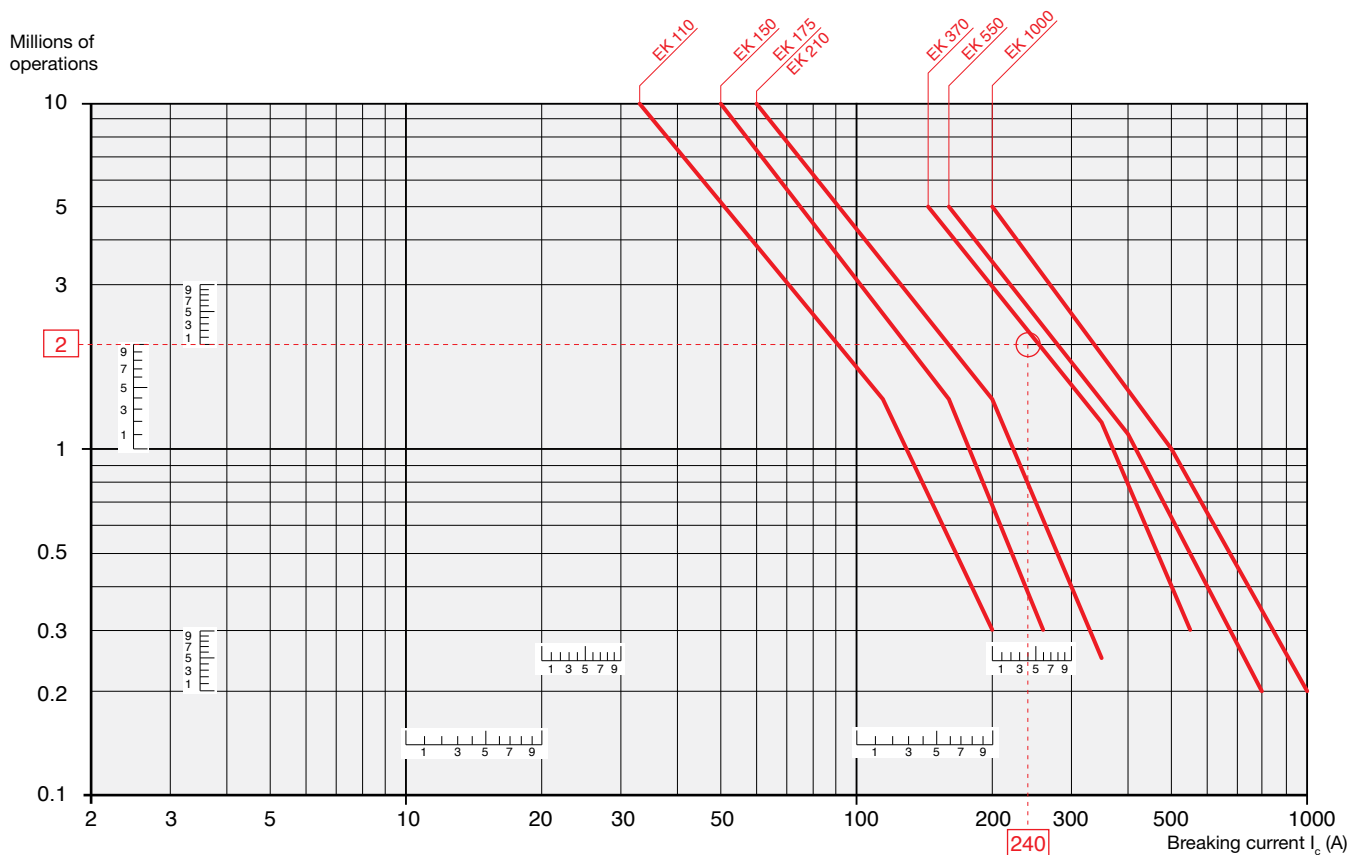

Example:

$I_c / \text{AC-1} = 240 \text{ A}$ – Electrical durability required = 2 million operations.

Using the AC-1 curves above select the EK 370 contactor at intersection "O" (240 A / 2 million operations).

IEC Technical data

Influence of the length of conductors used in contactor control circuits



A 50-30-00



AF 460-30-11

Under certain conditions the excessive length of the control circuit conductors may prevent the contactor from carrying out closing and opening orders.

- no closing: due to excessive voltage drop (in a.c. or d.c.).
- no opening: due to excessive capacitance (in a.c.).

Contactor Closing (contactor with a.c. or d.c. fed control circuit)

The voltage drop is due to the pull-in current (pull-in power) and to the resistance of the control circuit conductors.

The table and graph below can be used to determine the single length of line feeders (distance between the control device and the contactor coil) in relation to:

- I the coil pull-in consumption.
- I the supply voltage.
- I the connecting wire cross-sectional area.


The graph has been drawn for a max. line voltage drop of 5 %.

Coil pull-in consumption (average value)

Contactors	a.c. control circuit 50 Hz	Contactors	d.c. control circuit
A 9, 12, 16	70 VA	AE 9, 12, 16	90 W
A 26, 30, 40	120 VA	AE 26, 30, 40	110 W
A 45, 50, 63, 75	180 VA	AE 45, 50, 63, 75	200 W
A 95, 110	450 VA	AE 95, 110	400 W
A 145, 185	700 VA	BC 9, 16, 18, 25, 30	7 W
A 210, 260, 300	1700 VA		
AF 45, 50, 63, 75	210 VA	AF 45, 50, 63, 75	190 W
AF 95, 110	350 VA	AF 95, 110	400 W
AF 145, 185	430 VA	AF 145, 185	500 W
AF 210, 260, 300	470 VA	AF 210, 260, 300	520 W
AF 400, 460	890 VA	AF 400, 460	990 W
AF 580, 750	850 VA	AF 580, 750	950 W

Permissible single length for the control circuit conductors on contactor closing:

Depending on the coil pull-in power consumption on the supply voltage and on the control circuit conductor cross-sectional area.

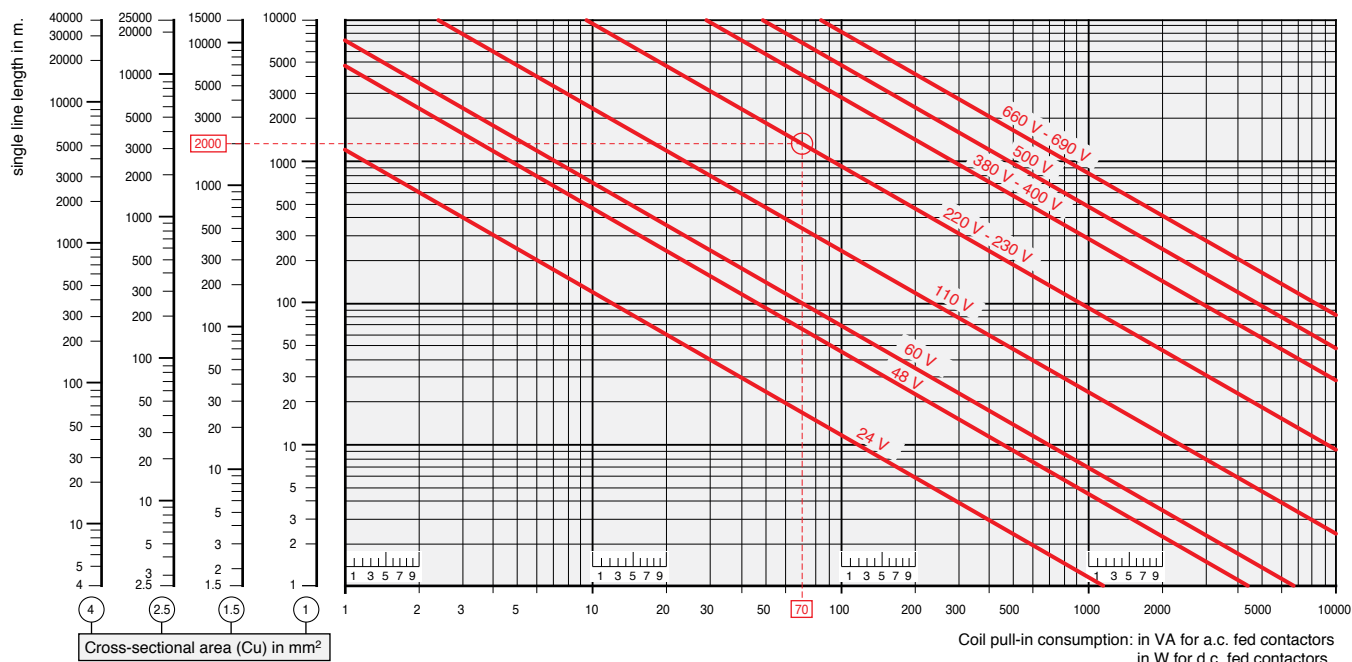

Example:

A 9 contactor


Coil voltage: 230 V 50 Hz, contactor coil pull-in power consumption: 70 VA,
control circuit conductor cross-sectional area: Cu 1.5 mm².

Max. permissible length: 2000 m.

IEC Technical data

Influence of the length of conductors used in contactor control circuits


Single control line length



Wiring diagram A

Via maintained pushbutton and 2-core cable (with a capacity of 0.2 µF/km, for example).

Single control line length



Wiring diagram B

Via momentary pushbutton plus hold-in contact and 3-core cable (with a capacity of 2 x 0.2 = 0.4 µF/km, for example).

Contactor Opening (contactor with a.c. fed control circuit)

Under certain conditions, an a.c. operated contactor does not open when the control circuit is de-energized.

This is due to a critical capacity of the excessively long control circuit line and the type of contactor coil control layout (see diagrams A and B opposite).

This may be caused by the following factors:

- high control voltage.
- low coil holding consumption.
- low contactor drop-out voltage (according to IEC 60947-4-1: 0.2 to 0.75 x U₀).

If lines longer than those indicated are required, the following measures must be taken:

- select a contactor with a higher rating.
- select a lower control voltage.
- connect "R_p" impedances in parallel with the contactor coil:

$$\text{sizing of parallel resistor: } R_p = \frac{10^3}{C} \quad (\text{with } C \text{ in } \mu\text{F})$$

The table and graph below can be used to determine the single length of line feeders (distance between the control device and the contactor coil) in relation to:

- the coil holding consumption VA.
- the supply voltage.
- the capacity in µF/km (depending on the control layout).


Wiring diagrams A and B opposite show two supply and coil control wiring examples.

Coil holding consumption (average value)

Contactors	a.c. control circuit 50 Hz	Contactors	a.c. control circuit 50 Hz
A 9, 12, 16	8 VA	AF 45, 50, 63, 75	7 VA
A 26, 30, 40	12 VA	AF 95, 110,	7 VA
A 45, 50, 63, 75	18 VA	AF 145, 185,	12 VA
A 95, 110	22 VA	AF 210, 260, 300	10 VA
A 145, 185	35 VA	AF 400, 460	12 VA
A 210, 260, 300	60 VA	AF 580, 750	12 VA

Permissible single length for the control circuit conductors on contactor opening:

Depending on the coil holding power consumption, on the supply voltage and on the control circuit conductor capacity.

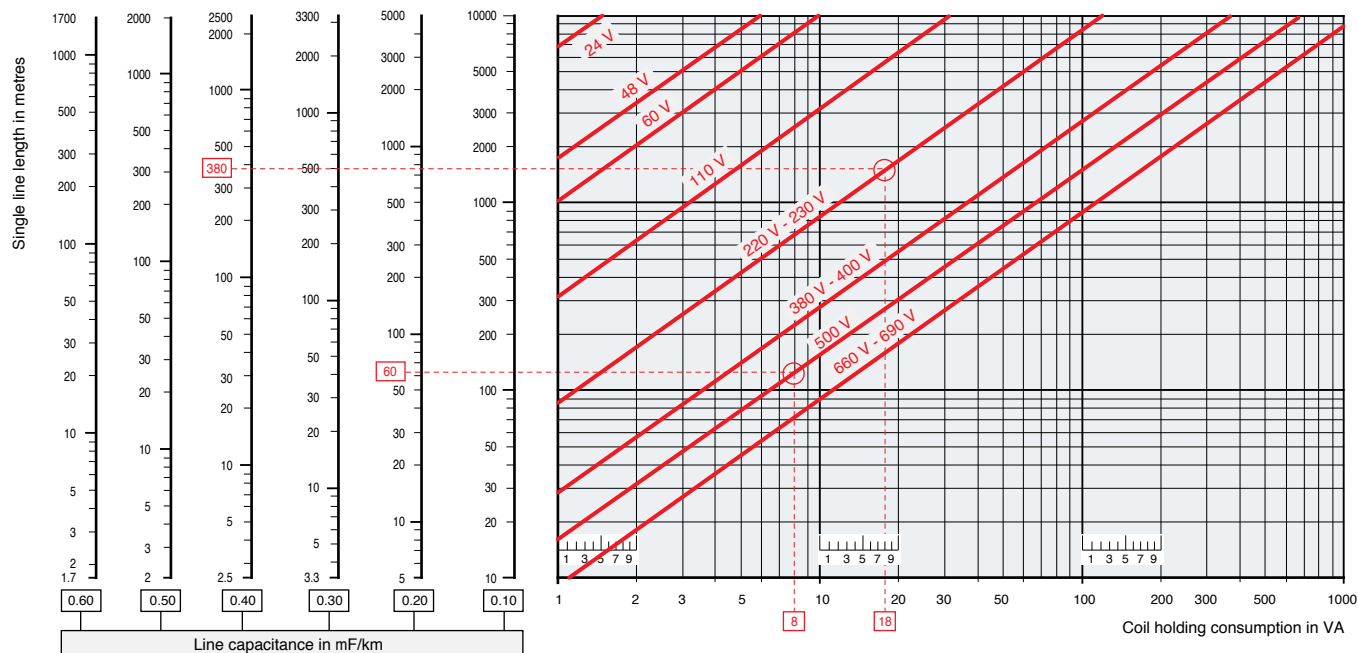

Examples:

A 16 contactor

Coil voltage U_c = 500 V, 50 Hz, 8 VA contactor coil holding consumption, control type: diagram A, via maintained pushbutton, and 2-core cable with a capacity of 0.2 µF/km.

Max. permissible length: 60 m.

A 50 contactor

Coil voltage U_c = 230 V, 50 Hz, 18 VA contactor coil holding consumption, control type: diagram B via momentary pushbutton, hold-in contact and 3-core cable with a capacity of 2 x 0.2 µF/km = 0.4 µF/km.

Max. permissible length: 380 m.

IEC Technical data

Parallel connection of main poles

Parallel Connection of Main Poles

Purpose: Increasing the a.c. resistive load.


Remarks:

- Parallel connection of main poles to increase the d.c. resistive load is not acceptable.
- Parallel connection of main poles doesn't increase the breaking capacity.

Means: The poles can be connected in parallel via shorting bars. See page 1.30.

- LP and LH for parallel connection of 2 poles,
- LY and LF for parallel connection of 3 poles,

The table below shows the uprating factor for I_g / AC-1 max. in relation to the number of poles in parallel and for a max. switching frequency.

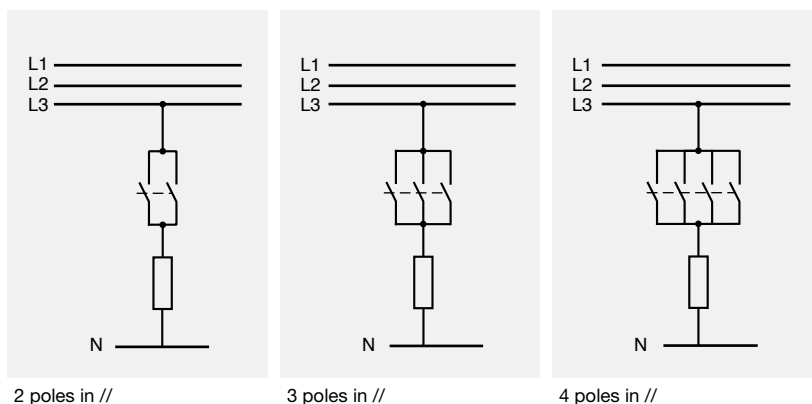

Contactors			Factor to be applied to the rated operational current I _g / AC-1 to obtain the permissible current I _g / AC-1 with "n" poles in parallel.				
a.c. Operated	d.c. Operated	Cycles / h					
3-pole contactors							
A 9 ... A 75	AF 50 ... AF 75	600 A 95 ... A 300	1.6 AF 145 ... AF 750	2.2 300	– 1.6 2.2 –		
AF 50 ... AF 75	AE..., TAE... AL...						
AF 145 ... AF 750							
4-pole contactors							
A 9 ... A 75	AF 45 ... AF 75	600 EK...	1.6 EK...	2.2 300	2.6 1.6 2.2 2.8		
AF 45 ... AF 75	AE..., TAE... AL...						

IEC Technical data

Temporary or intermittent duty

Across the line
contactors

1

Utilization of Contactors for Temporary / Intermittent Duty

The table below shows the factor to be applied to the rated operational current $I_e / AC-1$ to obtain the permissible operational current $I_e / AC-1$ in relation to the switching frequency and the current flow time per cycle.

Operating cycles per hour	120	60	20	6	2	1
Current flow time per cycle in seconds.	Factor to be applied to the rated operational current $I_e / AC-1$ max. to obtain the permissible current $I_e / AC-1$ for temporary / intermittent duty.					
5	2.8	3.4	4	4.7	5	5.2
10	2.2	2.6	3	3.4	3.7	3.8
20	1.6	2	2.4	2.6	2.7	2.8
30	–	1.7	2.1	2.2	2.3	2.4
40	–	1.5	1.9	2.0	2.1	2.2
60	–	–	1.7	1.8	1.8	1.9

Example:

A 9 contactor (intermittent duty, resistive load)

Rated operational current $I_e / AC-1$ at 55 °C (see page 1.42)

Switching frequency

Current flow time per cycle

Factor to be applied to the current $I_e / AC-1$

Permissible current: $2.7 \times 22 =$

22 A

2 operations/h

20 s

2.7

59 A

Technical data

Technical terms and definitions

Altitude

Refers to the height of the site where the equipment is located, expressed in meters above the sea level.

Ambient temperature

Temperature of the air surrounding the unit.

Circuits

• Auxiliary circuit

All the conducting parts of a contactor, intended to be included in a circuit different from the main circuit and the control circuit of the contactor e.g. signalization, interlocking circuits etc ...

• Control circuit

All the conducting parts of a contactor (other than the main circuit) included in a circuit used for the closing operation, or opening operation, or both, of the contactor.

• Main circuit

All the conducting parts of a contactor included in the circuit which it is designed to close or open.

Coil operating range

Expressed as a multiple of the rated control circuit voltage U_c for the lower and upper limits.

Cycle duration

Total time of the on-load + off-load period.

Endurance / durability

• Electrical endurance

Number of on-load operating cycles (i.e. with current on the main contacts) a contactor can achieve, varies depending on the utilization category.

• Mechanical endurance

Number of off-load operating cycles (i.e. without current on the main contacts) a contactor can achieve.

Inching

Energizing a motor once or repeatedly for short periods to obtain small movements of the driven mechanism.

Insulation class according to the VDE 0110 and NFC 20-040

Characterizes contactors suitability in accordance with environment and utilization conditions. A contactor can be classified depending on its own clearance and creepage distances in the insulation classes A, B, C, D which correspond to different insulation voltage values.

The insulation class C is applicable to most of the industrial applications. Equipment described in this catalogue correspond to insulation class C.

Intermittent duty

Duty in which the main contacts of a contactor remain closed for periods of time insufficient to allow the contactor to reach thermal equilibrium, the current-carrying periods being separated by off-load periods of sufficient duration to restore equality of temperature with the cooling medium.

Mounting positions

Stated by the manufacturer. Please note restrictions when applicable.

On-load factor

Ratio of the current flow time to the total time of the cycle $\times 100$.

Plugging

Stopping or reversing a motor quickly by interchanging two supply leads whilst the motor is running.

Rated breaking capacity; Rated making capacity

Value of r.m.s current a contactor can break or make at a fixed voltage value, within the conditions specified by the standards, depending on the utilization category.

Rated control circuit voltage U_c

Control voltage value for which the control circuit of the unit is sized.

Rated insulation voltage U_i

Voltage value which designates the unit and to which dielectric tests, clearance and creepage distances are referred.

Rated impulse withstand voltage U_{imp}

The highest peak value of an impulse voltage of prescribed form 1.2/50, which does not cause breakdown under specified conditions of test.

Rated operating current I_e

Current value stated by the manufacturer and taking into account the rated operating voltage U_e , the rated frequency, the rated duty, the utilization category, the electrical contact life and the type of the protective enclosure.

Rated operating voltage U_e

Voltage value to which utilization characteristics of the contactor are referred, i.e. phase to phase voltage in 3 phase circuits.

Conventional thermal current I_{th}

Value of current the contactor can withstand with poles in closed position, in free air for an eight hour duty, without the temperature rise of its various parts exceeding the limits specified by the standards.

Resistance to shocks

Requirements applicable for instance to vehicles, crane operation or switchgear slide-in module systems.

At the quoted permissible «g» values, contactors must not undergo a change in switching state and O/L relays must not trip.

Resistance to vibrations

Requirements applicable to all the vehicles, vessels and other similar transport systems. At the quoted amplitude and vibration frequency values, the unit must be capable to achieve the required duty.

Short-circuit protection coordination

Achieved by using back-up protection devices such as circuit-breakers, H.R.C. fuses or standard fuses.

Co-ordination types a, b, c are defined in IEC 292-1 publication, VDE 0660, NFC 63-650 standards. Co-ordination types "1" and "2" are defined in IEC 947-4-1.

• Type 1 co-ordination

There has been no discharge of parts beyond the enclosure. Damage to the contactor and the overload relay is acceptable.

• Type 2 co-ordination

No damage to the overload relay or other parts has occurred, except that welding of contactor or starter contacts is permitted, if they are easily separated.

Switching frequency

Number of operating cycles per hour.

Time

• Closing time

Time between energization of the coil until the moment the contacts of the first current path to be closed actually close.

• Opening time

Time from the beginning of state causing breaking until the moment when the contacts of the last current path to be opened are open.

• Minimal operation time

Shortest control duration to ensure complete closing or opening of a contactor.

• Short time current permissible

Value of current which the contactor can withstand in closed position for a short time period and within specified conditions.

• Time constant

Ratio of inductance to the resistance : $L/R = \text{mH}/\text{Ohm} = \text{ms}$.

Standards

- IEC standards 158-1: "Contactors" and series IEC 292 :

"Motor-starters" have been revised and replaced by the new IEC 947-4-1 (1990-05): "Contactors and Motor-starters" referring to IEC 947-1 (1988): "General rules". The new standards will constitute the basis of the future European and National standards, not yet revised.

Therefore the ratings indicated in this catalog are established according to the former and the future standards.

Main changes and additions in the new standards are:

- Revision and extension of the utilization categories (see hereafter)
- Replacement of the coordination classes types a, b, c by new types: "1" (approximately equivalent to former class "a") and "2" (approximately equivalent to former class "c") with additional requirements.
- Classification of the thermal overload relays in tripping classes: 10 A; 10; 20 and 30 depending on their tripping times, at 1.5 and 7.2 times their setting current, in order to cover motor applications depending on their starting times. Class 10 A is adapted for motors according to IEC 34-1.
- Introduction of tests to verify the connecting capability and the mechanical strength of terminals.

Utilization categories

A contactor duty is characterized by the utilization category plus indication of the rated operating voltage and the rated operating current (see at Rated ...), or the motor characteristics.

Utilization categories for contactors according to IEC 947-4-1

Alternating current:	AC-1 AC-2 AC-3 AC-4 AC-5a AC-5b AC-6a AC-6b AC-8a AC-8b	Non-inductive or slightly inductive loads, resistance furnaces. Power factor 0.7 - 0.8 (slightly inductive). Slip-ring motors: starting, switching-off. Squirrel-cage motors: starting, switching-off motors during running. Power factor 0.4 - 0.5 (AC-3). Squirrel-cage motors: starting, plugging, inching. Switching of electric discharge lamp controls. Switching of incandescent lamps. Switching of transformers. Switching of capacitor banks Hermetic refrigerant compressor motor control with manual resetting of overload releases Hermetic refrigerant compressor motor control with automatic resetting of overload releases.
Direct current:	DC-1 DC-3 DC-5 DC-6	Non-inductive or slightly inductive loads, resistance furnaces. Shunt motors: starting, plugging, inching. Dynamic breaking of d.c. motors. Series motors: starting, plugging, inching. Dynamic breaking of d.c. motors. Switching of incandescent lamps

Utilization categories for contactor relays according to IEC 947-5-1

Alternating current:	AC-12 AC-13 AC-14 AC-15	Control of resistive loads and solid state loads with isolation by opto couplers. Control of solid state loads with transformer isolation. Control of small electromagnetic loads (≤ 72 VA). Control of electromagnetic loads (> 72 VA).
Direct current:	DC-12 DC-13 DC-14	Control of resistive loads and solid state loads with isolation by opto couplers. Control of electromagnets. Control of electromagnetic loads having economy resistors in circuit.

Utilization categories AC-1, AC-2, AC-3, AC-4 and DC-1, DC-3, DC-5 are maintained with slightly more severe tests.

Other categories have been added in order to standardize specific applications. In fact some contactor applications and the specific criteria characterizing the types of load controlled can modify the recommended utilization characteristics. These major applications are, for example :

Switching of capacitor banks

This application is characterized by high current peaks when switching-on the contactor and presence of harmonic currents on uninterrupted duty. For this application, IEC 947-4-1 has defined an utilization category AC-6b. Practical ratings have to be defined according to tests or, in absence of tests, by a calculation indicated in IEC 947-4-1.

Switching of transformers

This application is characterized by high current peaks on contactor closing due to magnetization phenomena. The corresponding utilization category according to IEC 947-4-1 is AC-6a. Ratings are derived from test-values for AC-3 or AC-4 according to formula given in IEC 947-4-1.

Switching of lighting circuits

The current peaks on contactor closing and power factor vary depending on the type of lamps, the switching method used and if compensation systems are fitted or not.

IEC 947-4-1 contains two standard utilization categories

- AC-5a for switching of the electric discharge lamps.
- AC-5b for switching of incandescent lamp.

UL/CSA Technical data

Motor data

Ampere ratings of 3 phase, AC induction motors

Horse power	110 – 120V			200 – 208V			220 – 240V			380 – 415V ^①		440 – 480V			550 – 600V		
	Single phase	Two phase	Three phase	Single phase	Two phase	Three phase	Single phase	Two phase	Three phase	Single phase	Three phase	Single phase	Two phase	Three phase	Single phase	Two phase	Three phase
1/10	3.0	—	—	1.65	—	—	1.5	—	—	1.0	—	—	—	—	—	—	—
1/8	3.8	—	—	2.1	—	—	1.9	—	—	1.2	—	—	—	—	—	—	—
1/6	4.4	—	—	2.4	—	—	2.2	—	—	1.4	—	—	—	—	—	—	—
1/4	5.8	—	—	3.2	—	—	2.9	—	—	1.8	—	—	—	—	—	—	—
1/3	7.2	—	—	4.0	—	—	3.6	—	—	2.3	—	—	—	—	—	—	—
1/2	9.8	4.0	4.4	5.4	2.2	2.4	4.9	2.0	2.2	3.2	1.3	2.5	1.0	1.1	2.0	0.8	0.9
3/4	13.8	4.8	6.4	7.6	2.6	3.5	6.9	2.4	3.2	4.5	1.8	3.5	1.2	1.6	2.8	1.0	1.3
1	16.0	6.4	8.4	8.8	3.6	4.6	8.0	3.2	4.2	5.1	2.3	4.0	1.6	2.1	3.2	1.3	1.7
1 1/2	20.0	9.0	12.0	11.0	5.0	6.6	10.0	4.5	6.0	6.4	3.3	5.0	2.3	3.0	4.0	1.8	2.4
2	24.0	11.8	13.6	13.2	6.5	7.5	12.0	5.9	6.8	7.7	4.3	6.0	3.0	3.4	4.8	2.4	2.7
3	34.0	16.6	19.2	18.7	9.2	10.6	17.0	8.3	9.6	10.9	6.1	8.5	4.2	4.8	6.8	3.3	3.9
5	56.0	26.4	30.4	30.8	14.5	16.8	28.0	13.2	15.2	17.9	9.7	14.0	6.6	7.6	11.2	5.3	6.1
7 1/2	80.0	38.0	44.0	44.0	21.0	24.2	40.0	19.0	22.0	27.0	14.0	21.0	9.0	11.0	16.0	8.0	9.0
10	100.0	48.0	56.0	55.0	26.4	30.8	50.0	24.0	28.0	33.0	18.0	26.0	12.0	14.0	20.0	10.0	11.0
15	135.0	72.0	84.0	75.0	39.6	46.2	68.0	36.0	42.0	44.0	27.0	34.0	18.0	21.0	27.0	14.0	17.0
20	—	94.0	108.0	96.8	52.0	60.0	88.0	47.0	54.0	56.0	34.0	44.0	23.0	27.0	35.0	19.0	22.0
25	—	118.0	136.0	121.0	65.0	75.0	110.0	59.0	68.0	70.0	44.0	55.0	29.0	34.0	44.0	24.0	27.0
30	—	138.0	160.0	150.0	76.0	88.0	136.0	69.0	80.0	87.0	51.0	68.0	35.0	40.0	54.0	28.0	32.0
40	—	180.0	208.0	194.0	100.0	115.0	176.0	90.0	104.0	112.0	66.0	88.0	45.0	52.0	70.0	36.0	41.0
50	—	226.0	260.0	238.0	125.0	143.0	216.0	113.0	130.0	139.0	83.0	108.0	56.0	65.0	86.0	45.0	52.0
60	—	—	—	—	147.0	160.0	—	133.0	154.0	—	103.0	—	67.0	77.0	—	53.0	62.0
75	—	—	—	—	183.0	212.0	—	166.0	192.0	—	128.0	—	83.0	96.0	—	66.0	77.0
100	—	—	—	—	240.0	273.0	—	218.0	248.0	—	165.0	—	109.0	124.0	—	87.0	99.0
125	—	—	—	—	—	344.0	—	—	312.0	—	208.0	—	135.0	156.0	—	108.0	125.0
150	—	—	—	—	—	396.0	—	—	360.0	—	240.0	—	156.0	180.0	—	125.0	144.0
200	—	—	—	—	—	528.0	—	—	480.0	—	320.0	—	208.0	240.0	—	167.0	192.0
250	—	—	—	—	—	663.0	—	—	602.0	—	403.0	—	—	302.0	—	—	242.0
300	—	—	—	—	—	—	—	—	—	—	482.0	—	—	361.0	—	—	289.0
350	—	—	—	—	—	—	—	—	—	—	560.0	—	—	414.0	—	—	336.0
400	—	—	—	—	—	—	—	—	—	—	636.0	—	—	477.0	—	—	382.0
500	—	—	—	—	—	—	—	—	—	—	786.0	—	—	590.0	—	—	472.0


① To obtain full load currents for 265V and 277V motors, decrease corresponding 220 – 240V ratings by 13 percent and 17 percent.

Approximate dimensions A/AE9 – A/AE26, 3 pole


Across the line
1

00.00 → Inches
00.00 → [Millimeters]


A/AE9 – A/AE16 – Contactor, 3 pole

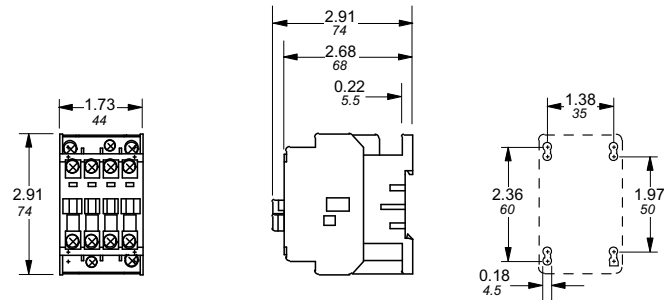


A/AE9 – A/AE16 + VM5 or VE5 – Mechanically interlocked contactor, 3 pole

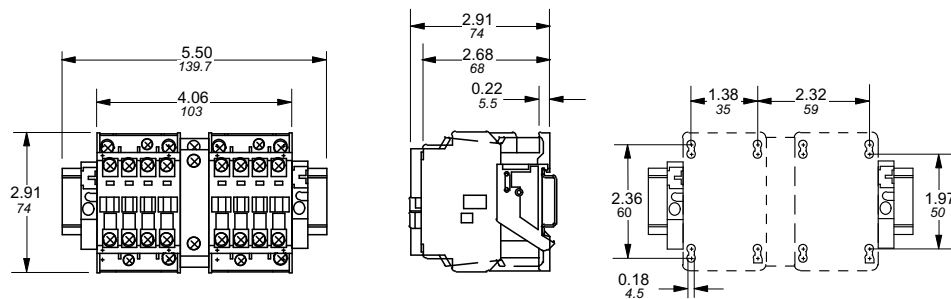

A/AE26 – Contactor, 3 pole

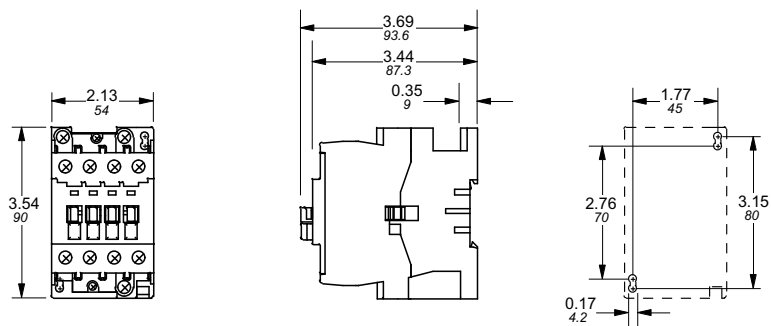




A/AE26 + VM5 or VE5 – Mechanically interlocked contactor, 3 pole

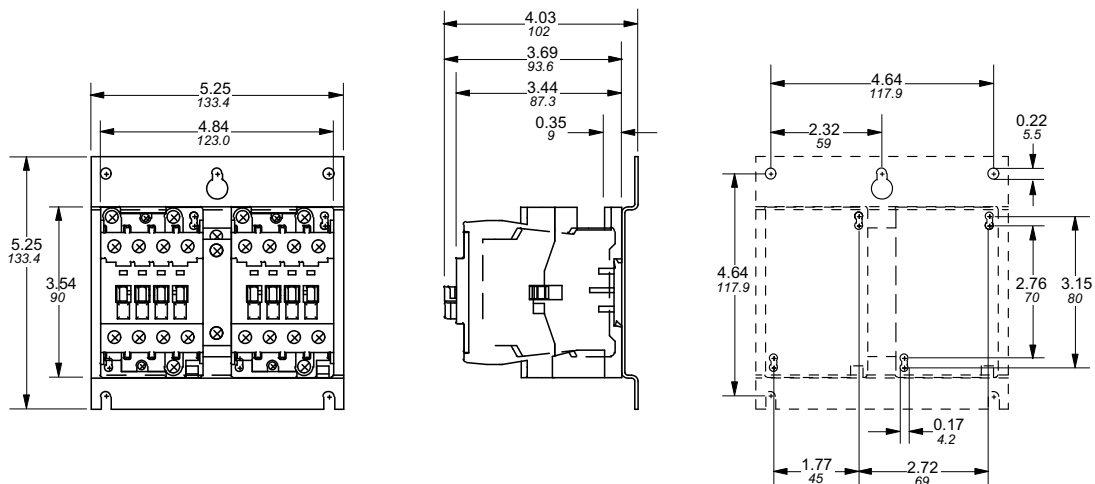




Approximate dimensions A/AE30 – A/AE/AF75, 3 pole

00.00 → Inches
00.00 → [Millimeters]




A/AE30 & A/AE40 – Contactor, 3 pole






A/AE30 & A/AE40 + VM5 or VE5 – Mechanically interlocked contactor, 3 pole

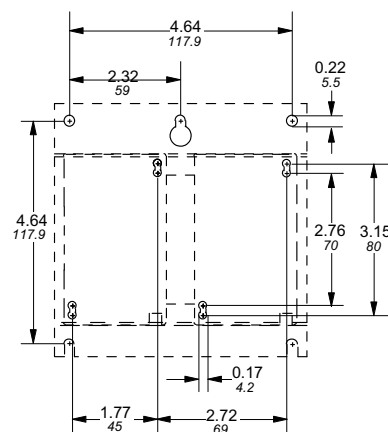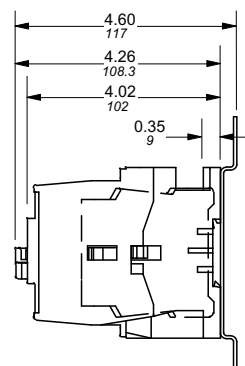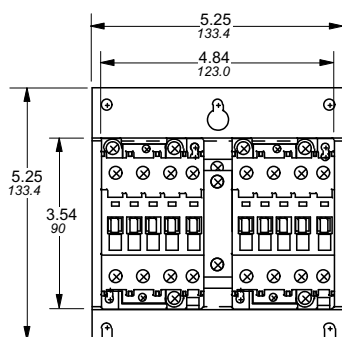

A/AE/AF50 – A/AE/AF75 – Contactor, 3 pole

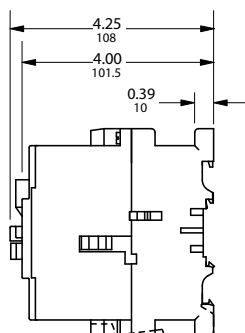

A/AE/AF50 – A/AE/AF75 + VM5 or VE5 – Mechanically interlocked contactor, 3 pole

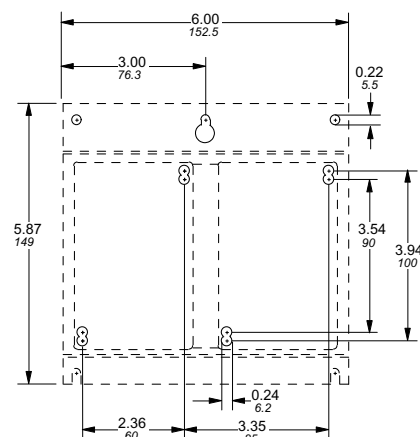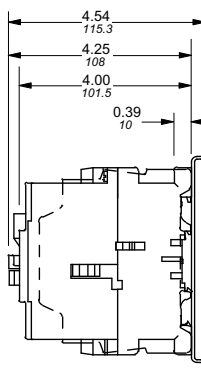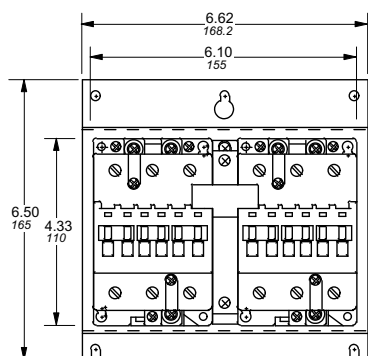


Approximate dimensions A/AE/AF95 & A/AE/AF110, 3 pole


Across the line
1

00.00 → Inches
00.00 → [Millimeters]

A/AE/AF95 & A/AE/AF110 — Contactor, 3 pole

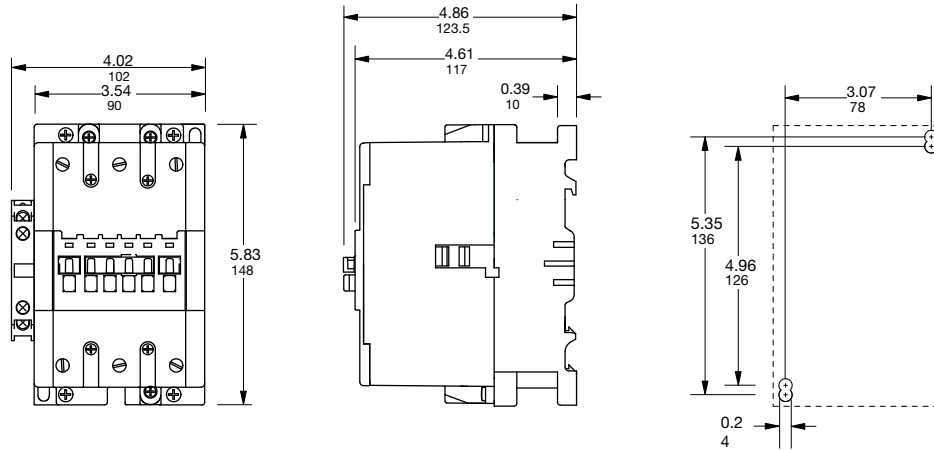

A/AE/AF95 & A/AE/AF110 + VE5 — Mechanically interlocked contactor, 3 pole

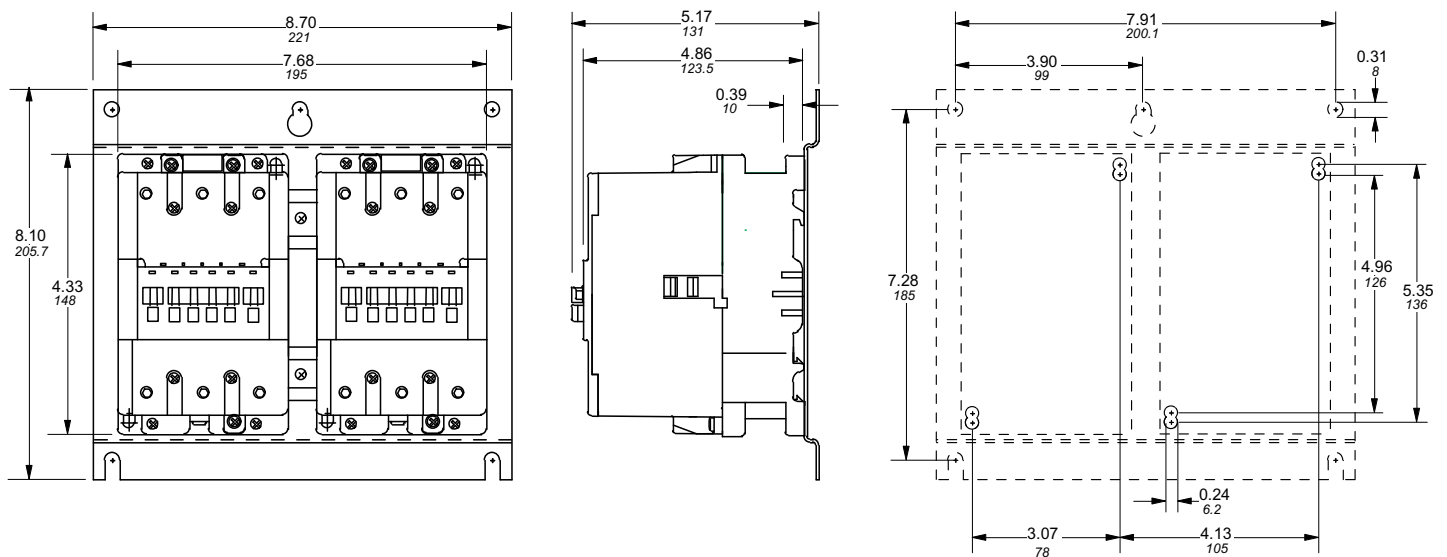


Approximate dimensions


A/AE9 – A/AE/AF75, 4 pole

00.00 → Inches
00.00 → [Millimeters]


A/AE9 – A/AE16 — Contactor, 4 pole

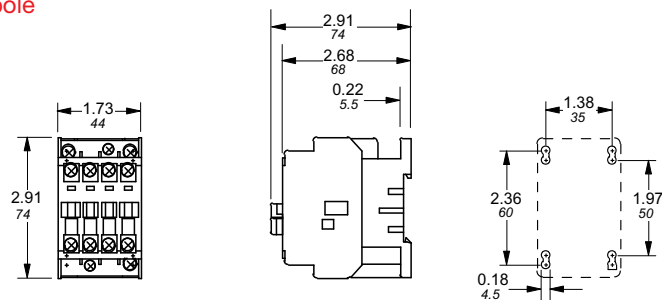

A/AE26 — Contactor, 4 pole

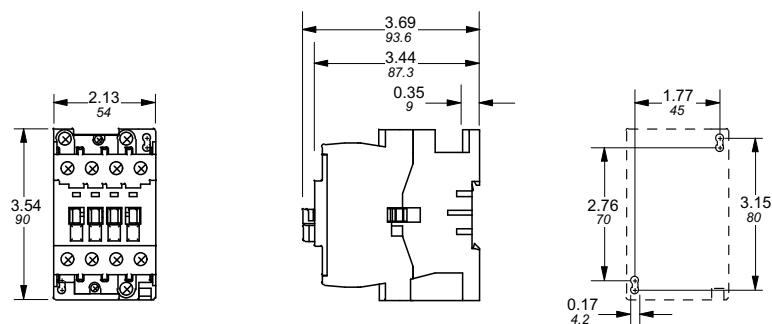

A/AE/AF45 – A/AE/AF75 — Contactor, 4 pole

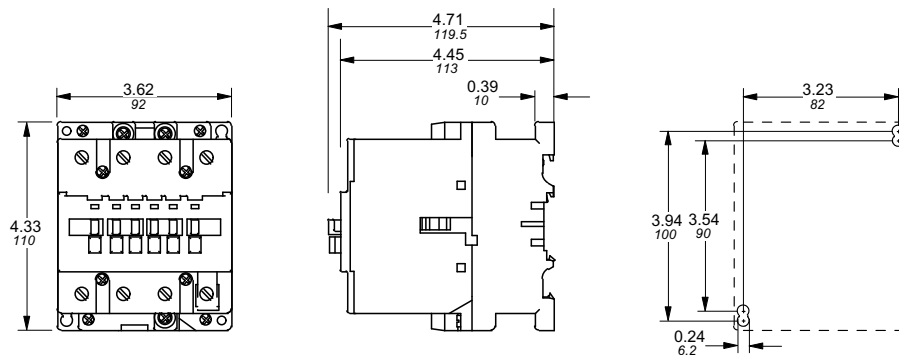


Approximate dimensions AL9 – AL40, 3 & 4 pole


Across the line
1

00.00 → Inches
00.00 → [Millimeters]


AL9, AL12, AL16 – Contactor, 3 & 4 pole

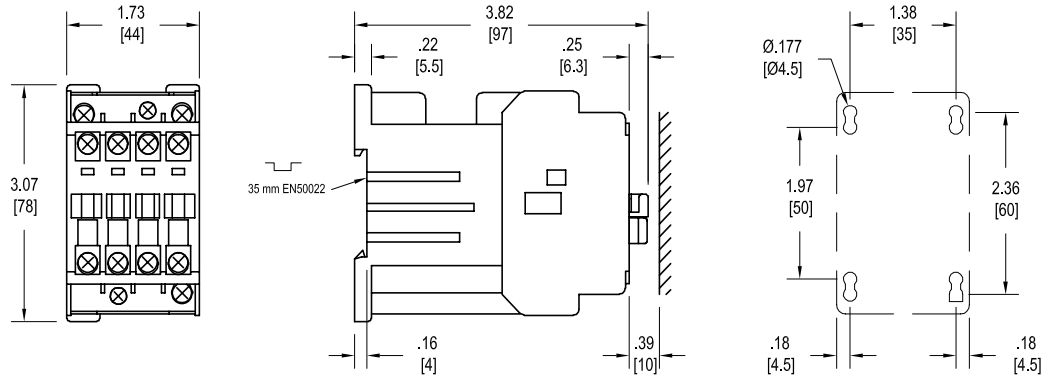

AL26 – Contactor, 3 & 4 pole

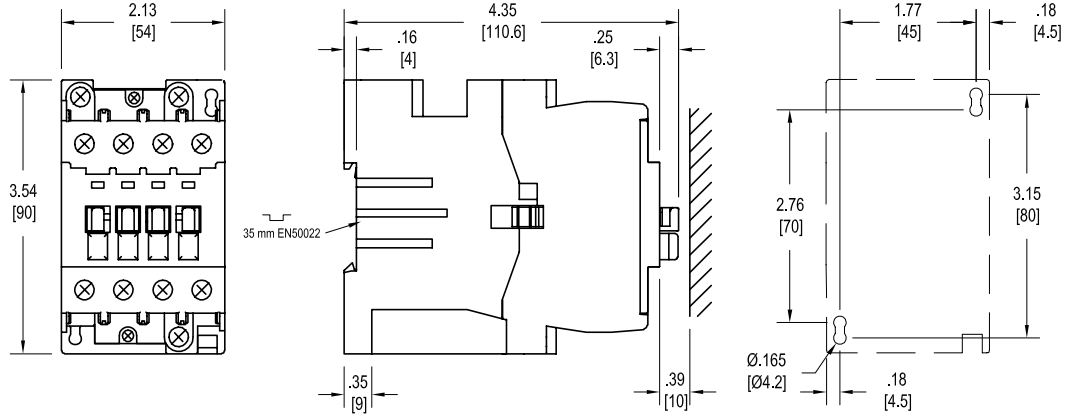

AL30, AL40 – Contactor, 3 pole

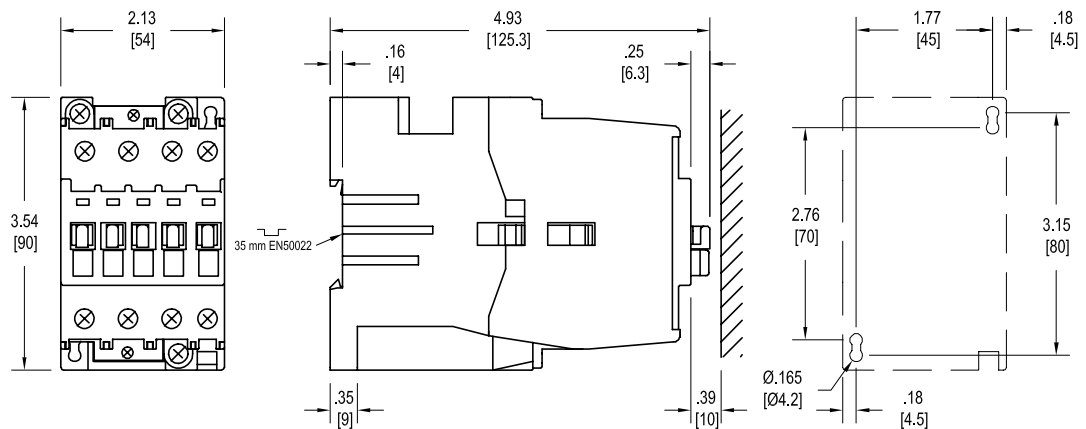


Approximate dimensions

Accessories for A/AE9 – A/AE/AF110


00.00 00.00 Inches
[Millimeters]

A/AE9 – A/AE40


A/AE/AF50 – A/AE/AF110




SIDE MOUNTED
AUXILIARY




SINGLE POLE
TOP MOUNTED
AUXILIARY




FOUR POLE
TOP MOUNTED
AUXILIARY



ON-POSITION
LATCH



PNEUMATIC
TIMER



MECH INTERLOCK D.C.
OPERATED

TYPE		A	B	C	D	E	F
A/AE9-16	IN	2.20	3.96	4.21	5.71	5.00	—
	MM	56	100.5	107	145	127	—
A/AE26	IN	2.20	4.72	4.97	6.47	5.76	—
	MM	56	119.8	126.3	164.3	146.3	—
A/AE30-40	IN	2.20	5.30	5.55	7.05	6.34	—
	MM	56	134.5	141	179	161	—
A/AE/AF50-75	IN	3.23	5.27	5.52	7.03	6.32	—
	MM	82	133.9	140.3	178.5	160.4	—
A/AE/AF45	IN	4.09	5.73	5.98	7.48	6.77	—
	MM	104	145.5	152	190	172	—
A/AE/AF95-110	IN	4.02	5.91	6.16	—	—	—
	MM	102	150	156.5	—	—	—


Approximate dimensions A/AF145 – A/AF185

Across the line


1

00.00 → Inches
00.00 → [Millimeters]


A/AF145 & A/AF185

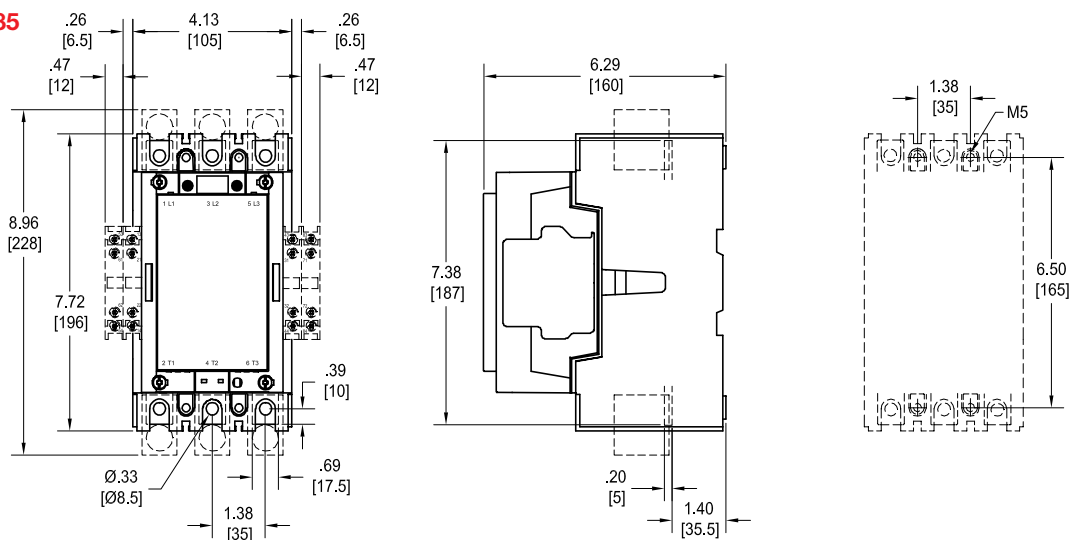

A/AF145, A/AF185 with mechanical interlock

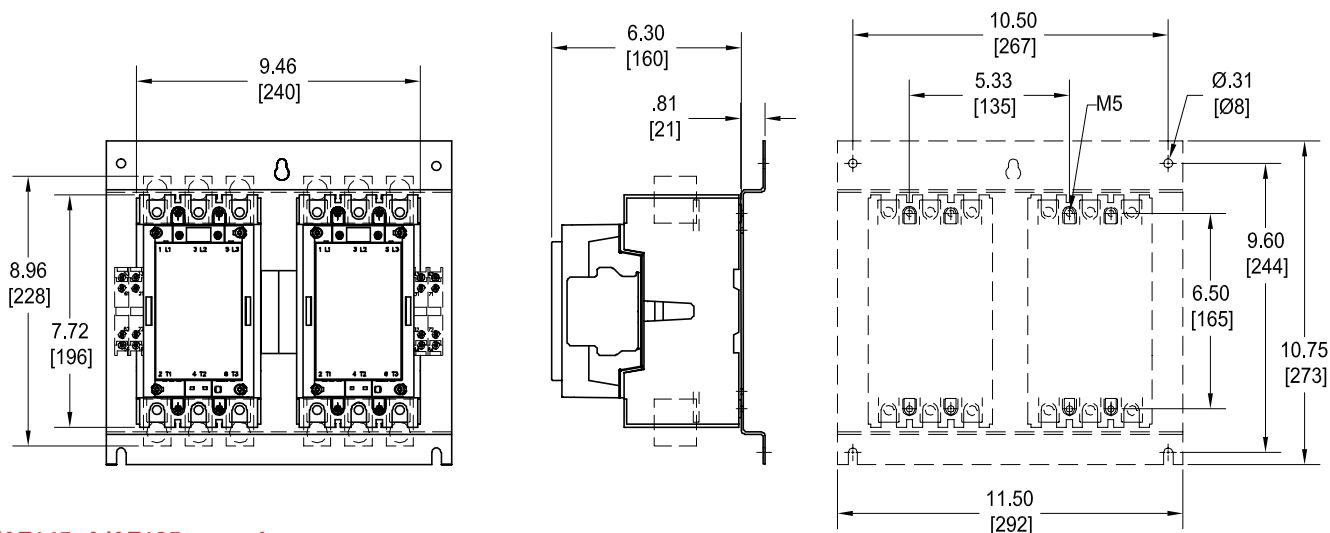


A/AF145, A/AF185 reversing

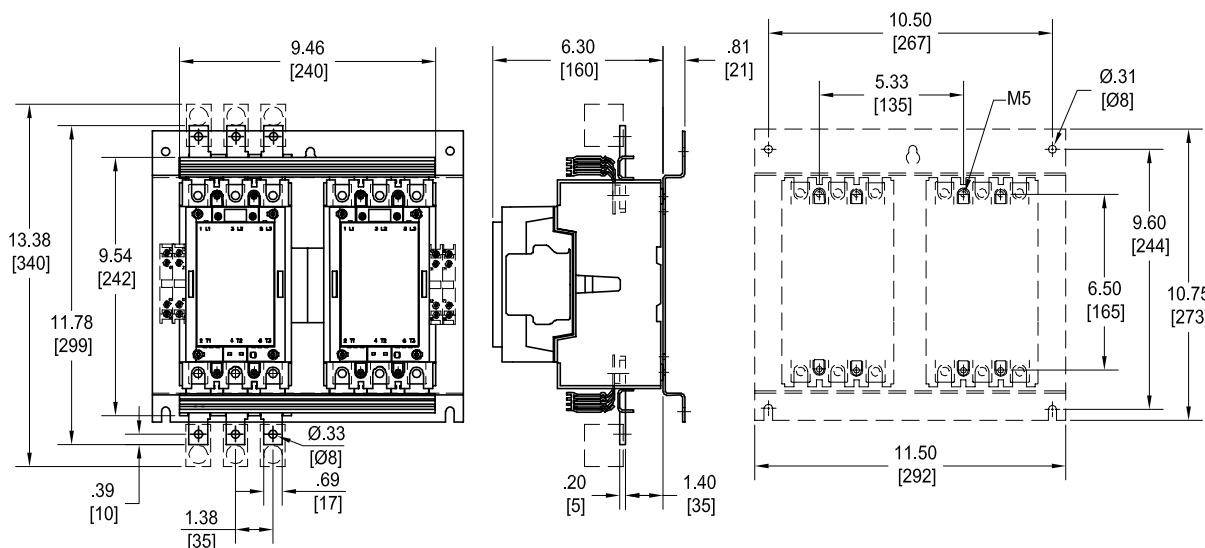


Approximate dimensions A/AF145 – A/AF300

00.00 00.00 Inches
[Millimeters]

A/AF145 – A/AE/AF95-110 mechanically interlocked

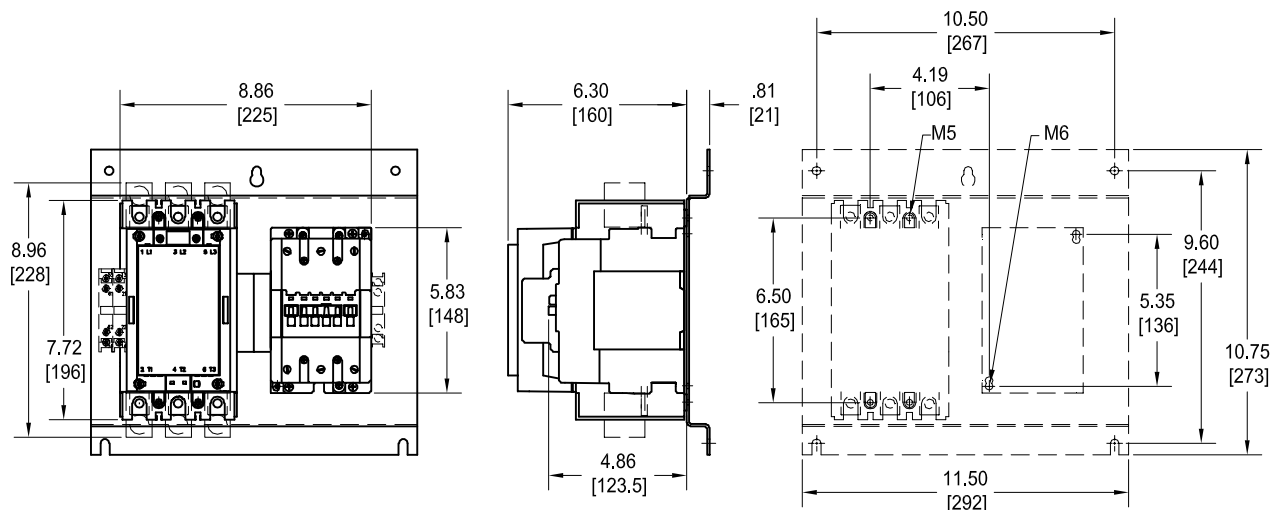

A/AF210, A/AF260, A/AF300

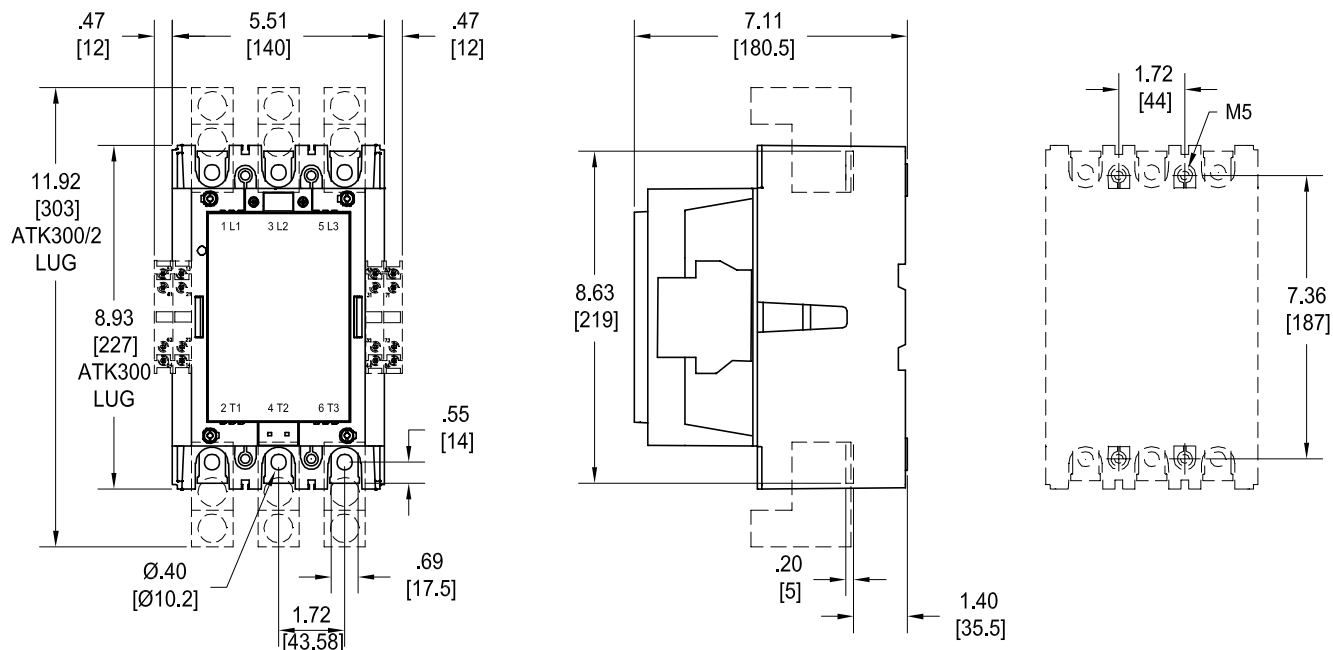

Across the line
contactors

← 00.00 → Inches
00.00 [Millimeters]

Technical drawings of the AF210, AF260, and AF300 reversing motor, showing dimensions in inches and millimeters.

Front View Dimensions:

- Width: 12.20 [310]
- Total Height: 11.92 [303]
- LUG Height: 8.93 [227]
- Side View Width: 7.11 [180.5]

Side View Dimensions:

- Width: 7.11 [180.5]
- Side View Height: .81 [21]

Top View Dimensions:

- Width: 13.25 [336]
- LUG Width: 6.71 [170]
- LUG Thread: M5
- LUG Hole: Ø.31 [Ø8]
- Total Height: 10.60 [269]
- LUG Height: 7.36 [187]
- Total Height: 11.75 [298]
- Base Width: 14.25 [362]

Motor Labels: AF210, AF260, AF300

Technical drawings of the ATK300/2 LUG showing front, side, and top views with dimensions in inches and millimeters.

Front View Dimensions:

- Overall Width: 12.20 [310]
- Overall Height: 17.43 [443]
- Height to Top Lug: 14.01 [356]
- Height to Bottom Lug: 11.31 [287.4]
- Bottom Lug Label: ATK300/2 LUG
- Top Lug Label: ATK300 LUG
- Internal Width (Terminals): 7.11 [180.5]
- Internal Height (Terminals): 6.71 [170]
- Terminal Spacing: 1.72 [44]
- Terminal Diameter: Ø.41 [Ø10]
- Terminal Thickness: .79 [20]
- Bottom Flange Thickness: .49 [12]

Side View Dimensions:

- Overall Width: 12.20 [310]
- Overall Height: 17.43 [443]
- Height to Top Lug: 14.01 [356]
- Height to Bottom Lug: 11.31 [287.4]
- Bottom Lug Label: ATK300/2 LUG
- Top Lug Label: ATK300 LUG
- Internal Width (Terminals): 7.11 [180.5]
- Internal Height (Terminals): 6.71 [170]
- Terminal Spacing: 1.72 [44]
- Terminal Diameter: Ø.41 [Ø10]
- Terminal Thickness: .79 [20]
- Bottom Flange Thickness: .49 [12]

Top View Dimensions:

- Overall Width: 14.25 [362]
- Overall Height: 11.75 [298]
- Height to Top Lug: 10.60 [269]
- Height to Bottom Lug: 7.36 [187]
- Bottom Lug Label: ATK300/2 LUG
- Top Lug Label: ATK300 LUG
- Internal Width (Terminals): 7.11 [180.5]
- Internal Height (Terminals): 6.71 [170]
- Terminal Spacing: 1.72 [44]
- Terminal Diameter: Ø.41 [Ø10]
- Terminal Thickness: .79 [20]
- Bottom Flange Thickness: .49 [12]

Technical drawings of the ATK300/2 LUG terminal block, showing front, side, and top views with dimensions in inches and millimeters.

Front View Dimensions:

- Overall Width: 10.84 [275.3]
- Overall Height: 11.92 [303]
- Height to Lug Center: 8.93 [227]
- Height to Lug Bottom: 7.72 [196]
- Height to Lug Top: 8.96 [228]

Side View Dimensions:

- Overall Depth: 7.11 [180.5]
- Base Width: 6.28 [160]


Top View Dimensions:

- Overall Width: 14.25 [362]
- Overall Height: 11.75 [298]
- Height to Lug Center: 7.36 [187]
- Height to Lug Bottom: 6.50 [165]
- Height to Lug Top: 10.60 [269]
- Distance between Lug Centers: 6.17 [157]
- Mounting Hole Diameter: .81 [21]
- Mounting Hole Pitch: M5


Approximate dimensions AF400 – AF460

00.00 → Inches
00.00 → [Millimeters]

AF400, AF460

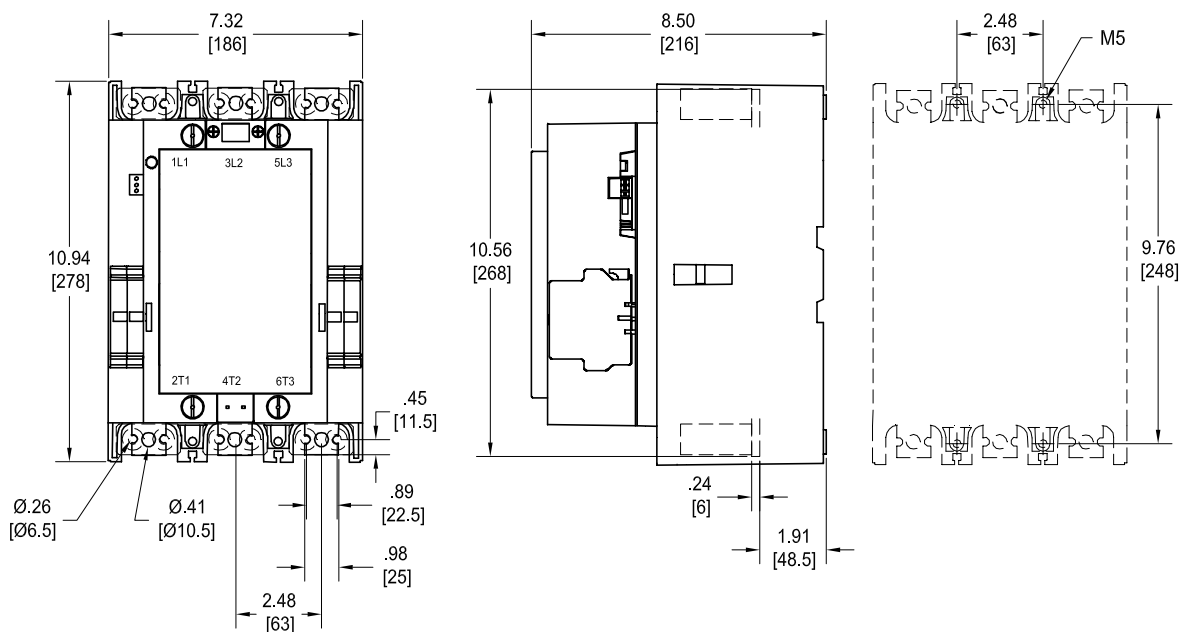

AF400, AF460 with mechanical interlock

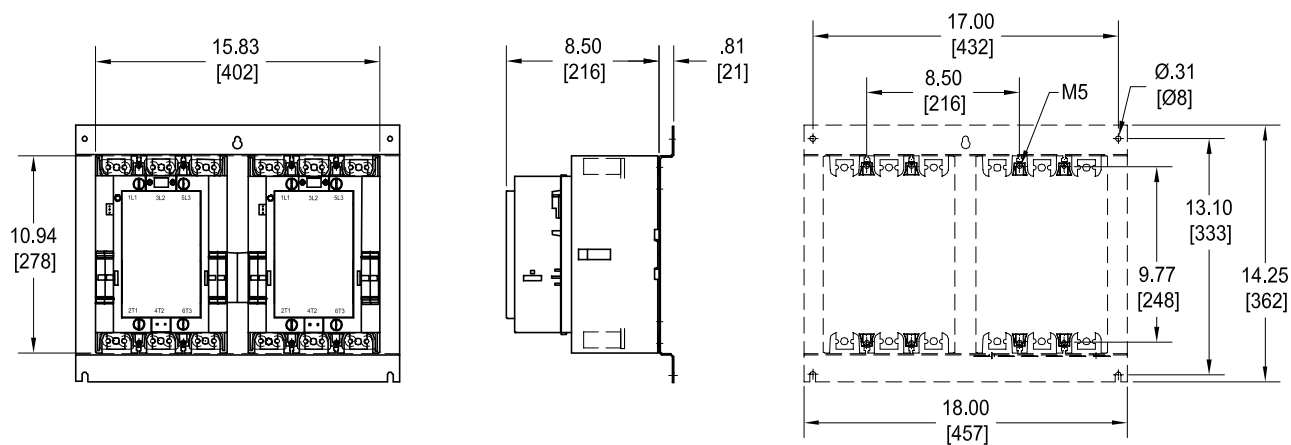


Approximate dimensions AF400 – AF750


Across the line
1

00.00 Inches
00.00 [Millimeters]

AF400, AF460 reversing

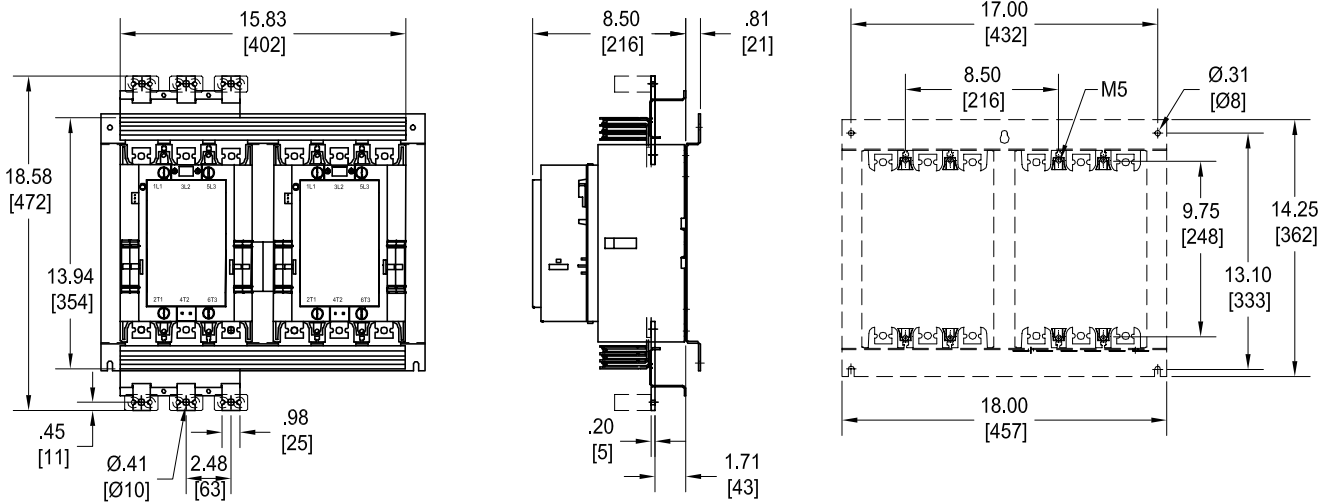


AF580 – AF750

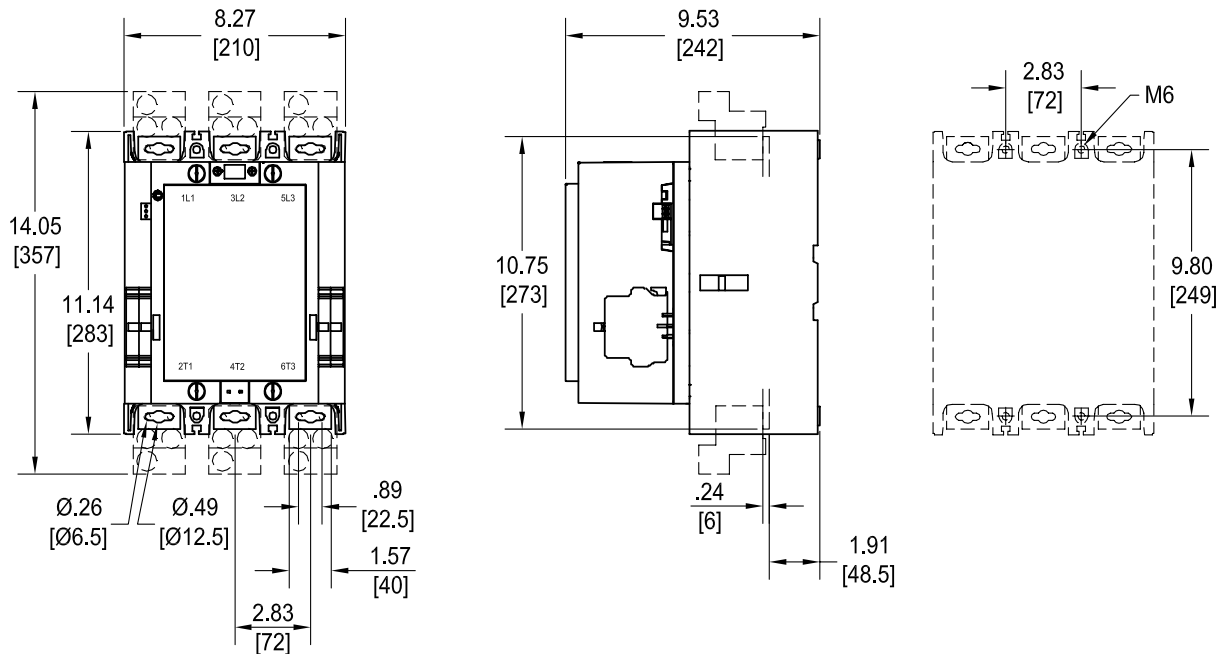


Approximate dimensions AF580 – AF750

00.00 → Inches
00.00 → [Millimeters]

AF580 – AF750 with mechanical interlock

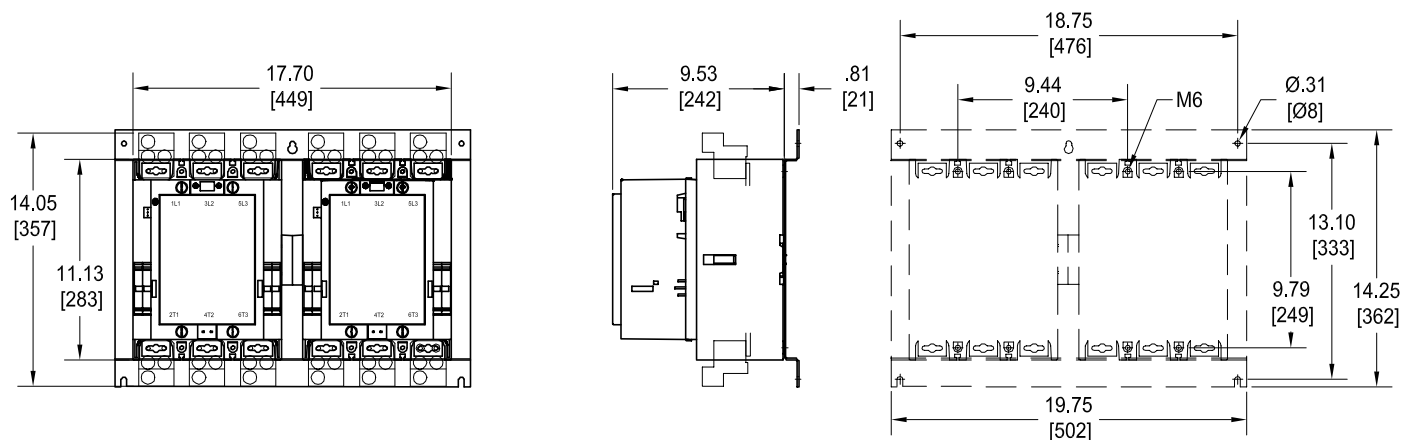

AF580 – AF750 reversing

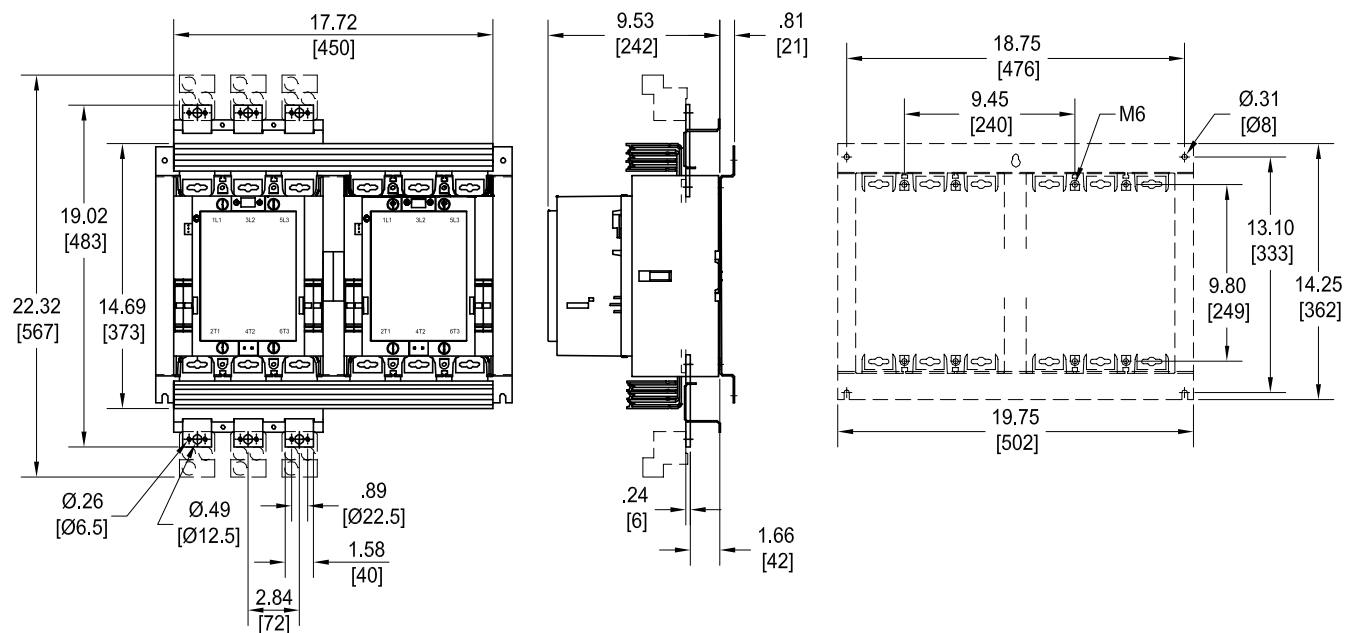


Approximate dimensions AF1350 – AF1650

Across the line
1


00.00 Inches
00.00 [Millimeters]

AF1350 – AF1650

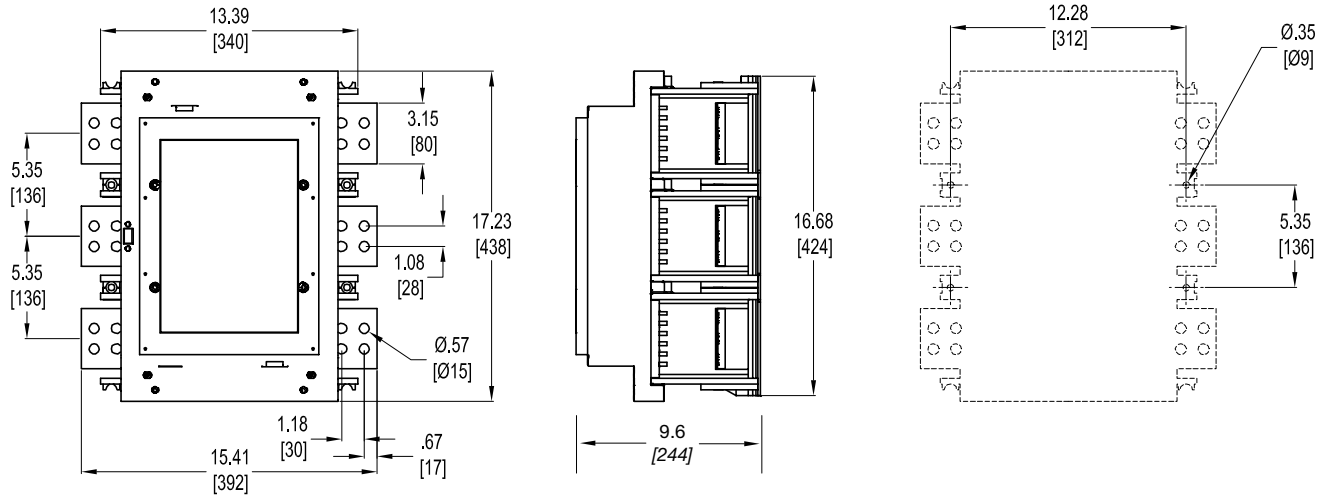

Approximate dimensions EK110 – EK550, 4 pole

00.00 Inches
00.00 [Millimeters]

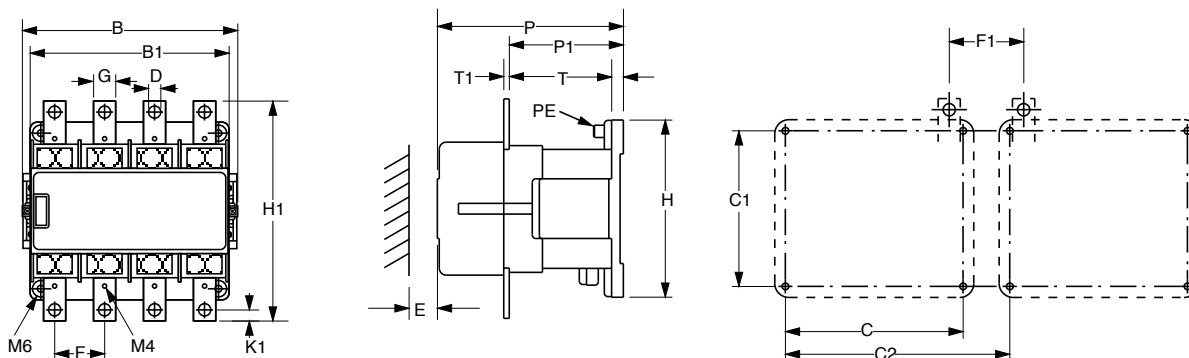

		B	B1	C	C1	D	E	F	F1	G	H	H1	K1	P	P1	T	T1
EK 110	in	6.50	5.35	4.72	5.51	0.26	1.57	1.61	1.69	0.59	6.14	6.14	0.30	6.08	4.03	0.39	0.16
	mm	165	136	120	140	6.6	40	41	43	15	156	156	7.5	154.5	102.3	10	4
EK 150	in	6.50	5.35	4.72	5.51	0.43	1.57	1.65	1.65	0.79	6.14	6.77	0.39	6.08	4.03	0.39	0.16
	mm	165	136	120	140	11	40	42	42	20	156	172	10	154.5	102.3	10	4
EK 175	in	7.91	6.93	6.30	5.51	0.43	0.59	1.77	2.64	0.79	6.14	7.80	0.39	6.77	4.20	0.39	0.20
	mm	201	176	160	140	11	15	45	67	20	156	198	10	172	106.7	10	5
EK 210	in	7.91	6.93	6.30	5.51	0.43	0.59	1.77	2.64	0.79	6.14	7.80	0.39	6.77	4.20	0.39	0.20
	mm	201	176	160	140	11	15	45	67	20	156	198	10	172	106.7	10	5
EK 370	in	10.63	9.61	8.66	7.87	0.43	1.57	2.64	2.76	0.98	8.78	10.71	0.49	8.88	5.49	0.91	0.24
	mm	270	244	220	200	11	40	67	70	25	223	272	12.5	225.5	139.5	23	6
EK 550	in	10.63	9.61	8.66	7.87	0.43	1.57	2.64	2.76	0.98	8.78	10.71	0.49	8.88	5.49	0.91	0.24
EK 1000	mm	270	244	220	200	11	40	67	70	25	223	272	12.5	225.5	139.5	23	6