

Monitoring Relays

True RMS 3-Phase, 3-Phase+N, Multifunction

Types DPC01, PPC01



DPC01



PPC01

- TRMS 3-phase over and under voltage, phase sequence, phase loss, asymmetry and tolerance monitoring relay
- Detect when all 3 phases are present and have the correct sequence
- Detect if all the 3-phase-phase or phase-neutral voltages are within the set limits
- Detect if asymmetry and tolerance are within the set value
- Separately adjustable setpoints
- Separately adjustable delay functions (0.1 to 30 s)
- Output: 2 x 8 A relay SPDT NE
- For mounting on DIN-rail in accordance with DIN/EN 50 022 (DPC01) or plug-in module (PPC01)
- 45 mm Euronorm housing (DPC01) or 36 mm plug-in module (PPC01)
- LED indication for relays, alarm and power supply ON


Product Description

3-phase or 3-phase+neutral line voltage monitoring relay for phase sequence, phase loss, asymmetry, tolerance, over and under voltage (separately adjustable set points)

with built-in time delay function. Supply ranges from 100 to 690 VAC covered by three multivoltage relays.

Ordering key

DPC 01 D M48

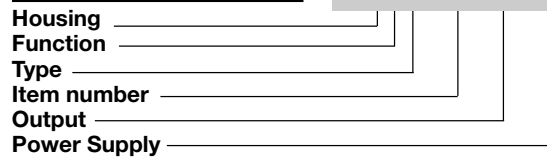

Type Selection

Mounting	Output	Frequency	Supply: 100 to 115 VAC	Supply: 208 to 240 VAC	Supply: 380 to 415 VAC
DIN-rail	2 x SPDT	50 - 60 Hz		DPC 01 D M23	
DIN-rail	2 x SPDT	50 - 400 Hz	DPC 01 D M11 400HZ	DPC 01 D M23 400HZ	DPC 01 D M48 400HZ
Plug-in	2 x SPDT	50 - 60 Hz		PPC 01 D M23	PPC 01 D M48
Mounting	Output	Frequency	Supply: 440 to 480 VAC	Supply: 380 to 480 VAC	Supply: 600 to 690 VAC
DIN-rail	2 x SPDT	50 - 60 Hz		DPC 01 D M48	DPC 01 D M69
DIN-rail	2 x SPDT	50 - 400 Hz	DPC 01 D M49 400HZ		DPC 01 D M69 400HZ

Input Specifications

Input	Input	Terminals	Ranges	Upper level	+2 to +22% of the nominal voltage
L1, L2, L3, N	DPC01:	Terminals L1, L2, L3, N	Upper level	-22 to -2% of the nominal voltage	
	PPC01:	Terminals 5, 6, 7, 11	Lower level	2 to 22% of the nominal voltage	
		Measure their own supply	Asymmetry	2 to 22% of the nominal voltage	
			Tolerance	2 to 22% of the nominal voltage	
Note: Connect the neutral only if it is intrinsically at the star centre			Note: The input voltage must not exceed the maximum rated voltage or drop below the minimum rated voltage reported above.		
Measuring ranges	Measuring ranges	Measuring ranges	Hysteresis	Set points from 2 to 5%	1%
M11		85 to 132 ΔVAC	Set points from 5 to 22% <td>2%</td> <td></td>	2%	
M23		177 to 275 ΔVAC			
M48	DPC01	323 to 550 ΔVAC			
	DPC01 400HZ	323 to 475 ΔVAC			
	PPC01	323 to 475 ΔVAC			
M49	DPC01	375 to 550 ΔVAC			
M69	DPC01	510 to 793 ΔVAC			

Output Specifications

Output	2 x SPDT relays N.E.
Rated insulation voltage	250 VAC
Contact ratings (AgSnO₂)	μ
Resistive loads	AC 1 8 A @ 250 VAC DC 12 5 A @ 24 VDC
Small inductive loads	AC 15 2.5 A @ 250 VAC DC 13 2.5 A @ 24 VDC
Mechanical life	≥ 30 x 10 ⁶ operations
Electrical life	≥ 10 ⁵ operations (at 8 A, 250 V, cos φ = 1)
Operating frequency	≤ 7200 operations/h
Dielectric strength	
Dielectric voltage	≥ 2 kVAC (rms)
Rated impulse withstand volt.	4 kV (1.2/50 μs)

Supply Specifications

Power supply	Overvoltage cat. III (IEC 60664, IEC 60038)
Rated operational voltage through terminals:	
L1, L2, L3, N (DPC01)	
5, 6, 7, 11 (PPC01)	
M11 - Delta Voltage:	100 to 115VAC ±15%; 45 to 65Hz
M23 - Delta Voltage:	208 to 240VAC ±15%; 45 to 65Hz
DPC01 M48 - Delta Voltage:	380 to 480VAC ±15%; 45 to 65Hz
DPC01 M48 - Star Voltage:	220 to 277VAC ±15%; 45 to 65Hz
PPC01 M48 - Delta Voltage:	380 to 415VAC ±15%; 45 to 65Hz
PPC01 M48 - Star Voltage:	220 to 240VAC ±15%; 45 to 65Hz
M48 400HZ - Delta Voltage:	380 to 415VAC ±15%; 45 to 440Hz
M48 400 HZ- Star Voltage:	220 to 240VAC ±15%; 45 to 440Hz
M49 400HZ - Delta Voltage:	440 to 480VAC ±15%; 45 to 440Hz
M49 400 HZ- Star Voltage:	254 to 277VAC ±15%; 45 to 440Hz
M69 - Delta Voltage:	600 to 690VAC ±15%; 45 to 65Hz
M69 - Star Voltage:	347 to 400VAC ±15%; 45 to 65Hz
M69 400HZ- Delta Voltage:	600 to 690VAC ±15%; 45 to 440Hz
M69 400HZ- Star Voltage:	347 to 400VAC ±15%; 45 to 440Hz
Rated operational power	
M11	8 VA @ Δ115 VAC, 50 Hz
M23	9 VA @ Δ230 VAC, 50 Hz
M48	13 VA @ Δ400 VAC, 50 Hz
M69	21 VA @ Δ600 VAC, 50 Hz
	Supplied by L2 and L3 for the DIN-rail versions and by L1 and L2 for the Plug-in versions

General Specifications

Power ON delay	1 s ± 0.5 s or 6 s ± 0.5 s	Housing	
Accuracy	(15 min warm-up time)	Dimensions	DPC01 45 x 80 x 99.5 mm PPC01 36 x 80 x 94 mm
Temperature drift	± 1000 ppm/°C	Weight	Approx. 220 g
Delay ON alarm	± 10% on set value ± 50 ms	Screw terminals	(DPC01)
Repeatability	± 0.5% on full-scale	Tightening torque	Max. 0.5 Nm acc. to IEC 60947
Reaction time		Approvals	UL, CSA GL (DPC01 only, except 400Hz, M11)
Incorrect phase sequence or total phase loss	< 200 ms	CE Marking	Yes
Voltage level	(input signal variation from -20% to +20% or from +20% to -20% of set value)	EMC	Electromagnetic Compatibility
Asymmetry level		Immunity	According to EN 61000-6-2
Alarm ON delay:	< 200 ms (delay < 0.1 s)	Emissions	According to EN 61000-6-3
Alarm OFF delay:	< 200 ms (delay < 0.1 s)		
Indication for			
Power supply ON	LED, green		
Alarm ON	LED, red (flashing 2 Hz during delay time)		
Output relays ON	2 x LED, yellow		
Environment	(EN 60529)		
Degree of protection	IP 20		
Pollution degree	3 (DPC01), 2 (PPC01)		
Operating temperature			
@ Max. voltage, 50 Hz	-20 to +60°C, R.H. < 95%		
@ Max. voltage, 60 Hz	-20 to +50°C, R.H. < 95%		
Storage temperature	-30 to +80°C, R.H. < 95%		

Mode of Operation

Asymmetry definition.

Asymmetry is an indicator of the mains quality and it is defined as the absolute value of the maximum deviation among the mains voltages, divided by the nominal voltage of the 3-phase system. The definition changes according to the voltage reference:

1) in case of measuring phase-phase voltages:

$$\frac{\max |\Delta V_{PH-PH}|}{V_{\Delta NOM}} \times 100$$

2) in case of measuring phase-neutral voltages:

$$\frac{\max |\Delta V_{PH-N}|}{V_{\Delta NOM}} \times 100$$

Tolerance definition.

Tolerance is another indicator of the mains quality and it is defined as the absolute value of the maximum deviation of the mains voltages from the nominal voltage, divided by the nominal voltage of the 3-phase system. The definition changes according to the voltage reference:

1) in case of measuring phase-phase voltages:

$$\frac{\max |V_{\Delta NOM} - V_{PH-PH}|}{V_{\Delta NOM}} \times 100$$

2) in case of measuring phase-neutral voltages:

$$\frac{\max |V_{\Delta NOM} - V_{PH-N}|}{V_{\Delta NOM}} \times 100$$

Connected to the 3 phases (and neutral) DPC01 and PPC01 operate when all 3 phases are present at the same time and the phase sequence is correct. It can be decided whether to monitor upper and lower voltage level of each phase or their asymmetry and tolerance.

Voltage level monitoring: if one or more phase-phase or phase-neutral voltage exceed the upper set level or drop below the lower set level, the red LED starts flashing 2 Hz and the respective output relay releases after the set time period.



Asymmetry and tolerance monitoring: if one or more phase-phase or phase-neutral voltage exceed the set levels the red LED starts flashing 2 Hz and the respective output relay releases after the set time period.

Note: For both functions, if the phase sequence is wrong or one phase is lost, both output relays release immediately. Only 200 ms delay occurs. The failure is indicated by the red LED flashing 5 Hz during the alarm condition.

Example 1 (Mains monitoring - over and under phase-phase voltage) The relay monitors over and under voltage, phase loss and correct phase sequence.

Example 2 (Motor monitoring - starting and operating load -asymmetry and tolerance of phase-neutral voltage) DPC01 and PPC01 ensure correct starting and operating conditions. They monitor the voltage level, phase sequence (correct direction of the motor rotation) and asymmetry.

Frequent failures are fuse blowing and incorrect voltage level. In case of fuse blowing the motor regenerates a voltage in the interrupted phase. The relay detects the failure and reacts due to excessive imbalance among the phases.

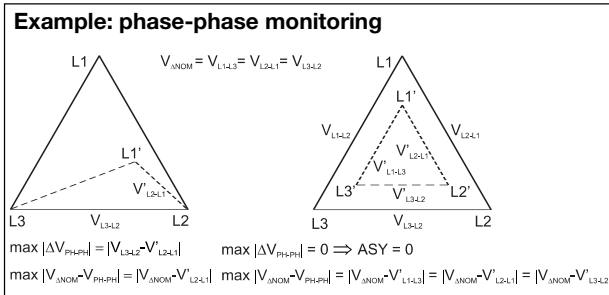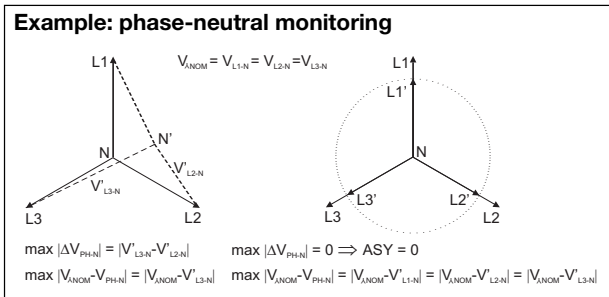




Function/Range/Level/Time Setting

Adjust the input range setting the DIP-switches 3 and 4. Select the desired function setting the DIP-switches 5 and 6 as shown below. To

access the DIP-switches open the plastic cover using a screwdriver as shown below.


Centre knobs: Setting of upper (*r*) and lower (*l*) level or setting of asymmetry (ASY) and tolerance (*λ*) on relative scale.

Lower knobs: Setting of delay on alarm times (DELAY 1, DELAY 2) on absolute scale: 0.1 to 30 s.

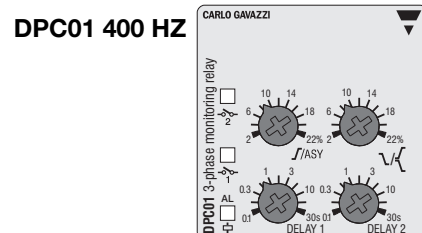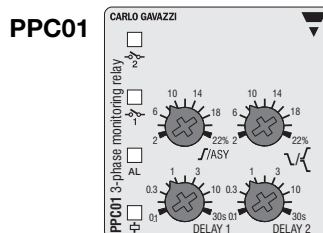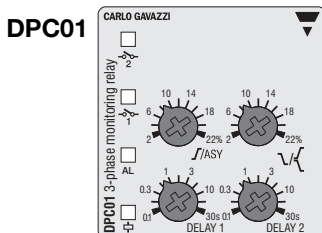



Function/Range/Level/Time Setting (cont.)

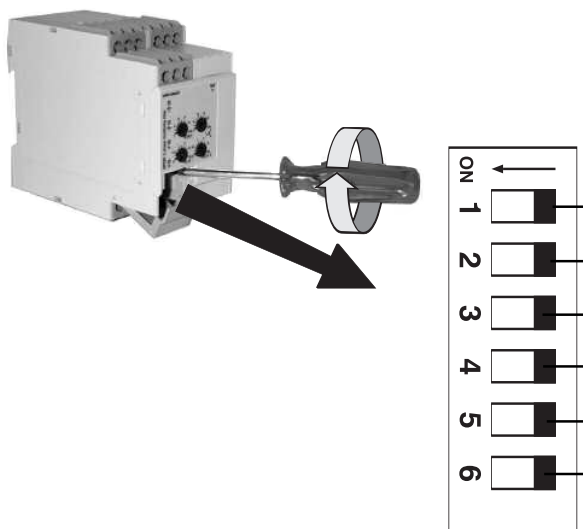

Power-ON delay
 ON: 6 s ± 0.5 s
 OFF: 1 s ± 0.5 s

Monitoring
 ON: Phase-Neutral voltages
 OFF: Phase-Phase voltages

Measuring range


SW3	ON	ON	OFF	OFF
SW4	ON	OFF	ON	OFF
M11 Ph-Ph Voltage	100 VAC	100 VAC	115 VAC	115 VAC
M23 Ph-Ph Voltage	208 VAC	220 VAC	230 VAC	240 VAC
M48 Ph-Ph Voltage	380 VAC	400 VAC	415 VAC	480 VAC DPC01 only
M48 Ph-N Voltage	220 VAC	230 VAC	240 VAC	277 VAC DPC01 only
M49 Ph-Ph Voltage	440 VAC	440 VAC	480 VAC	480 VAC
M49 Ph-N Voltage	254 VAC	254 VAC	277 VAC	277 VAC
DPC01DM69 Ph-Ph Volt.	600 VAC	600 VAC	690 VAC	690 VAC
DPC01DM69 Ph-N Volt.	347 VAC	347 VAC	400 VAC	400 VAC

Output
 ON: 2 x SPDT relays
 OFF: 1 x DPDT relay

Function
 ON: Asymmetry and tolerance monitoring
 OFF: Over and undervoltage monitoring


Operation Diagrams

Over and undervoltage monitoring (2 x SPDT relays)

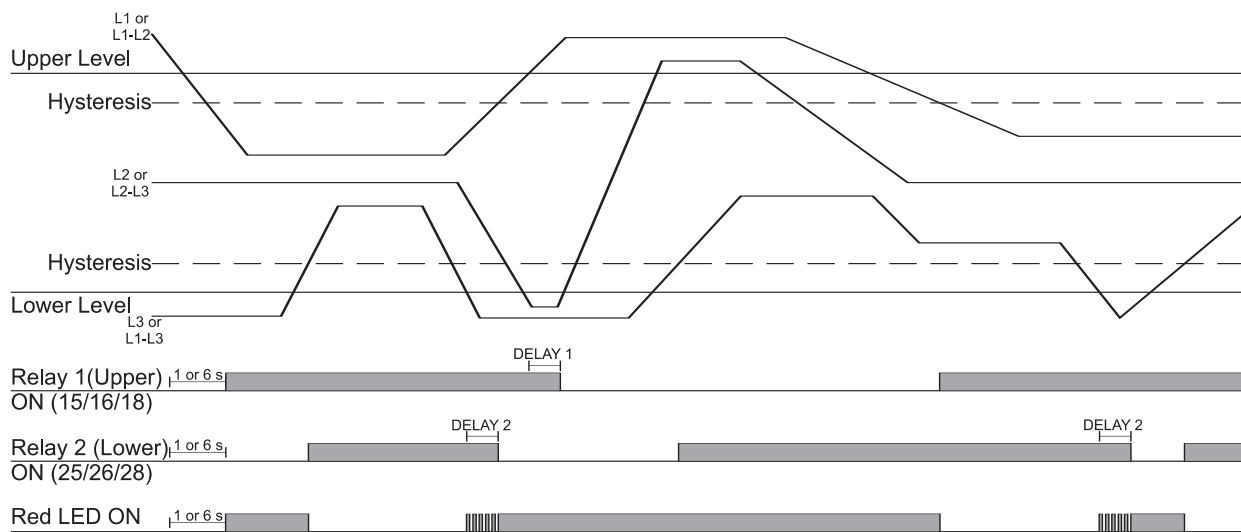


Operation Diagrams (cont.)



Asymmetry and tolerance monitoring (2 x SPDT relays)

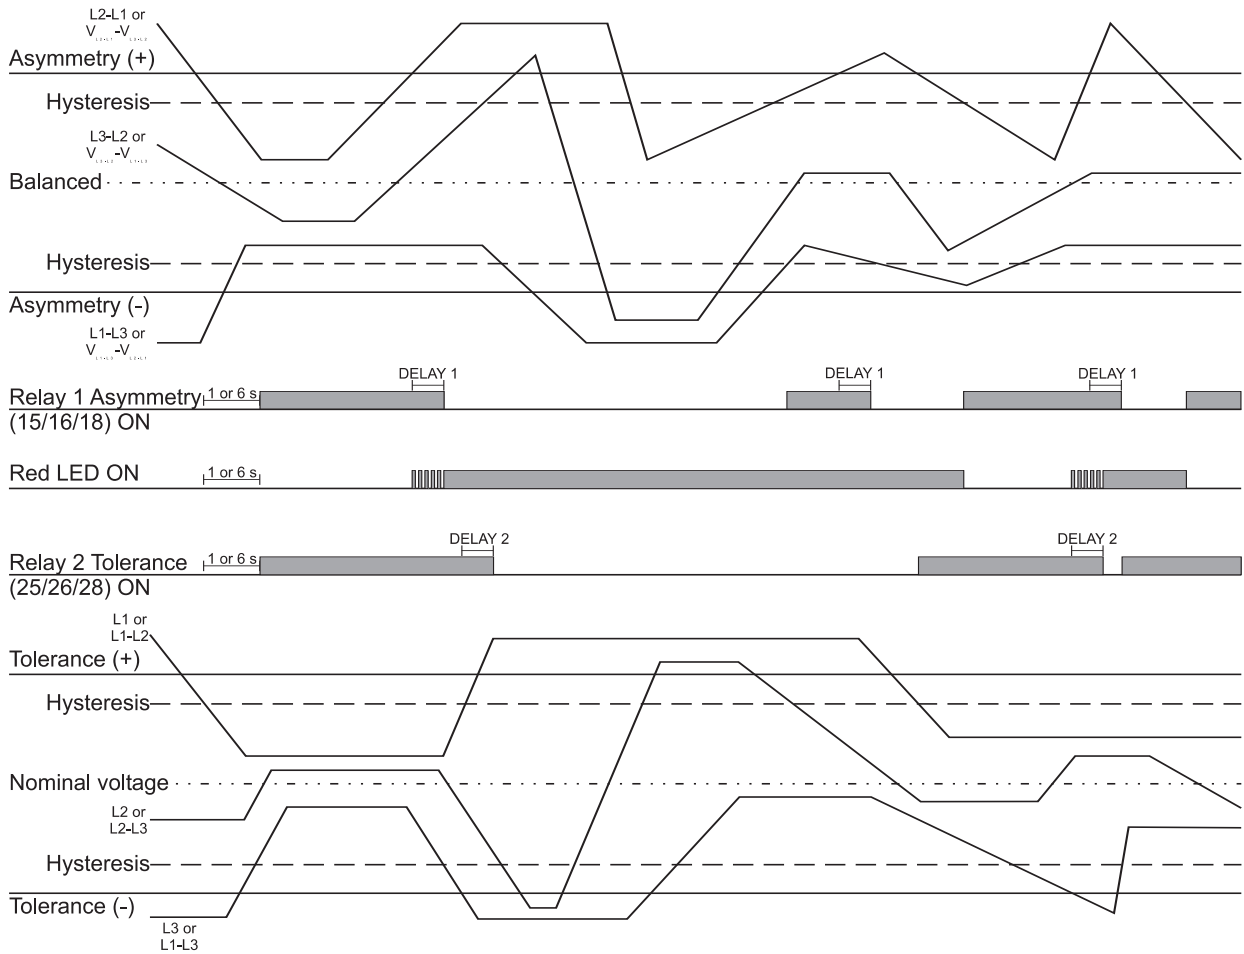

Phase sequence, total phase loss

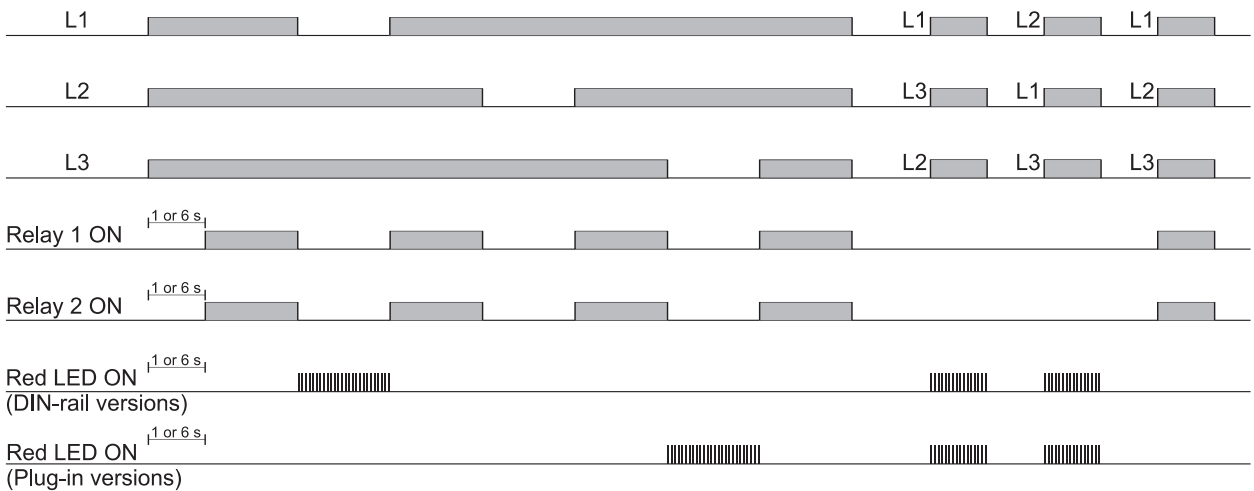

Wiring Diagrams

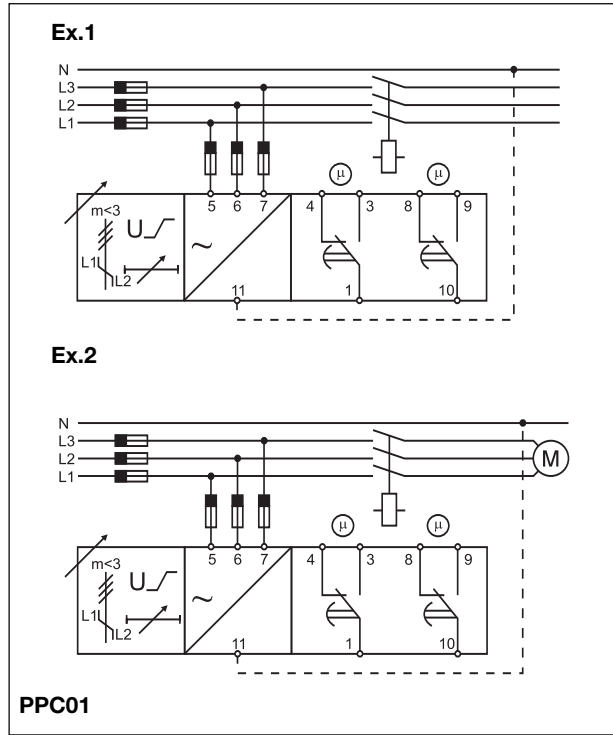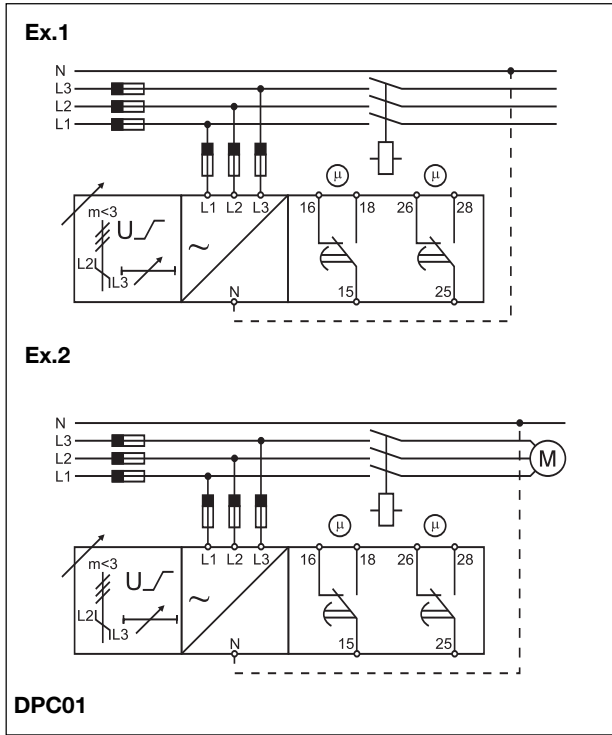

Dimensions

