

RS 2400W, 1 Output, Embedded Switch Mode Power Supply (SMPS), 12V dc, 200A

RS Stock number 674-1662




Features:

- AC input 180 ~ 264VAC
- · AC input active surge current limiting
- · High efficiency up to 90%
- Built-in active PFC function, PF>0.95
- Protections: Short circuit / Overload / Over voltage / Over temperature / Fan alarm
- Forced air cooling by built-in DC with fan speed control function
- Output voltage can be trimmed between 20~110% of the rated output voltage
- High power density 15.6W/inch³
- Current sharing up to 3 units
- Alarm signal output (relay contact and TTL signal)
- Built-in 12V/0.1A auxiliary output for remote control
- Built-in remote ON-OFF control
- Built-in remote sense function



MODEL		RSP-3000-12	RSP-3000-24	RSP-3000-48				
DC VOLTAGE		12V	24V	48V				
	RATED CURRENT	200A	125A	62.5A				
	CURRENT RANGE	0~200A	0 ~ 125A	0 ~ 62.5A				
	RATED POWER	2400W	3000W	3000W				
	RIPPLE & NOISE (max.) Note.2	150mVp-p	150mVp-p	200mVp-p				
DUTPUT	VOLTAGE ADJ. RANGE	10.8 ~ 13.2V	22 ~ 28V	43 ~ 56V				
	VOLTAGE TOLERANCE Note.3	±1.0%	±1.0%	±1.0%				
	LINE REGULATION	±0.5%	±0.5%	±0.5%				
	LOAD REGULATION	±0.5%	±0.5%	±0.5%				
	SETUP, RISE TIME	1000ms, 80ms at full load						
	HOLD UP TIME (Typ.)	10ms at full load						
	VOLTAGE RANGE	180 ~ 264VAC 254 ~ 370VDC						
	FREQUENCYRANGE	47 ~ 63Hz						
	POWER FACTOR (Typ.)	0.95/230VAC at full load						
NPUT	EFFICIENCY (Typ.)	86%	90%	90.5%				
	AC CURRENT (Typ.)	20A/180VAC 16A/230VAC						
	INRUSH CURRENT (Typ.)	60A/230VAC						
	LEAKAGE CURRENT	<2.0mA/240VAC						
		100 ~ 110% rated output power						
	OVERLOAD	User adjustable continuous constant current limiting or constant current limiting with delay shutdown after 5 seconds, re-power on to recove						
		13.8 ~ 16.8V	28.8 ~ 33.6V	57.6~67.2V				
PROTECTION	OVER VOLTAGE	Protection type: Shut down o/p voltage,	re-power on to recover					
		90°C±5°C(12V), 110°C±5°C(24V), 105°C±5°C (48V) (TSW1: detect on heatsink of power transistor)						
	OVER TEMPERATURE	90°C±5°C(12V), 85°C±5°C(24V), 75°C±5°C(48V) (TSW2: detect on heatsink of o/p diode)						
		Protection type: Shut down o/p voltage, recovers automatically after temperature goes down						
	AUXILIARY POWER(AUX)	12V@0.1A(Only for Remote ON/OFF control)						
	REMOTE ON/OFF CONTROL	Please see the Function Manual						
FUNCTION	ALARM SIGNAL OUTPUT	Please see the Function Manual						
	OUTPUT VOLTAGE TRIM	2.4 ~ 13.2V	4.8 ~ 28V	9.6 ~ 56V				
	CURRENT SHARING	Please see the Function Manual						
	WORKING TEMP.	-20 ~ +70°C (Refer to output load derating curve)						
	WORKING HUMIDITY	20~90% RH non-condensing						
ENVIRONMENT	STORAGE TEMP., HUMIDITY	-40 ~ +85°C, 10 ~ 95% RH						
	TEMP. COEFFICIENT	±0.05%/C (0~50°C)						
	VIBRATION	10~500Hz, 2G 10min /1 cycle, 60min. each along X, Y, Z axes						
	SAFETYSTANDARDS	UL60950-1, TUV EN60950-1 approved						
	WITHSTAND VOLTAGE	I/P-O/P:3KVAC I/P-FG:1.5KVAC O/P-FG:0.5KVAC						
SAFETY &	ISOLATION RESISTANCE	I/P-O/P, I/P-FG, O/P-FG:100M Ohms / 500VDC / 25°C/ 70% RH						
EMC	EMICONDUCTION & RADIATION							
(Note 4)	HARMONIC CURRENT	Compliance to EN61000-3-2,-3						
	EMS IMMUNITY	Compliance to EN61000-4-2,3,4,5,6,8,11; ENV50204, EN55024, light industry level, criteria A						
	MTBF	104.5K hrs min. MIL-HDBK-217F (25°C)						
OTHERS	DIMENSION	278*177.8*63.5mm (L*W*H)						
	PACKING	4Kg; 4pcs/16Kg/1.89CUFT						
IOTE	All parameters NOT specially mentioned are measured at 230VAC input, rated load and 25°C of ambient temperature.							
NOTE	Ripple & noise are measured at 20MHz of bandwidth by using a 12" twisted pair-wire terminated with a 0.1 of & 47 of parallel capacitor. Tolerance: includes set up tolerance, line regulation and load regulation. The power supply is considered a component which will be installed into a final equipment. The final equipment must be re-confirmed that it still meets EMC directives.							



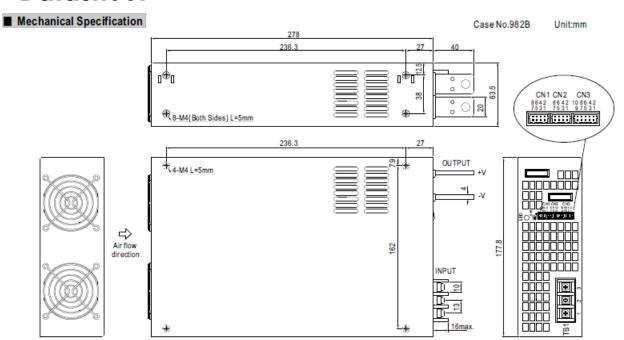

AC Input Terminal Pin No. Assignment

Pin No.	Assignment	
1	AC/L	
2	AC/N	
3	FG ÷	

Control Pin No. Assignment (CN1, CN2): HRS DF11-8DP-2DS or equivalent

Pin No.	Assignment	Pin No.	Assignment	Mating Housing	Terminal
1	RCG	5,7	-S		
2	RC	6	CS(CurrentShare)	HRS DF11-8DS	HRS DF11-**SC
3	PV	8	+S	or equivalent	orequivalent
4	PS				

RCG: Remote ON/OFF Ground

-S:-Remote Sensing RC : Remote ON/OFF CS: Load Share

:Output Voltage External Control

+S: +Remote Sensing

PS : Reference Voltage Terminal

Control Pin No. Assignment(CN3): HRS DF11-10DP-2DS or equivalent

Pin No.	Assignment	Mating Housing	Terminal						
1	P OK GND	4	P O K2	7	AUXG	10	OL-SD	LIDO DELL LODO	
2	POK	5	RCG	8	AUX			HRS DF11-10DS or equivalent	or equivalent
3	P OK GND2	6	RC	9	OLP			or oquivaront	or oquivaront

P OK GND: Power OK Ground

RCG: Remote ON/OFF Ground

AUX: Auxiliary Output

P OK: Power OK Signal (Relay Contact)


RC: Remote ON/OFF


OLP: OLP/OL-SD:OLP mode select

P OK2: Power OK Signal (TTL Signal)

AUXG: Auxiliary Ground



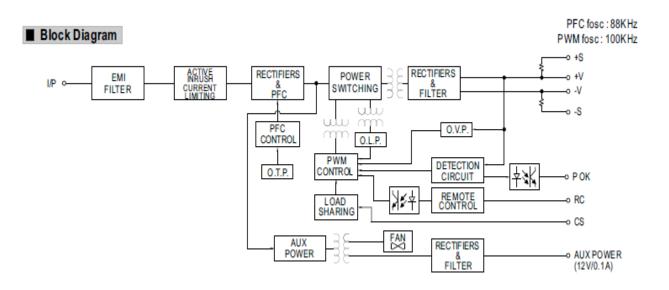

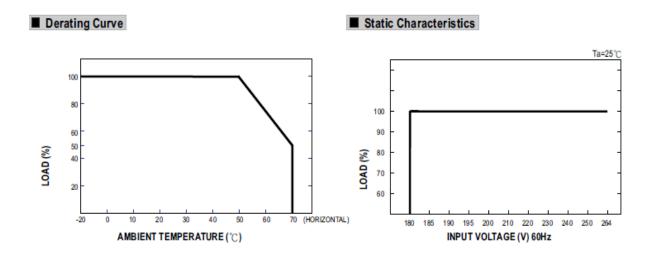

■ Function Manual

1.Remote ON/OFF

- (1)Remote ON/OFF control becomes available by applying voltage in CN1 & CN2 & CN3.
- (2)Table 1.1 shows the specification of Remote ON/OFF function.
- (3)Fig.1.2 shows the example to connect Remote ON/OFF control function.

Table 1.1 Specification of Remote ON/OFF

Connec	tion Method	Fig. 1.2(A)	Fig. 1.2(B)	Fig. 1.2(C)
SWLogic	Output on	SW Open	SW Open	SW Close
SWLOGIC	Output off	SW Close	SW Close	SW Open



■ Function Manual

1.Remote ON/OFF


- (1)Remote ON/OFF control becomes available by applying voltage in CN1 & CN2 & CN3.
- (2)Table 1.1 shows the specification of Remote ON/OFF function.
- (3)Fig. 1.2 shows the example to connect Remote ON/OFF control function.

Table 1.1 Specification of Remote ON/OFF


Connec	tion Method	Fig. 1.2(A)	Fig. 1.2(B)	Fig. 1.2(C)
SW Logic	Output on	SW Open	SW Open	SW Close
SWLogic	Output off	SW Close	SW Close	SW Open

Fig.1.2 Examples of connecting remote ON/OFF


(A)Using external voltage source



(B)Using internal 12V auxiliary output




(C)Using internal 12V auxiliary output




3.Output Voltage TRIM

- (1)Connecting an external DC source between PV and-S on CN1 or CN2 that is shown in Fig. 3.1.
- (2)Adjustment of output voltage is possible between 20~110% (Typ.) of the rated output which is shown in Fig. 3.2. Reducing output current is required when the output voltage is trimmed up.











Fig. 3.2 Output voltage trimming



4.Current Sharing

- (1)Parallel operation is available by connecting the units shown as below (+S,-S and CS are connected mutually in parallel):
- (2) The voltage difference among each output should be minimized that less than ±2% is required.
- (3)The total output current must not exceed the value determined by the following equation. (Output current at parallel operation)=(The rated current per unit) x (Number of unit) x 0.9
- (4) In parallel operation 3 units is the maximum, please consult the manufacturer for other applications.
- (5) When remote sensing is used in parallel operation, the sensing wire must be connected only to the master unit.
- (6) Wires of remote sensing should be kept at least 10 cm from input wires.

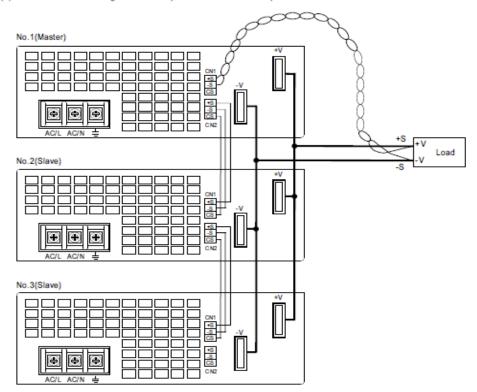

- (7) Under parallel operation, the O.L.P. function can only choose "constant current limiting with delay shut down".
- (8) Under parallel operation, the "output voltage trim" function is not available.

5.Select O.L.P mode

- (1)Remove the shorting connector on CN3 that is shown in Fig 5.1, the O.L.P. mode will be "continuous constant current limiting".
- (2)Insert the shorting connector on CN3 that is shown in Fig 5.2, the O.L.P. mode will be "constant current limiting with delay shutdown after 5 seconds, re-power on to recover.



Fig. 5.1 Remove the CN3
OLP Mode: constant current limiting





Fig. 5.2 Insert the CN3

OLP Mode: constant current limiting with delay shutdown after 5 seconds



6.Three Phase Connect

■ FIG. A: 3 ϕ 3W 220 VAC SYSTEM (STANDARD MODEL FOR STOCK)

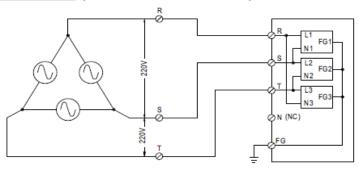

■ FIG. B: 3 \(\phi \) 4W 220/380VAC SYSTEM

